



OXYGEN PIPELINE AND PIPING SYSTEMS

AIGA 021/12

Globally Harmonised Document

Replaces AIGA 021/05

Asia Industrial Gases Association

3 HarbourFront Place, #09-04 HarbourFront Tower 2, Singapore 099254
Tel : +65 62760160 Fax : +65 62749379
Internet : <http://www.asiaiga.org>



OXYGEN PIPELINE AND PIPING SYSTEMS

Disclaimer

All technical publications of AIGA or under AIGA's name, including Codes of practice, Safety procedures and any other technical information contained in such publications were obtained from sources believed to be reliable and are based on technical information and experience currently available from members of AIGA and others at the date of their issuance.

While AIGA recommends reference to or use of its publications by its members, such reference to or use of AIGA's publications by its members or third parties are purely voluntary and not binding.

Therefore, AIGA or its members make no guarantee of the results and assume no liability or responsibility in connection with the reference to or use of information or suggestions contained in AIGA's publications.

AIGA has no control whatsoever as regards, performance or non performance, misinterpretation, proper or improper use of any information or suggestions contained in AIGA's publications by any person or entity (including AIGA members) and AIGA expressly disclaims any liability in connection thereto.

AIGA's publications are subject to periodic review and users are cautioned to obtain the latest edition.

NOTE—Technical changes from the previous edition are underlined.

Table of Contents

1	Introduction	1
2	Scope and purpose.....	1
3	Definitions.....	2
4	Design philosophy.....	4
4.1	General criteria	4
4.2	Materials compatibility for oxygen service.....	6
4.3	Selection of metals	7
4.3.1	Velocity exemption pressures for standard purity oxygen	8
4.3.2	Reduced purity oxygen-enriched atmospheres.....	8
4.3.3	Ultra high purity (UHP) oxygen atmospheres.....	9
4.3.4	Temperature limitations.....	9
4.4	Velocity and gas pressure criteria	10
4.5	Selection of non-metal.....	12
4.5.1	Properties and risks.....	12
4.6	Piping systems.....	14
4.7	Siting, remote operation, use of barriers	15
5	Piping, valves, and equipment	16
5.1	General criteria	16
5.1.1	Material selection criteria.....	16
5.2	Piping and fittings	16
5.2.1	Impingement sites	16
5.2.2	Non-impingement sites.....	17
5.2.3	Specific piping locations	17
5.3	Valves	18
5.3.1	General.....	18
5.3.2	Valve functions	19
5.3.3	Valve types.....	21
5.3.4	Valve seals and packing.....	22
5.3.5	Other possible sources of ignition in valves	22
5.4	Equipment.....	22
5.4.1	Conical strainers.....	22
5.4.2	Y-strainers	23
5.4.3	Filters.....	23
5.4.4	Flow-measuring devices.....	24
5.4.5	Bursting disks	25
5.4.6	Insulating joints.....	25
5.4.7	Flexible connections.....	26
5.4.8	Miscellaneous equipment items	26
5.4.9	Protection systems	27
5.4.10	Heat exchangers	27
5.5	Lubricants	27
6	Cleaning.....	28
6.1	General requirements	28
6.1.1	Cleaning strategy	28
6.1.2	Standard of cleanliness	28
6.1.3	Cleaning methods	28
6.1.4	Piping system components	29
6.1.5	Welding.....	29
6.1.6	Pressure testing.....	29
6.1.7	Installation of piping equipment.....	29
6.2	Specification and manufacture of line pipe material.....	30
6.2.1	General requirements.....	30
6.2.2	Codes and standards	30
6.2.3	Manufacturing process	30
6.2.4	Heat treatment.....	30
6.2.5	Hydrostatic test.....	30

6.3	Pre-cleaned piping.....	30
6.3.1	General.....	30
6.3.2	Pipe fabrication.....	31
6.3.3	Pressure testing.....	31
6.3.4	Internal surface finish.....	31
6.3.5	Preparation for shipment.....	31
6.3.6	Maintaining cleanliness.....	31
6.3.7	Final cleaning.....	32
6.3.8	Leak testing and blowout.....	32
6.4	Post-installation cleaning.....	33
6.4.1	General.....	33
6.4.2	Pressure testing.....	33
6.4.3	Internal surface finish.....	33
6.4.4	Maintaining cleanliness.....	33
6.4.5	Leak testing and blowout.....	33
6.5	Inspection.....	33
6.5.1	Procedure.....	33
6.5.2	UVA light examination.....	34
6.5.3	Acceptance criteria.....	34
6.5.4	Remedial action.....	34
6.5.5	Sealing, purging, and monitoring.....	34
6.6	Records.....	34
7	Construction.....	34
7.1	General criteria.....	34
7.2	Construction plan.....	35
7.3	Pipe fabrication and welding.....	35
7.3.1	General.....	35
7.3.2	Qualifications.....	36
7.3.3	Backing rings.....	36
7.3.4	Preparation for welding.....	36
7.3.5	Welding requirements for materials.....	36
7.4	Assembly and installation.....	36
7.4.1	Alignment.....	36
7.4.2	Flanged joints.....	37
7.4.3	Insulating joints.....	37
7.4.4	Threaded joints.....	37
7.4.5	Valves.....	38
7.4.6	Supports, guides, and anchors.....	38
7.5	Inspection and examination.....	38
7.6	Non-destructive testing.....	39
7.6.1	Pressure testing.....	39
7.6.2	X-ray examination.....	39
7.7	Documentation.....	40
8	Design and construction of control stations.....	40
8.1	Function.....	40
8.2	Design brief.....	40
8.2.1	Emergency shut-off valves.....	40
8.2.2	Isolation valves.....	41
8.2.3	Throttling and process control valves.....	41
8.2.4	Filters and strainers.....	41
8.2.5	Flowmeters.....	41
8.2.6	Flow and pressure control.....	42
8.2.7	Gas storage.....	42
8.2.8	Spill or vent control.....	42
8.2.9	Pressure relief and vent valves.....	42
8.2.10	Instruments.....	42
8.3	Standards and design codes.....	42
8.4	Materials.....	43

8.5	Barriers or screens	43
8.5.1	Barrier requirements criteria.....	43
8.5.2	Design criteria.....	43
8.5.3	Operational requirements	44
8.6	Location	44
8.7	Earthing, grounding	45
8.8	Fabrication	45
8.9	Installation.....	46
8.10	Testing	46
8.10.1	Post fabrication.....	46
8.10.2	Post installation	46
8.11	Commissioning	46
8.11.1	Safety	46
8.11.2	Procedure	46
8.11.3	Filters.....	47
8.12	Operation.....	47
9	Operation, monitoring, and maintenance.....	47
9.1	General safety instruction.....	47
9.1.1	Personnel for operation and maintenance	48
9.1.2	Operating isolation valves	48
9.1.3	Welding and cutting work	48
9.1.4	Oxygen enrichment and deficiency	48
9.1.5	Shutdown/startup of pipelines and piping systems	49
9.1.6	Venting and pressure relief	49
9.1.7	Purging	50
9.1.8	Tools.....	50
9.2	Commissioning pipelines, piping, and stations.....	50
9.3	Operation and monitoring.....	50
9.4	Information to third parties, work adjacent to pipelines, and update of documents	51
9.4.1	General.....	51
9.4.2	Flow of information	51
9.4.3	Summary of work	51
9.4.4	Records	51
9.4.5	Updating of pipeline drawings	51
9.5	Specialized surveys	51
9.6	Damage to the pipeline system	52
9.6.1	Leakage.....	52
9.6.2	Revalidation.....	52
10	General protective measures	52
10.1	Emergency response plan.....	52
10.1.1	Liaison with public authorities and other consultees	52
10.1.2	Description of pipeline system.....	52
10.1.3	Control centers	52
10.1.4	Notification of an incident	53
10.1.5	Alerting procedure	53
10.1.6	Shutting down a pipeline	53
10.1.7	Emergency equipment	53
10.1.8	Remedial action.....	53
10.1.9	Pipelines with cathodic protection	53
10.1.10	Incident report form.....	53
10.1.11	Emergency exercises	53
10.2	Power supplies and lightning strikes	53
10.3	Fire.....	54
10.4	Oxygen deprivation hazards and precautions	55
10.5	Accident and damage report	55
10.6	Safety management system	55
10.6.1	Notification to authorities and consultation on routing	55
10.6.2	Design and construction.....	55

10.6.3	Shut-down systems	55
10.6.4	Operations	55
10.6.5	Control of third party interference.....	56
10.6.6	Maintenance and inspection.....	56
10.6.7	Major accident prevention policies and safety management systems	56
10.6.8	Emergency planning.....	56
10.6.9	Information to the public and interested parties	57
10.6.10	Land use planning	57
10.6.11	Accident reporting.....	57
11	References.....	57
12	Additional references	60
	Appendix A—Description of promoted ignition combustion test method (Informative)	66
	Appendix B—Potential Ignition Mechanisms (Informative).....	68
	Appendix C—Table of nominal alloy compositions and ranges (Normative).....	69
	Appendix D—Table of exemption pressures and minimum thicknesses (Normative).....	70
	Appendix E—Table of minimum safety distances (without barriers) for oxygen control and isolating/metering stations (Informative)	71
	Appendix F—Example of preventive maintenance program (Normative).....	72

1 Introduction

This publication has been prepared by a group of specialists in oxygen piping and pipeline systems, representing major oxygen producers in various countries of Europe and North America and is based on the technical information and experience currently available to the authors.

The industrial gases companies have engaged, through the International Harmonisation Council (IHC), comprised of the Asia Industrial Gases Association (AIGA), Compressed Gas Association (CGA) and the European Industrial Gases Association (EIGA), Japan Industrial and Medical Gases Association (JIMGA) in a process of developing harmonized safety practices and this publication is one of them.

It must be recognized, however, that oxygen pipeline systems developed over 40 years in the various countries of Europe and North America have shown good and comparable safety records, although national practices show many differences in design and operations. Some national authorities have also introduced legislation that is mandatory for the operators in those countries. The information contained in this document applies only to future installations and not to existing installations. However, the information contained in this document may benefit existing installations or those in the project phase. Furthermore, to the extent that they exist, national laws supersede the suggested practices listed in this publication. It should not be assumed that every local standard, test, safety procedure, or method is contained in these recommendations or that abnormal or unusual circumstances may not warrant additional requirements or procedures. The authors make no representations or warranties on the information in or the completeness of this document and disclaim all warranties, express or implied including, but not limited to, the warranty of merchantability and the warranty of fitness for a particular use or purpose.

ISO units and corresponding Imperial units in parentheses are used in this document. Corresponding values may be approximate.

2 Scope and purpose

The scope of this document is for metal oxygen pipelines, distribution piping systems, and gaseous oxygen piping on an air separation plant external to the coldbox. It is limited to gaseous oxygen with a temperature range between $-30\text{ }^{\circ}\text{C}$ and $200\text{ }^{\circ}\text{C}$ ($-22\text{ }^{\circ}\text{F}$ and $400\text{ }^{\circ}\text{F}$), pressures up to 21 MPa (3000 psig) and a dew point of $-30\text{ }^{\circ}\text{C}$ ($-22\text{ }^{\circ}\text{F}$) or lower depending on local conditions.

This document does **not** apply to the following processes:

- oxygen cylinder filling plants;
- medical oxygen piping installations;
- cold box internal piping;
- oxygen compressor units;
- liquid oxygen vaporizers;
- bulk oxygen facilities (liquid or high pressure gas) at the customer's site up to the point where gas enters the distribution systems; or
- piping on specialized equipment and machines such as scarfing, jet piercing, etc.

The purpose of this publication is to further the understanding of those engaged in the safe design, operation, and maintenance of gaseous oxygen transmission and distribution systems. It is not intended to be a mandatory standard or code.

Some of the practices represent conservative compromises and not all situations are described. The designer is cautioned that this document is not a complete design handbook and does not do away with the need for competent engineering judgment and interpretation. It is suggested that the user review any special problems or concerns with his oxygen supplier who should be able to provide advice and guidance.

Although the technical information provided in this document is not intended to be mandatory, the word "shall" is frequently used. The use of "shall" implies a strong concern that the particular practice referenced be followed for safety reasons. The use of "should" implies that the referenced practice is commonly followed, but recognizes that other safe practices are sometimes utilized.

3 Definitions

Distribution piping

Piping and components contained on the property (generally owned by the customer) at the oxygen use point.

Plant piping

Piping within the oxygen production facility

Transmission pipeline

Piping between the oxygen production plant boundary and distribution piping boundary including that which passes over public land and third party property

Gaseous oxygen

Gas that contains more than 23.5% oxygen by volume (with the remainder of its components being inert)

Burn resistant alloys

Burn resistant alloys are engineering alloys that, after being subjected to an ignition event, either will not burn or exhibit burn quenching behaviour, resulting in minimal consumption. A metal used at or below its exemption pressure, for a defined set of process conditions including oxygen purity, temperature, and minimum material thickness would be considered to be a "burn resistant alloy" under those conditions. Examples of metals which are highly burn resistant, and hence exhibit high exemption pressures, are copper, nickel, and copper/nickel alloys such as Monel. Other engineering alloys, such as stainless steel, may exhibit varying degrees of burn resistance depending upon oxygen pressure, oxygen purity, temperature, equipment configuration, piping layout, and metal thickness..

Exemption pressure

Exemption pressure is the maximum pressure at which a material is not subject to velocity limitations in oxygen enriched atmospheres where particle impingement may occur. At pressures below the exemption pressure, ignition and burn propagation is considered unlikely to occur based on ignition mechanisms listed in this document. The exemption pressures of the alloys listed in Appendix D are based on industry experience and under the conditions used for the promoted ignition combustion testing per ASTM G124, Test Method for Determining the Combustion Behaviour of Engineering Materials in Oxygen-Enriched Atmospheres [1].

NOTE –Materials may be used above their exemption pressures provided that the pressure velocity values are below the curves in Figures 2 and 3 or a risk assessment has shown that ignition is unlikely to occur or can be mitigated by other safety measures.

Exempt materials

For the purpose of this document, exempt materials are engineering alloys that are exempt from any oxygen velocity limitations within defined limits of pressure, material thickness, and oxygen purity. Appendix C and Appendix D identify the composition of specific alloys, together with their thickness limitations and exemption pressures in oxygen.

Copper-based alloys

Copper-based alloys used in components for oxygen piping systems generally contain at least 55 weight % copper. Included within this group are the coppers, brasses (copper alloyed primarily with zinc), bronzes (copper alloyed with aluminium, silicon, manganese, tin, lead, etc.) and copper nickels (copper alloyed with nickel). These have had an outstanding application history in oxygen service. Caution should be exercised in the use of aluminium bronzes. Aluminium bronzes containing more than 2.5% and up to 11% aluminium (by weight) have been extensively used for cast components (e.g., valve bodies, pipe fittings, etc.) in oxygen pipeline duty for many years without a significant history of failure. However, use of aluminium bronze is not recommended as flammability tests show that it will support burning if ignited, even at low pressure.

Aluminium content in copper alloys should be limited to 2.5% (by weight).

Nickel-based alloys

Nickel-based alloys used in oxygen gas transmission pipeline systems contain at least 50 weight % nickel and nickel contents up to 99+ weight % have been used. However, some tabulations of nickel alloys may list alloys with nickel contents as low as 30 weight %. Generally, the higher the combined nickel and copper content, the more burn resistant the alloy. Combined nickel and cobalt also may be beneficial.

Some of the major nickel alloy families and examples of each are as follows: nickel (Nickel 200), nickel-copper (Monel-400 and Monel-500), nickel-chromium (Inconel 600 and Inconel X-750) and nickel-chromium-molybdenum (Hastelloy C-276 and Inconel 625).

Stainless steel alloys

Ferrous alloys become stainless when they contain a minimum chromium content of at least 10 to 13 weight %. There are a number of stainless steel classifications, which are dependent upon the alloy content, crystalline lattice, strengthening mechanisms, and the ratio of ferrite stabilizers to austenitic stabilizers.

Stainless steel classifications with examples of each type are as follows:

- Austenitic (304, 304L, 316, 316L, 321, 347);
- Ferritic (430);
- Martensitic (410);
- Precipitation hardening (17-4 PH); and
- Duplex (329, SAF 2205).

The preceding alloy designations were for wrought products but there are alloys such as CF-8, CF-3, CF-8M, CF-3M, which are the cast analogs of 304, 304L, 316, and 316 L respectively.

Of the various stainless steels, the 300 series stainless steels and their cast analogs are the most commonly used in oxygen gas transmission piping systems.

Cobalt alloys

The commercial listings of cobalt alloys generally start with a minimum cobalt content of at least 40 weight %. Wear resistant alloys such as Stellite 6 or Stellite 6B are sometimes used as coatings on valve trims to minimize erosion damage and improve valve life. Cobalt alloys have a successful history in oxygen when used as coatings, even though the thin cross-section may reduce its burn-resistance.

Non-ferrous alloys

When the term non-ferrous alloys is used in this document, it includes only copper, nickel, and cobalt alloys. It does not include aluminium or reactive materials such as titanium or zirconium.

Ferrous alloys

Included in this category are carbon-steel, low-alloy steel, and all stainless steels irrespective of whether these alloy families are in cast or wrought form.

Standard purity oxygen

The standard purity oxygen is defined as 99.5+% by volume.

Low purity oxygen

Gaseous oxygen that contains 35% or less oxygen by volume (23.5% to 35%)

Ultra high purity (UHP) oxygen

Oxygen purity equal or higher than 99.999% by volume

Velocity

The **actual** volumetric flowrate divided by the minimum internal flow cross-sectional area. It should be noted that the velocity in a pipe and its components may be significantly different.

Gas pressure

The gas pressure is the maximum pressure that can be achieved within the piping system.

4 Design philosophy

4.1 General criteria

The safe design and operation of an oxygen transmission pipeline or piping system depends on various factors that can influence each other. This section describes the principal risks and hazards associated with oxygen systems and the manner in which the hazards can be minimized by good engineering design.

The oxygen hazard can be effectively illustrated through the fire triangle, which shows that three main elements are required for a fire to occur: an oxidizer, a fuel, and an ignition source.

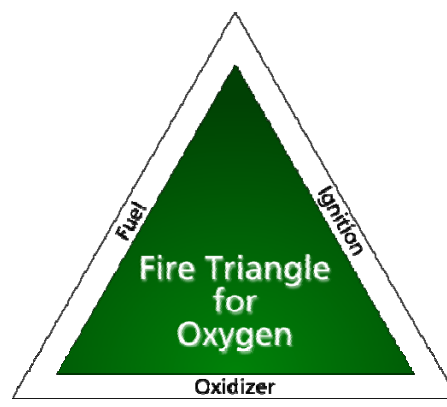


Figure 1—Oxygen Fire Triangle

In an oxygen system, oxygen itself is the oxidizer and the system fire hazard increases with increasing concentration, pressure, temperature, and flowrate. The fuels in an oxygen system are the materials of construction (metals, non-metals, and lubricants) or potential contaminants like particulates, oils or greases. The ignition sources common to oxygen systems include particle impact, compression heating, frictional heating, and others as discussed below.

Since each leg of the fire triangle is present in an oxygen system to some degree at all times, an oxygen-compatible design is generally one that minimizes the severity of each leg of the fire triangle to a tolerable level. For example, minimizing the severity of the oxidizer might include reducing the oxygen pressure, temperature, or concentration as practical. Minimizing the severity of the fuels might include ensuring burn-resistant alloys are used in locations where active ignition mechanisms exist. Minimizing the severity of ignition mechanisms might include oxygen service cleaning to reduce particle impact and promoted combustion, elimination of adiabatic compression, and other mechanisms.

Thus, a safe oxygen piping transmission or distribution system, including all its components, is one that is designed taking into account first and foremost:

- The oxidizer: oxygen conditions of service with respect to fluid composition, gas velocity, pressure, temperature and dew point;
- The fuel: materials of construction, selection of metal and non-metal components;
- The potential ignition mechanisms: contributing factors that contribute to ignition such as gas velocities and impingement sites that contribute to particle impact ignition, or rapid-opening components that can produce adiabatic compression heating.

Other factors to be considered include:

- local conditions (e.g., seismic zone, soil characteristics);
- applicable piping codes and practices for mechanical design (including pressure rating and wall thickness) and installation;
- national laws and regulations which apply to gas transmission pipelines generally and oxygen systems specifically;
- standards of cleanliness for oxygen service; and
- industry codes of practice relating to oxygen systems.

Piping fabricated from non-metal such as plastic or composite material, has been used for distribution of oxygen-enriched gases at low pressures. However, the use of non-metal piping for oxygen-enriched gases in production plants, transmission systems, or distribution systems is outside the scope of this document and does require specific risk assessment and precautions.

Normally, gaseous oxygen transported by piping contains negligible quantities of water and no special precautions against corrosion are therefore required. It is, however, important to identify areas where piping systems could become contaminated with water, in the event of equipment failure (e.g., compressor intercoolers or aftercoolers) and introduce appropriate design and/or monitoring procedures. Piping systems specifically intended for the transport of wet oxygen on a continuous basis, whereby the piping could be exposed to free water, may require special precautions such as the use of corrosion resistant piping material or internal coatings. It is important that any protective internal coatings or corrosion inhibitors used be compatible with oxygen for the process conditions. Potentially flammable coatings or inhibitors are prohibited, unless compatibility has been verified.

More detailed background information can be found by consulting the following references:
ASTM G88, Standard Guide for Designing Systems for Oxygen Service [2];
ASTM G128, Standard Guide for the Control of Hazards and Risks in Oxygen Systems [3];
Evaluation of the usefulness of security standards, selection and cleaning of materials, resources and appliances in oxygen technology for the application under high partial oxygen pressures [4];
ASTM STP 986 "Test to Evaluate the Suitability of Materials for Oxygen Service" Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres [5]; and
ASTM STP 1197 "A Hazards Analysis Method for Oxygen Systems Including Several Case Studies" Flammability and Sensitivity of Materials in Oxygen-Enriched Atmosphere [6].

4.2 Materials compatibility for oxygen service

Oxygen materials compatibility is dependent on many factors and thus, materials compatibility in oxygen is application-specific. In general, acceptance criteria for materials in a given application depends on two key factors, flammability and ignitability.

4.2.1 Material flammability

Some of the factors that determine the flammability of materials include the material composition, thickness, and the operating conditions such as oxygen pressure, temperature, concentration, and others.

Standard test methods are often used to determine the flammability of materials in oxygen. For metals, the promoted ignition test per ASTM G-124 is one test that evaluates the flammability behaviour as a function of pressure in the condition of the test [1]. A description of the promoted ignition-combustion test method can be found in Appendix A.

ASTM G-125, *Standard Test Method for Measuring Liquid and Solid Material Fire Limits in Gaseous Oxidants* is one test that evaluates the flammability behaviour of non-metals as a function of purity [7]. Other guidance is provided in ASTM G-94, *Standard Guide for Evaluating Metals for Oxygen Service* for metals and in ASTM G-63, *Standard Guide for Evaluating Materials for Oxygen Service* for non-metals [8, 9].

4.2.2 Ignition mechanisms and kindling chain

Several ignition mechanisms have been known to cause fires in oxygen piping systems. Appendix B lists common ignition mechanisms in oxygen systems, conditions for those mechanisms to be active, and some contributing factors that increase their likelihood.

Ignition mechanisms include particle impact, adiabatic compression (pneumatic impact), promoted ignition by organic materials, frictional heating, electrical arcing, and others as shown in Appendix B. If the specific conditions for an ignition mechanism are present, then the ignition mechanism is assumed to be active. For example, the conditions that must be present for the particle impact mechanism to be active are:

- particulates;
- high gas velocities; and
- impingement sites.

The design practices described in this publication are intended to minimize the conditions and contributing factors related to ignition.

When a material has been ignited, a fire can propagate through the kindling chain. Once ignited, the combustible material or component generates heat, which can, depending on many factors, ignite the surrounding bulk material. The rate and extent of the propagation of the fire along the pressure envelope will depend on the thickness and the flammability of the material, among other factors. The use of burn resistant materials, such as the use of exempt alloys per this publication, = limits the propagation of the fire by interrupting the kindling chain.

4.2.3 Oxygen hazards analysis and risk assessment

Certain operating parameters such as oxygen concentration, pressure, temperature, and velocity increase the risk of fire. When these parameters increase, more stringent oxygen service practices are progressively applied:

- cleaning of piping and equipment;
- use of compatible non-metals and, if appropriate, lubricants; and
- use of burn resistant metal .

An oxygen hazard analysis is a method used to evaluate risk of fire in an oxygen system. It assesses the probability of ignition or consequence of ignition (ignition vs. sustained burning based on operating conditions), discussed further below. It can be used to select materials for new designs or to evaluate the compatibility of materials in existing systems.

An oxygen hazard analysis is required if a metal alloy is used above its exemption pressure and gas velocities exceed those allowed by the pressure-velocity curve. The oxygen hazard analysis process is explained in ASTM STP 1197, ASTM G63, and ASTM G94, and generally proceeds as follows [6, 8, 9]:

- Determine application conditions (oxygen purity, pressure, temperature, gas velocity, etc.);
- Evaluate flammability of materials in application pressure and thickness (see section 4.2.1);
- Evaluate ignition mechanism severity based upon contributing factors present (see Appendix B). Ignition mechanisms for metals include: particle impact, frictional heating / galling, electrical arc, promoted ignition from non-metals/contaminants, etc. Ignition mechanisms for non-metals include: compression heating, mechanical impact, flow friction, electrostatic discharge, etc.;
- Evaluate reaction effects of fire (should a fire occur) based upon the severity of the reaction effects on personnel and operation;
- Analysis should include parts list, materials used, drawings, procedures, etc.; and
- Make recommendations if required to achieve low probability of ignition and a low consequence of ignition if possible. A priority list for implementing changes in order to reduce the risk of ignition or consequences of a fire is 1) Change material, 2) Change design, 3) Change Operation, 4) Implement barrier protection.

4.3 Selection of metals

Metal flammability is a key consideration for an engineering alloy used in an oxygen piping application. Alloy chemistry, component thickness, temperature, oxygen pressure, and oxygen purity are key variables that affect metal flammability.

For selecting metals used in oxygen pipeline systems, exemption pressures can be used in combination with the pressure-velocity curves in this document to provide helpful guidance. As stated previously, the exemption pressures for many alloys listed herein are based upon flammability data from ASTM G124 and other design factors [1]. By this method, gas velocity restrictions are placed on an application where the alloys of construction are used at pressures above their exemption pressures in order to minimize particle impact ignition hazards. If the application pressure is above the published exemption pressure, the application gas velocity shall conform to an area below a specific pressure-velocity curve depending on the presence of impingement sites. If the application pressure is below the exemption pressure, the alloy is considered burn-resistant and thus no restrictions on velocities are required. It should be understood that pressure velocity curves only address the particle impact ignition mechanism. Other ignition mechanisms may be present and should be evaluated according to Appendix B.

The choice of burn resistant alloys according to 4.2.2.2 is a simple solution for the designer, who could also perform an oxygen hazard analysis, as explained in 4.1.2, to determine what other options might be available.

Aluminium shall not be used in gaseous oxygen piping systems outside the cold box.

4.3.1 Velocity exemption pressures for standard purity oxygen

4.3.1.1 Engineering alloys

Appendix C lists the nominal compositions of the engineering alloys and alloy systems for which velocity exemption pressures are identified in this document. Generally, the alloys or alloy systems are those for which published flammability data exist. Techniques by which a flammability assessment can be made for alloys not listed in Appendix C are described in 4.2.1 and Appendix A.

4.3.1.2 Exemptions pressures and thickness effects

Appendix D is a listing of exemption pressures for the alloys covered in 4.3.1.1. The exemption pressures are based on a burn criterion of less than 30 mm (1.18 in) for a specimen as described in Appendix A.

Thickness is a very important variable in component flammability. The thickness of a metal or alloy shall not be less than the minimum prescribed in Appendix D. If the thickness is less than the prescribed minimum, the alloy shall be considered flammable and velocity limitations appropriate for the system pressure shall be observed. Exemption pressures should not be extrapolated outside the given thickness range of 3.18 mm to 6.35 mm (0.125 in to 0.250 in).

Alternatively, flammability assessments can be made using appropriate characterization techniques described in 4.2.1 and Appendix B, which could result in a judgment that velocity limitations are not required.

4.3.1.3 Protective liners and weld overlays

Protective liners and weld overlays of burn resistant alloys can be used in conjunction with carbon steel or stainless steel components, where high oxygen velocities and pressures could result in a particle impact ignition scenario. Copper, nickel or Monel alloys are typical choices. In accordance with ASTM G88, a minimum thickness of the order of 1 mm to 3 mm (0.04 in to 0.12 in) is generally used for weld overlay or liners. Refer to Appendix D for the minimum thickness requirements of specific metals [2]. Electroplated or electroless surfaces are not satisfactory due to the inadequate thickness of the protective liners and weld overlays most commonly employed for these processes unless a specific risk assessment has been conducted evaluating factors such as hydrogen embrittlement, wear erosion of the thin protective coating, and others.

Hardfacing alloys are also candidates if abrasion resistance is also required, however, the hardfaced alloy and its substrate alloy burn resistance shall be acceptable for the process conditions either based on system velocity, the exemption pressures shown in Appendix D, or a detailed risk assessment.

4.3.2 Reduced purity oxygen-enriched atmospheres

4.3.2.1 Reduced purity effects

There are an increasing number of applications where oxygen enrichment in excess of normal atmospheric concentrations but less than the nominal 99.5% by volume may be required. Depending upon specific parameters such as oxygen pressure and temperature, reduced oxygen purities may result in a decrease in metals flammability if an ignition event occurs. Thus, there might not be any necessity for imposing velocity limitations. However, metals flammability data in reduced purity oxygen-enriched environments is less available although several publications are useful in this regard [5,6,10,11,12,13,14,15,16,17,18,19,20]. Three options may be considered as follows:

- Option 1. Treat the reduced purity oxygen-enriched atmosphere as equivalent to 99.5+% by volume oxygen and use the exemption pressure listed in Appendix D for standard purity oxygen. This is a

conservative and very safe approach that becomes increasingly conservative as the oxygen purity decreases.

- Option 2. Treat the reduced purity oxygen as equivalent to pure oxygen gas at a pressure equivalent to its oxygen partial pressure in the gas mixture. The exempt pressure listed in Appendix D for a specific reduced purity oxygen gas mixture will therefore represent an oxygen partial pressure. This is a safe approach but not as conservative as Option 1.
- Option 3. Flammability testing can be performed with the system materials in the reduced purity oxygen environment using the procedures described in 4.2.1 and Appendix A. If the material is not burn resistant, an oxygen velocity limitation as indicated in 4.4 shall be imposed. If tests results indicate the metal is burn resistant for the thickness, oxygen purities and pressures of interest, there is no need to impose velocity limitations.

4.3.2.2 Oxygen purities \leq 35% by volume

At pressures up to 21 MPa (3000 psig) and an oxygen content lower than 35% by volume, systems free of hydrocarbons and constructed of ferrous and/or non-ferrous materials are exempt from velocity limitations. Under these conditions, both carbon and stainless steels have been proven to be burn resistant materials by the promoted ignition combustion test method (see Appendix A). However, the oxygen service cleaning and the use of oxygen-compatible non-metals as described in 4.5 is advised for such piping systems.

4.3.2.3 Gaseous oxygen production systems from vaporized liquid oxygen

For some systems, the designer may choose stainless steel piping and equipment to minimize the presence of particles. An example of such a system could be the supply of gas by the vaporization of liquid oxygen. Provided that the system is adequately cleaned, blown out, and inspected and no source of particles can be identified during the commissioning and operational lifetime of the piping, exemption from oxygen velocity requirements could be justified through an oxygen hazard analysis assessing different ignition sources.

4.3.3 Ultra high purity (UHP) oxygen atmospheres

4.3.3.1 General

Increasingly, UHP oxygen is being utilized in high technology applications such as semiconductors and electronics. The special requirements of these applications require almost total elimination of particulates, which could contribute to a particle impact ignition mechanism. In addition to special cleaning procedures, UHP systems require special monitoring procedures to ensure particulate-free conditions. These systems are typically fabricated from stainless steel.

4.3.3.2 System pressures

Bulk gas system pressures usually are below 4 MPa (600 psig). Higher pressures may be encountered in delivery systems utilizing high pressure cylinders.

4.3.3.3 Velocity exemptions

The absence of particulates and ignitable contaminants in a UHP stainless steel UHP cleaned oxygen system is a significant factor which precludes ignition from a particle impact mechanism. Hence, UHP oxygen systems that are cleaned and maintained properly are exempt from oxygen velocity requirements, although other ignition mechanisms (such as adiabatic compression) may be present that could ignite a non-metallic component.

4.3.3.4 Cleaning UHP oxygen systems

The cleaning of UHP piping systems requires special cleaning subcontractors capable of meeting contaminant levels not exceeding 1000 micrograms per square metre. Such vendors shall be rigorously qualified and subject to periodic audits, inspections, and process reviews.

4.3.4 Temperature limitations

The metals flammability information contained within 4.2 is pertinent to oxygen piping systems up to:

150 °C (303 °F) for carbon steel piping systems; and

200 °C (398 °F) for stainless steel and non-ferrous piping systems.

Systems operated at temperatures in excess of the preceding constraints will require additional analysis. Components or material may require metals flammability or particle impact testing at elevated temperatures to ensure system safety.

In the event of operating temperatures below -20 °C (-4 °F), steels that demonstrate adequate fracture toughness values will be required in the same way as for other industrial gases.

4.4 Velocity and gas pressure criteria

4.4.1 General

Pipe system sizing is predominantly based on the design velocity. This velocity is based on normal plant operation and venting, and not based on velocities that may arise due to mechanical failures or other unusual circumstances such as control valve failure or relief valve lifting. The term velocity means the average axial velocity in the pipe at all defined operating pressures, temperatures, and flow rates. For pipeline equipment, the velocity shall be based on the minimum cross sectional flow area of the component. There may be multiple operating conditions defined for which all velocities shall be considered.

4.4.2 Impingement velocity curve and metal selection for piping and equipment

The impingement velocity curve, shown as Figure 2, shall be used for the design and material selection of new pipelines, valves, equipment, and associated piping systems where impingement sites may exist. See 5.2.1 and 5.2.2. The designer will choose the metals according to the impingement velocity curve and their exemption pressures defined in 4.2. Below its exemption pressure (see Appendix D), any metal may be used without velocity limitation. Above its exemption pressure, the designer will check that the velocity remains below the impingement velocity curve. For velocities below the impingement velocity curve, carbon steel, stainless steel, and other exempt materials may be used; above the impingement velocity curve, exempt materials shall be used or alternative measures shall be taken to mitigate risks.

Piping systems are usually made of carbon steel and it is therefore necessary to limit the gas velocity to a value below the impingement velocity curve. Other design considerations may also dictate lower velocities such as pressure drop, gaseous buffer effect, noise reduction, vibrations and the need to limit the kinetic energy.

Velocity limitations in non-impingement sites are considered in 4.4.3. For pressures below 0.21 MPa (30 psig), industry experience suggests that it may be possible to use carbon and thin walled stainless steels in oxygen service without velocity limitations, using properly designed components with appropriate risk assessments. This is due to the low burn rates shown by these materials in low pressure flammability tests. It is recommended that components for such applications be evaluated on a case-by-case basis.

A hazards analysis of the system (piping or equipment) may justify solutions other than the use of burn resistant material, for example:

- the use of a protection plate made of exempt material at impingement locations;
- minimizing the presence of particulate matter by the use of filtration for particles 150 microns or smaller; and
- other exceptions as listed in 4.2.3, 4.2.4, 5.2.2, and 5.2.3.

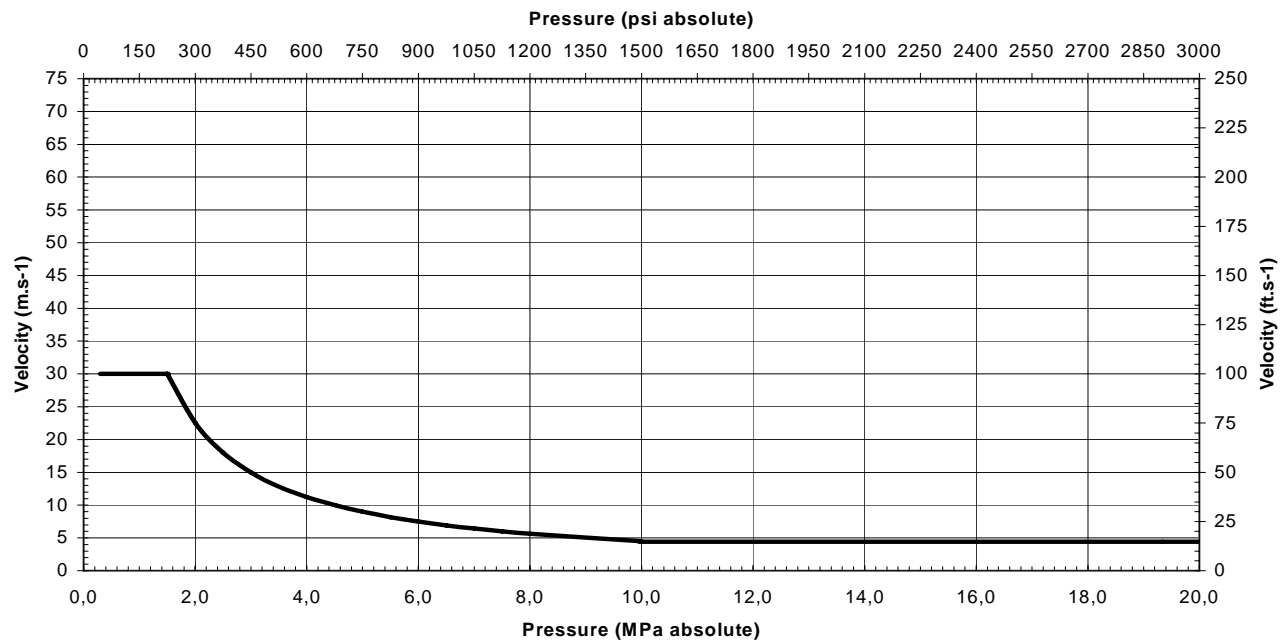


Figure 2—Impingement velocity curve

The curve shown in Figure 2 is valid for design temperatures up to 150 °C (302 °F) for carbon steel piping, and 200 °C (392 °F) for stainless steel and non-ferrous piping. The carbon steel temperature limitation may be increased to 200 °C (392 °F) provided a hazard analysis is performed that takes into account factors such as site conditions, operating experience, experimental data, etc. Pressures are limited to a maximum of 21 MPa (3000 psig).

The equation of the impingement velocity curve in Figure 2 is defined as follows:

- If 0.3 MPa abs (45 psia) < P < 1.5 MPa (225 psia) then V(m/s) = 30 m/s (100 ft/s)
- If 1.5 MPa (225 psia) < P < 10 MPa (1500 psia) then $P \cdot V = 45 \text{ MPa} \cdot \text{m/s}$ (22 500 psia • ft/s)
- If 10 MPa (1500 psia) < P < 20 MPa (3000 psia) then V(m/s) = 4.5 m/s (15 ft/s)

4.4.3 Velocity limitations in non-impingement sites

The velocity may be increased up to the curve shown in Figure 3, in the non-impingement sites of the piping system. See 5.1.1 and 5.2.2.

For velocities above the non-impingement velocity curve, exempt materials shall be used or alternative measures shall be taken to mitigate risks.

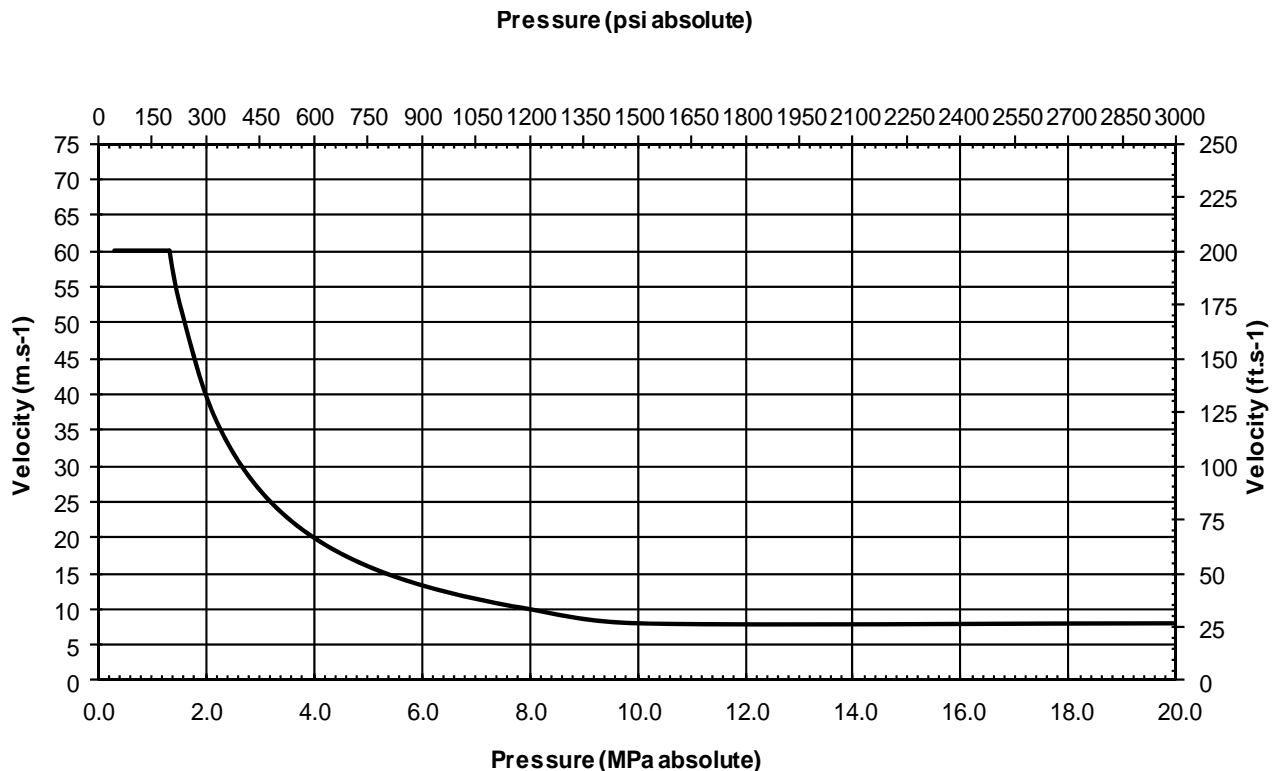


Figure 3—Non-impingement velocity curve

The curve shown in Figure 3 is valid for temperatures up to 150 °C (302 °F) for carbon steel piping, and 200 °C (392 °F) for stainless steel and non-ferrous piping. The carbon steel temperature limitation may be increased to 200 °C (392 °F) provided a hazard analysis is performed that takes into account factors such as site conditions, operating experience, experimental data, etc. Pressures are limited to a maximum of 21 MPa (3000 psig).

The equation of the non-impingement velocity curve is defined as follows:

- If 0.3 MPa abs (45 psia) < P < 1.5 MPa (225 psia) then V(m/s) = 60 m/s (200 ft/s)
- If 1.5 MPa (225 psia) < P < 10 MPa (1500 psia) then $P \cdot V = 80 \text{ MPa} \cdot \text{m/s}$ (40 000 psia • ft/s)
- If 10 MPa (1500 psia) < P < 20 MPa (3000 psia) then V(m/s) = 8 m/s (26.6 ft/s)

4.5 Selection of non-metal

4.5.1 Properties and risks

Most non-metals are less compatible with oxygen than metals. Non-metals are used mainly for gaskets, valve seats, thread lubricants, thread seals, valve packing, and similar applications to reduce friction and to minimize gas leakage.

Many non-metals are flammable in oxygen even at low absolute pressure and purities greater than 23.5%. The main factors affecting their ignition and fire propagation are the pressure, temperature, and oxygen concentration.

The oxygen index (OI) is the minimum oxygen content in an oxygen-nitrogen gas mixture that will sustain candle like burning of a test sample. Materials with high oxygen index are preferred. Oxygen index data reported in ASTM G63 for various non-metals are tested at atmospheric pressure [9]. In general, a material's oxygen index decreases as the system pressure increases.

In a kindling chain fire process, the non-metal part is often the link that promotes the ignition of the bulk metal. The heat of combustion of the non-metal component is therefore an important parameter. The preferred non-metals have heats of combustion less than 2500 cal/g (4500 BTU/lb), compared

with 10 000 cal/g (18 000 BTU/lb) for common hydrocarbon products (see section 7.6.6 of ASTM G63) [9].

To assess the oxygen compatibility of a non-metal, a significant parameter to be considered is its auto ignition temperature (AIT). In practice it is usual to allow a margin of at least 100 °C (212 °F) between the operating temperature and the AIT. A lower margin of 50 °C (122 °F) may, however, be accepted subject to complementary tests (see [5] Bundesanstalt für Materialforschung und Prüfung (BAM) procedure for oxygen gasket evaluation). However, it is important to check the behaviour of the product in oxygen atmosphere at the maximum working pressure and temperature. The material may be subjected to gaseous fluid impact or to a mechanical impact [17, 18]. The result of mechanical impact in a liquid oxygen environment may be a useful indication of the behaviour of the product as liquid oxygen can be considered as a high density oxygen source. For the measurement of AIT, see ASTM G72, *Standard Test Method for Autogenous Ignition Temperature of Liquids and Solids in High-Pressure Oxygen-Enriched Environment* and ISO 11114-3, *Transportable Gas Cylinders - Compatibility of Cylinder and Valve Materials with Gas Contents—Part 3: Autogeneous Ignition Test in Oxygen Atmosphere* [19, 20].

As a slow oxidation may occur and change the properties of the product, an aging procedure may be performed [21]. The behaviour of non-metals within generic classifications may vary in oxygen compatibility tests depending upon the source of supply of the materials.

Qualification of vendors' supplied products should be considered. For maintenance purposes, it is important to ensure that the correct spare part selected for its oxygen compatibility is used. Many fires have occurred due to confusion in selection and use of spare parts.

The energy necessary to ignite a non-metal part may be created by:

- Adiabatic compression of the oxygen;
- Internal flexing of the soft material itself due to vibration, resonance or flow friction;
- Mechanical impact, friction or rupture after swelling;
- Arcing due to static electric discharge or lightning;
- Promoted ignition by burning particles.

An evaluation of the ignition probability assessment combined with the reaction effect assessment may lead the designer to optimize the design and the choice of materials. Examples of this procedure are given in ASTM G63 [9].

4.5.2 Design practices and material selection

When designing a system containing non-metals, it is desirable to observe the following practices:

- Minimize the quantity of non-metals used in oxygen systems;
- Take account of heat dissipation in the design by embedding the non-metal part in an adequate mass of burn resistant metal which will act as a heat sink;
- Avoid locating non-metals directly in the gas stream;
- Prevent excessive movement of the component;
- Ensure that the material is physically and chemically stable at the service conditions; and
- Ensure that a non-metal component does not prevent electrical continuity between internal parts except at insulting joints.

In addition to these design practices, special care should be taken with the cleaning procedure, particularly if a solvent is used. It is important to check that the solvent is compatible with the non-metals and thereby avoid any contamination of the non-metal part, or the item of equipment, by polluted solvent. All cleaning solvent residuals should be removed.

Specific information on the design and installation of non-metals can be found in the appropriate equipment sections.

For components exposed to adiabatic compression, testing on small equipment items (<25 mm/1 in) should be considered, particularly for oxygen regulators [26].

ASTM G 63, the results of tests performed by BAM in Berlin and other relevant publications from EIGA, CGA and ASTM could help the designer in the selection of non-metals [9,22,5,6,10,11,16,23,24,25,26].

Examples of non-metals exhibiting the best oxygen compatibility are (design temperatures should be considered when selecting non-metals):

- Fluorinated polymers including plastic products such as polytetrafluoroethylene (PTFE), fluorinated ethylene-propylene (FEP) or polychlorotrifluoroethylene (PCTFE);
- Elastomer products such as Neoflon, Kalrez, Viton or Fluorel;
- Amorphous polymers such as polyimides (Vespel SP21);
- Ceramics and glass, which are totally oxidized products, are burn resistant but brittle so they are generally used with a binder as composite products. The crystalline structure is very stable and burn resistant as in the case of graphite, which has a high oxygen compatibility even at high temperature; and
- Other products as listed by BAM [22].

WARNING: *Fluorinated polymers may release toxic gases when they burn. Composition of non-metals can be variable. Users should verify composition and compatibility of non-metal components prior to use in oxygen service.*

Lubricants are also detailed in 5.5

4.6 Piping systems

4.6.1 Underground piping systems

Piping should be of all welded construction in accordance with a specification and inspection code such as American Petroleum Institute (API) 1104, *Welding of Pipelines and Related Facilities* or any other recognized code. Underground piping shall be externally coated to an approved specification, to protect against corrosion [27]. Reference to current, internationally accepted, coatings standards and specifications is recommended [28, 29, 30, 31].

Underground piping should be adequately buried to protect it from frost, casual surface construction, shifting due to unstable soil, back fill damage to the external surface of pipe or the coating, and aboveground loads such as vehicles or equipment moving over the path of the pipeline. In the case of crossings, the pipeline should cross the railroad or roadway perpendicularly or as close to perpendicular as possible. Uncased crossings are preferred. When pipe casings or load shields, are installed at railroad or road crossings, cathodic protection systems at cased crossings should be reviewed carefully. Casing may reduce or eliminate the effectiveness of cathodic protection. The introduction of a casing creates a more complicated electrical system than would prevail for uncased crossings. This may lead to difficulties in interpreting the cathodic protection measurements at cased crossings. Test stations with test leads attached to the carrier pipe and the casing pipe may be provided at each cased crossing. Load shields should be installed where unusual aboveground loading can occur. Casings or sleeves require special measures to avoid cathodic protection problems and arcing, which can be caused due to an electrical connection forming between the sleeve and carrier pipe owing to settlement, etc.

Underground oxygen piping is particularly vulnerable to damage by lightning strikes or ground fault conditions, which may ignite the pipe material. Electrical continuity between underground oxygen piping and aboveground piping or other metal structures should be avoided to prevent cathodic protection problems. Due to the possibility of leaks and risk of enriched atmosphere it is preferable to have no flanged joints underground either buried or in pits.

4.6.2 Aboveground piping systems

Aboveground oxygen piping systems should follow good mechanical design practices as applied to any other aboveground piping system. Aboveground carbon steel piping should be painted to an approved specification to protect against atmospheric corrosion.

Aboveground portions of pipeline systems should connect to underground portions through an electrically insulated joint to isolate the underground cathodic protection system (see 4.5.4, 5.4.5 and 7.4.3).

All above ground pipelines shall have electrical continuity across all connections, except insulating joints (could be either flanges or monobloc) and shall be earthed at suitable intervals to protect against the effects of lightning and static electricity. The electrical resistance to earth of the installed aboveground piping system should not exceed 10 Ohms for lightning protection.

Flange bolting will provide the necessary electrical bond provided the bolts are not coated with a dielectric material or paint and are well maintained to avoid rust.

In the case of short above ground sections, where insulating flanges are not used, the pipe should be insulated from the support structure by means of an isolating pad.

Aboveground piping should be routed as far away as practical from other lines and process equipment containing fluids that are hazardous in an oxygen environment. If located in a multi-line pipe-rack, the mechanical joints in the oxygen line should not be located close to the mechanical joints in other fluid lines where hazardous mixtures could result if simultaneous leaks or failures occurred. Consideration should be given to protecting other fluid lines opposite mechanical joints in oxygen lines from fire. Oxygen lines should not be exposed unnecessarily to external forces that can cause a failure or dangerous situation such as external impingement from hot gas or steam vents, vibration from external sources, leaking oil dripping onto the line, etc.

4.6.3 Pipeline markers

Overhead piping should be colour coded and/or identified according to national or corporate standards. Underground piping should be identified with distinctive markers placed on the ground near the buried pipeline. Marker posts should also be installed at pipeline changes in direction. Markers should be suitably spaced to indicate the route of the line.

4.6.4 Cathodic protection

Underground pipelines are subject to soil corrosion. The primary protection against corrosion is provided by the coating system. Cathodic protection in accordance with approved standards and specifications should be applied to protect against imperfections in the coating system (see 5.4.5). For additional information, please see NACE SP0169, Control of External Corrosion on Underground or Submerged Metallic Piping Systems and EN 12954, Cathodic protection of buried or immersed metallic structures. General principles and application for pipelines [32, 33].

Precautions against induced alternating current sources and lightning strikes should be considered.

There shall be no cad-welding (Thermite) of test station wires to in-service oxygen lines. Cold processes can be used or alternative methods stated in 9.2.3.

4.7 Siting, remote operation, use of barriers

Siting of oxygen systems shall be carefully studied especially in the case of stations comprising valves and locations where impingement may occur. Siting and safety distances should follow established practices and applicable regulations. For details see 8.6.

When there is a concern that the hazards of a system cannot be controlled to an acceptable level of safety with design component selection, compatible materials, operating practices and siting, as defined above, then remote operation or use of physical barriers shall be considered for protection of the operators and others. For details see 8.5.

5 Piping, valves, and equipment

5.1 General criteria

This section describes how the design philosophy presented in Section 4 can be applied in practice to piping, valves, specific piping components and equipment configurations.

5.1.1 Material selection criteria

Selection of material for pipes, valves, and equipment shall be based on 4.2, 4.3, and 4.4.

At impingement sites, the material selection shall be based upon the impingement velocity curve in Figure 2 as explained in 4.4.2.

At non-impingement sites, the velocity for carbon and stainless steel may be increased, but shall be limited by the non-impingement velocity curve (see Figure 2).

Sites where impingement and non-impingement may occur follow.

5.2 Piping and fittings

5.2.1 Impingement sites

Impingement occurs when the flow stream changes direction abruptly or when the presence of eddies leads to the impact of particles with the system walls. Pipe impingement sites include, but are not limited to, the following:

- Tees, both butt weld and socket-weld and socket weld elbows;
- branch connections such as fabricated branches, weldolets, sockolets, and threadolets;
- multiple-hole diffusers and surrounding body;
- short-radius elbows (radius of curvature < 1.5 d);
- socket-weld and threaded reducers;
- reducers (eccentric and concentric) with greater than 3:1 inlet to outlet reduction section ratio (for flow from large to small);
- mitered elbows (mitered cut angle more than 20°); and
- piping downstream of a pressure letdown valve up to a length of 8 pipe diameters (pipe diameters can be based on valve outlet size).

Other impingement sites identified as special in-line pipe components are discussed in the following subsections:

- Valves, subsection 5.3;
- Conical strainers and Y strainers, subsections 5.4.1 and 5.4.2;
- Filters, subsection 5.4.3;
- Orifices plates, subsection 5.4.4.2;
- Noise reduction, silencers, subsection 5.4.8.1; and
- Other accessories, thermowells, subsection 5.4.8.2.

5.2.2 Non-impingement sites

Non-impingement sites include but are not limited to the following:

- straight piping runs;
- butt-weld tees, with long (or smooth) crotch radius (for flow from main to branch);
- long radius diameter elbows (equal or greater than 1.5 diameter);
- 90-degree mitered elbows made of 6 pieces (5 welds) as well as 45-degree mitered elbows made of 3 pieces (2 welds), providing that all internal surfaces are ground smooth; and
- eccentric and concentric reducers with a maximum 3 to 1 reduction ratio.

5.2.3 Specific piping locations

5.2.3.1 Bypass piping

Selection of piping material on the inlet and outlet of the bypass valve, see Figure 3, shall be given special consideration since this piping is often exposed to both high velocities and turbulent flow during pressurization. Bypass piping upstream of the bypass valve is defined as a non-impingement site. The possibility of bi-directional flow shall be considered. Thus, exempt materials are recommended downstream of the bypass valve, and for the entire bypass piping system if bi-directional flow is possible.

5.2.3.2 Piping upstream of vents and bleeds

Branch piping upstream of vent and bleed valves and any system isolation bleed valves (i.e., between isolation valves) should be designed as bypass piping.

5.2.3.3 Inlet piping to pressure relief valves (PRVs)

The material selection of inlet piping to a PRV shall be based on the relief valve set pressure and the maximum flow capacity of the relief valve. See section 4.4.1.

5.2.3.4 Piping downstream of vent valves and pressure relief valves

Associated vent piping material selection shall be based on the impingement velocity curve. Corrosion-resistant material is commonly used for vent lines since the pipe is open to atmosphere and invites condensation with daily temperature fluctuations. Carbon steel piping may be used for vent piping when the venting is controlled to avoid turbulence immediately downstream of the vent valve. However, exempt materials may provide both corrosion resistance and combustion resistance.

Pressure relief valves should be located in the open air so that they discharge in a safe area. If they are unavoidably located inside buildings or enclosures, the vent piping shall discharge outside. Consideration shall be given to the location of the vent outlet, height, direction, adequate spacing, etc. in order to minimize risks due to oxygen-enriched atmosphere in the surroundings.

5.2.3.5 Piping downstream of pressure letdown sites

The piping downstream of a pressure let-down valve (throttling or process control valve, see 5.3.2.3) experiences high velocity and highly turbulent gas flow. The pipe wall downstream of a throttling or process control valve is considered an impingement eddy site for a distance equivalent to a minimum of 8 pipe diameters where pipe diameters is based on the valve outlet size. Particles in the eddy flow regime impinge on pipe walls at a greater velocity than determined by the gas flow calculations. Because of the eddy flow particle velocity, exempt materials should be considered for the piping in the eddy site zone.

The risk of particle impingement or its consequences may be reduced and non-exempt material considered for any of the following situations:

- If a 150 micron screen or finer filter is installed upstream of the let-down valve, then particle impingement is significantly reduced;
- If the pressure letdown occurs across a multi-hole diffuser, the flow downstream of the diffuser may be considered smooth with no high velocity turbulent jet; and
- If the system is shielded to protect personnel and prevent exposure (see 4.6 and 8.5).

5.2.3.6 Gaskets

Gaskets of an oxygen-compatible material shall be sized and installed to match the internal diameter of the pipe thereby eliminating a space where particles can accumulate. Gaskets should be full face so they can be positioned concentrically in a flange joint and thereby eliminate any protrusion of the gasket in the flow. Spiral wound gaskets shall be manufactured such that they are clean for oxygen service. Spiral wound gaskets shall have inner rings to prevent inner radial buckling of the windings.

Gasket sealant should be avoided because extrusion of the sealant into the flowing gas stream is undesirable. If a sealant is necessary, the choice of sealant should be made according to 4.5.

ASTM G63 may provide guidance on non-metals selection [9].

5.2.3.7 Thread sealants

The oxygen user shall confirm that the thread sealant material is compatible for oxygen service at the maximum service pressure and temperature. PTFE products (tape) can be used according to their specifications including cleanliness in order to ensure compatibility with oxygen service (see 4.5). Minimal amounts of thread sealant should be applied to prevent extrusion out of the joint. Provisions shall be made to prevent contamination of open containers of thread sealant.

ASTM G63 may provide guidance on non-metals selection [9].

5.2.3.8 Dust traps and dead ends

The risk of ignition of bulk metal increases with the mass of particles. It is important to avoid accumulation of these particles in dust traps or dead ends. Dead ends where particles can accumulate shall be identified for all possible operational configurations. In these cases, design or operational procedures shall be developed.

In particular, consideration shall be given to lines in stand-by service such as bypass pipes, vent pipes, or purge lines for which the connection should be on the top of the main line or at least at the same level horizontally. Dead ends and dust traps are to be avoided wherever possible.

Examples of dust traps are manifolds, enlarged diameter tees, gaskets not flush with the internal diameter of the flange, stand-by lines under the main line and other locations, where the velocity of the gas is reduced, allowing particles to drop out of the gas stream.

5.2.3.9 Fire stops

Fire stops are short spool pieces of copper or nickel-based alloy. Their use is no longer considered common practice in steel pipeline transmission or distribution systems.

5.3 Valves

5.3.1 General

Valves shall be procured from suppliers suitably qualified in oxygen-compatible procedures. The material and physical design of the valve shall be carefully selected considering both the normal and unusual operating conditions to which the valve can be subjected. Specific design considerations shall be given to manual valves design, as they are locally operated by personnel.

Metal selection requirements are related to gas velocity and potential impingement sites, which may exist in a valve depending on its design, function and type. Non-metal selection requirements are described in 4.3.

5.3.2 Valve functions

This document recognizes several classes of oxygen-service valves. The classes of valves recognized include the following:

- isolation valves;
- process control valves;
- emergency shutoff valves;
- bypass valves;
- vent valves;
- pressure relief valves; and
- check valves.

5.3.2.1 Isolation valve risks

There are two risk factors associated with isolation valves when they are opened with differential pressure across the seat:

- high velocity and turbulence through the valve during its opening; and
- rapid downstream pressurization and temperature rise due to adiabatic compression.

The high velocity, turbulence, and rapid pressurization risks can be avoided by the use of a bypass system to equalize pressure across the isolation valve before it is opened. Bypass valves are discussed in 5.3.2.5.

5.3.2.2 Isolation valves

Isolation valves shall be operated in either the fully closed or fully open position and never in a throttling mode. They shall be operated without significant pressure differential by using a bypass system or a specific operating procedure. The downstream pressurization rate shall be controlled to prevent the risk of adiabatic compression.

Isolation valves are normally gate, ball, plug, or butterfly type.

Valves that are intended to be operated with differential pressure during opening and closing are considered throttling valves or process control valves (see 5.3.2.3).

It should be noted that if a closed isolation valve leaks, there can be a high velocity flow across it if a high differential pressure exists.

5.3.2.3 Throttling or process control valves

Throttling or process control valves include those for pressure control, flow control, bypass, or pressure relief.

They are defined as valves that control flow or pressure. Depending on the function necessary, pressure control valves might throttle flow continuously, might allow for slow opening or closing, or be programmed for quick opening or closing. Process control valves in the vast majority of cases are automated; the exceptions being manually operated throttle valves and spring-operated regulators.

Process control valves are considered to be the most severe class of service in gaseous oxygen systems. This is because their function is to regulate flow or operate with high differential pressure that is associated with high velocity and turbulent impingement flow. The turbulence and impingement

is not only present in the trim and body of the valve but is considered to extend to the downstream piping for a length of a minimum of 8 valve diameters. If bi-directional flow is possible, turbulence and impingement will also exist in the upstream piping.

Process control valves are generally globe, modified ball, eccentric plug, or butterfly type. Valves that do not meet the definition of isolation valves shall be considered throttling valves.

5.3.2.4 Emergency shut-off valves

Emergency shut-off valves are usually automated, operate in the fully open position, and are normally closed only in the event of an emergency. Emergency shut-off valves are high flow valves and are normally gate, knife gate, butterfly, or ball type. Although in normal operation the valve experiences non-impingement flow, in the event of an excess flow condition, the valve will experience excessive velocities and momentary turbulence upon closing. Normally these valves are treated as throttling valves.

5.3.2.5 Bypass valves

Bypass valves are normally piped from immediately upstream to immediately downstream of manual isolation valves. Depending on the process design, a bypass system may be required for certain process control or emergency shut-off valves. They are installed for the purpose of providing pressure equalization across an isolation valve. Once pressure equalization is established, the isolation valve may be safely opened. Bypass valves are also used to slowly pressurize a downstream system to mitigate excessive velocity and rapid pressurization risks. Controlled, slow pressurization requires the use of a throttling flow-control-style valve. Due to their flow-control function, bypass valves are categorized as throttling or process control valves. Although classified as process control valves, bypass valves are normally manually operated valves. Typically, they are globe valves that experience impingement and high velocity turbulent flow throughout the valve body. Exempt materials are recommended for the valve and piping downstream of the bypass valve, and for the entire bypass piping system if bi-directional flow is possible or if indicated by a risk analysis.

Bypass valves shall be designed according to the following criteria:

The bypass system shall be sized to achieve pressure equalization within an acceptable period; and

To minimize the amount of particles that might collect in the bypass line, the bypass pipe shall be connected into the main pipe at or above the centerline (see Figure 4).

Bypass piping should stub-in the main piping such that the bypass line protrudes through the main piping to prevent edge impingement.

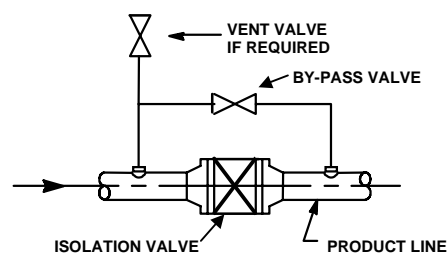


Figure 4—Bypass installation

5.3.2.6 Vent valves

Vent valves normally experience high velocity and impingement and are usually treated as throttling valves. Associated vent piping material selection is covered by sections 5.2.3.2 and 5.2.3.4.

5.3.3 Valve types

The velocity through a valve varies depending on changes in cross-sectional flow area, particularly in the case of globe valves and pressure relief valves. For isolation valves such as ball, plug, butterfly, and gate types that are normally fully open when in operation, the velocity does not change significantly and material selection for body and trim can be based on the velocity at the valve inlet.

5.3.3.1 Ball and plug valves

Ball and plug valves are inherently quick opening. This leads to concerns about adiabatic compression especially for any elastomer/polymer materials in the valve or piping system. Also the ball typically has a sharp edge in the flow path when it is being closed or opened.

When a ball or plug valve is fully open, the flow is considered smooth and both the body and trim are considered in non-impingement service.

Ball and plug valves can be equipped with gear operators to assure slow opening.

5.3.3.2 Butterfly valves

Butterfly valves, when open, operate with the valve disk in the flow stream. Butterfly valves that are specified for low leakage rates use either an elastomer seal or a metal-to-metal seat.

When a butterfly valve is wide open, the flow is considered smooth and the body is considered as a non-impingement site. The disk, however, is directly in the flow stream and is considered as an impingement site.

Butterfly valves are inherently quick opening. This leads to concerns about adiabatic compression and temperature rise, especially for any elastomers in the valve or downstream piping system.

Butterfly valves can be equipped with gear operators to ensure slow opening.

5.3.3.3 Gate valves

When gate valves are fully open, the flow through the valve is considered smooth. The body is considered as a non-impingement site whereas the gate is treated as an impingement site.

There are potential friction surfaces in the moving parts of gate valves such as between the gate and body seat, between the gate and back seat, between the rotating stem and the gate, and between the stem thread and the guide.

If gate valves are in a closed position and pressure is equalized across them using a bypass valve, it is possible in some designs that the pressure in the bonnet area remains low until the valve is opened. This could result in adiabatic compression in the bonnet area on initial opening.

Some gate valves have tack welded, screwed in seats. It can be difficult to clean the thread area after assembly. By design a gate valve may have an open groove at its base when the valve is open, which is an ideal site for debris collection.

5.3.3.4 Globe valves

Globe valves are commonly used in control applications and are usually automated. Globe valves have a tortuous path with many impingement sites. The trim design varies with specific vendors but it can be of a relatively thin section fitted with elastomer/polymer inserts to minimize leakage and seat damage. Sometimes cage trims are used, which are usually of thin section and provide sites for debris to be trapped and/or "guillotined". Because of these design features, globe valves shall always be considered as throttling valves with both body and trim classed as impingement sites. Exempt materials are commonly used.

5.3.3.5 Pressure relief valves

Pressure relief valves by nature experience high velocity across the trim. There will be impingement on the exhaust part of the housing and outlet piping although these areas are normally at or close to

atmospheric pressure. The sizing of the trim and the valve inlet determines the gas velocity at the valve inlet. Valve and trim sizing can sometimes be selected to maintain a low velocity in the inlet area. Both body and trim are considered impingement sites. Exempt materials are often used for seat and trim unless other mitigating measures are in place. Pressure relief devices shall comply with national or international standards such as ASME *Boiler and Pressure Vessel Code*, Section VIII [34].

5.3.3.6 Check valves

Check valves, by virtue of their design, contain components that will always be in the flow stream and may be subjected to high velocities and impingement. Therefore, the disk, plate, piston, or spring of a check valve should be made from exempt materials. Depending on the valve type, the body of a check valve may or may not be regarded as an impingement site. The components of check valves are designed to impact with each other and shall therefore be regarded as potential sources of ignition energy and, possibly, particle generation. Care shall be taken to ensure that the thickness of moving or impacting components in the flow stream is adequate and not less than those indicated in Appendix D unless other mitigating measures are in place.

Plate-type check valves normally supplied with reciprocating oxygen compressor systems are excluded from this section.

Check valves should be designed to withstand chatter and installed such that the possibility of chatter is minimized.

5.3.4 Valve seals and packing

The party responsible for specifying or procuring valves for oxygen systems should contact the seals and packing supplier for guidance on materials that are compatible and suitable for oxygen service at the design conditions (see 4.5). Information on compatibility of non-metal seal and packing materials may be found in ASTM G63 and BAM [9, 22].

5.3.5 Other possible sources of ignition in valves

- Localized heating due to friction between metal components;
- Arc discharges where two metal components, at different electrical potentials, are separated by a non-metal insulating substance;
- Flow friction, which is flow induced vibration of an elastomer/polymer, causing a localized increase in elastomer/polymer temperature leading to a kindling chain type ignition; and
- Mixing of oxygen and non-compatible oil or grease, for instance in gear boxes or angled valve wheels. If such equipment is used, suitable arrangements such as distance pieces open to the atmosphere, shall be provided to prevent migration of oil or grease down the spindle into the oxygen system.

5.4 Equipment

Special in-line pipe components including filters, strainers, orifice plates, venturi flowmeters, thermowells, silencers, and flexible connections are described in the following paragraphs. The vast majority of in-line components experience impingement flow, and their materials should be selected based on the information given below.

5.4.1 Conical strainers

Conical strainers in gaseous-oxygen service are normally designed as a perforated cone with a mesh-screen overlay. The strainer shall be positioned in the piping system such that the mesh will be on the outside of the cone with the cone projecting upstream. Commonly used screen sizes are 150 micron and finer.

The mesh of a conical strainer is regarded as an area of high risk because it experiences direct impingement and also captures and accumulates debris and particles. Wire mesh, because it is constructed of thin material offering a high surface-to-volume ratio, is more susceptible to ignition in

oxygen service. The mesh overlay material shall be of a burn resistant material such as nickel, bronze or Monel. Materials with relatively low burn resistance such as stainless steel mesh shall not be used.

The perforated cone support is also considered an impingement site and the material selection and its thickness should be based on the impingement velocity curve shown in Figure 2 and in Appendix D.

5.4.1.1 Conical strainer buckling pressure

Conical-strainer cones should be designed with a high buckling or collapse pressure, preferably 100% of the system design pressure as determined by the setting of the pressure relief valve. If the buckling pressure is less than 100%, a pressure differential indicator with an alarm should be installed to warn operating personnel that the element is approaching a failure condition and that corrective action is required. This is to avoid collapse of the cone and the passage of fragments through the piping system thereby creating a potential fire hazard.

5.4.1.2 Conical strainer system design

Systems should be designed to avoid the likelihood of filter or strainer operation in reverse flow. The piping and valve requirements discussed for filters in 5.4.2.6 also apply to strainers.

5.4.2 Y-strainers

The Y-type strainer body is considered an impingement site, a dead-end, and a location where contaminant can be ignited and kindle the surrounding components. As such, usage of Y-type strainers shall be restricted to locations where the potential for contaminant is minimal. Only exempt materials shall be used for the body. Carbon steel is prohibited. The wire mesh and screen shall conform to the guidelines given for conical strainers in 5.4.1.

Blowdown valves on Y-strainer housing shall be avoided in gaseous oxygen service. Though the blowdown valve provides an easy method for cleaning the strainer, it could easily be opened at an inappropriate time and could cause a dangerous localized oxygen enriched atmosphere along with high gas velocities.

5.4.3 Filters

Gas cleaning with filter elements is required when particle-retention specifications exceed the capabilities of a conical strainer.

5.4.3.1 Filter risks

Filter elements are impingement locations that are considered high risk due to their particle-retention function. Elements are also "high surface area to volume" components that, depending on the material used, might easily ignite. As such, element material selection requires additional care. Systems should be designed to avoid the likelihood of filter or strainer operation in reverse flow.

5.4.3.2 Filter element material

Common filter-element materials include, but are not necessarily limited to, the following:

- fiberglass or woven glass without organic binders;
- woven or sintered nickel; and
- brass, bronze, copper, or Monel 400.

5.4.3.3 Glass fiber filter elements

If filter elements are fitted with non-metal oxygen-compatible materials such as glass fiber, they shall be designed and assembled using copper wire to avoid accumulation of electrostatic charges in the medium, following which they shall be thoroughly cleaned to remove lubricants and other agents used during their manufacture.

5.4.3.4 Filter buckling pressure

Collapse of filter elements due to high differential pressure can lead to potential fire hazards. The element shall either be able to withstand maximum line pressure when completely clogged, or a pressure differential indicator with an alarm should be installed (see 5.4.1.1).

5.4.3.5 Filter housing

Housing material selection shall be determined by the application of impingement and non-impingement criteria and reference to the velocity curves shown as Figures 1 and 2.

5.4.3.6 Piping and valve requirements for filters

Filters should be provided with inlet and outlet block valves to permit removal for cleaning. If a line cannot be taken out of service for cleaning the filter, parallel filters should be installed and each should be provided with inlet and outlet block valves. A vent valve should be installed downstream of each filter upstream of the discharge block valve. Filters should not be equipped with valves for in-service back blowing since this entrains a collection of particulate matter at very high velocity. Bypass lines around filters can be considered when filter maintenance can be carried out during periods of low flow rate such as 20% of the design flow rate and velocity, e.g. at process shutdowns where only low flow rates are used.

5.4.4 Flow-measuring devices

5.4.4.1 General requirements

Flow meter systems should be located remotely from other equipment and piping, preferably outdoors. Manual block and bypass valves should be reasonably remote from meters and either located away from any potential fire area or separated by a barrier. Material selection is based on the use of exempt materials such as those shown in Appendix D or meeting the criteria of the impingement velocity curve shown in Figure 2. Filtration shall be considered upstream of carbon steel meter systems.

Static meters such as orifice plates are preferred over moving element meters for oxygen service provided that their measuring performance is able to satisfy user's requirements. Filtration is generally installed upstream of moving element meters.

5.4.4.2 Orifice plates

Orifice plates are flow-measuring devices that are considered to be an impingement site because of the higher velocity and sharp edges at the reduced areas. Exempt materials such as those listed in Appendix D should be used.

5.4.4.3 Moving element flow-measuring devices

The design and selection of moving element flow-measuring devices shall be suitable for oxygen service and the service conditions of pressure, flow, and temperature. Rotary, turbine, angular momentum mass flow and positive displacement meters are typical types of moving element meters that are used where broad range ability and accuracy are required. A design of a typical moving element meter station of this type takes into account the concerns of overpressuring, overspeeding, reverse flow, and excess flow. As there may be some additional considerations or simplifications, every case should be individually and carefully analyzed for its requirements. Special safety considerations for these types of meters are:

- Piping should be designed and installed to apply minimum stresses on connections to meters that have moving parts;
- Manual maintenance operation should only be carried out on meters after they have been taken out of service, isolated from the system, depressurized, and made safe;
- Lubrication: some dynamic meters require a reserve of lubricant. This shall be selected from among the oxygen-compatible lubricants described in 5.5. If the lubricant reservoir is visible from outside,

there shall be a label in a prominent position fixed to the meter specifying the grade of lubricant authorized. Renewal or checking of the lubricant shall be made by personnel authorized by the user;

- Remote indication: meters having integral flow indicators or totalizers should be designed, so they can be read at remote location without approaching the meter; and
- Overspeed protection: some moving element meters such as rotary piston meters are in danger of undergoing excessive deformation when their maximum permitted flow is exceeded. The friction caused by contact of the moving parts or entrained foreign particles may cause jamming, fracture, and/or ignition. These meters shall be protected by a flow-limiting device.

5.4.5 Bursting disks

Caution is required with regard to the use of bursting disks on oxygen transmission and distribution piping because of the risk of premature failure, disruption of supply, and subsequent uncontrolled release of large volumes of gas, which can form oxygen-rich atmospheres. If their use is for any reason unavoidable, they should be made of exempt material. Stainless steel and nickel alloys less than exemption thickness are permitted based on burst disc design conditions, the requirement to open at a set design pressure, and since they only pass flow upon rupture. Pre-scored non-fragmenting burst discs are preferred. Their outer surface in contact with the atmosphere may be coated with a thin layer of PTFE or FEP in order to prevent deterioration by corrosion.

5.4.6 Insulating joints

An insulating joint is essentially made up of two pipe elements separated by a dielectric material.

The purpose of insulating joints is to provide permanent electrical discontinuity between the parts of the installation with cathodic protection and those without it.

Because of this electrical discontinuity, insulating joints carry potential danger of spontaneous ignition of the insulating material caused by possible heating due to the Joule effect. If, in the interior of a pipeline, a continuous deposit of dust connects the two pipeline elements, and if the current intensity is sufficient, the dust may be brought to a temperature capable of initiating ignition of the insulating material.

The insulating material in contact with oxygen should combine adequate mechanical and dielectric properties and comply with the provisions in 4.3.

Insulating joints using standard flanges shall include the following features as minimum requirements:

- The insulating gaskets, bolt washers, and sleeves shall be compatible with gaseous oxygen under the conditions of service;
- The dielectric strength of the gaskets, bolt washers and sleeves will depend on vendors' specifications and purchasers requirements but typically will be in the order of 10 kV/mm;
- Insulating flanges should be installed in the horizontal plane (i.e., a vertical pipe run) to minimize accumulation of debris and moisture inside the flange faces, which can cause bridging across the gasket. The pipe run can be inclined up to a maximum of 45 degrees from the vertical. Gaskets should be full face type cut to exact pipe internal diameter. The bridging effect and also the possibility of arcing across the gap can also be reduced by using a gasket with an outside diameter greater than the raised face of the flange;
- Insulating flanges should be fitted with a fault current protection cell to provide protection against fires in the event of lightning strikes (see 10.2);
- The design of the cathodic protection system should limit impressed current potentials wherever possible. Insulation joints should be fitted with suitable surge protection devices to prevent sparks or excessive voltage gradients causing localized heating across joint gaps or other locations where metal surfaces at different electrical potentials are separated by insulating materials.
- If proprietary insulating joints of the monolithic/mono block type are to be used, the following important features merit consideration:

-
- The dielectric material and internal gas seals shall be compatible with gaseous oxygen under the conditions of service;
 - The dielectric material shall also be non-permeable with respect to gaseous oxygen at the service conditions;
 - The dielectric strength of the insulating material should typically be in the order of 10 kV/mm;
 - Monolithic/mono block joints should be provided with connection lugs on the exterior of the unit positioned on either side of the insulation element to allow for the fitting of a surge diverter 'spark gap' and for the ongoing checking of electrical isolation.
 - Insulating joints, especially the monolithic block type, are prone to damage and leakage if overstressed either laterally or longitudinally. To reduce the likelihood of joint deformation beyond the acceptable limit, it is critical to select an appropriately conservative mechanical design safety factor for the joint to guard against design uncertainties associated with the piping installation, terrain, local environment, and other factors; and
 - It is also important that joints are adequately supported and correctly installed.

See also 4.5.2, 4.5.4, and 7.4.3.

5.4.7 Flexible connections

The use of permanent flexible connections, hoses, and expansion joints is not recommended in oxygen pipeline systems due to their thin wall thickness and potential for creating dust entrapment zones in the corrugations.

For pipelines exposed to wide variations in temperature, it may be necessary to insert expansion loops to accommodate the pipeline movement. The radius of curvature of the expansion loops should be chosen to facilitate the use of cleaning pigs if required. The material for the expansion loops should be consistent with 5.2.

5.4.8 Miscellaneous equipment items

5.4.8.1 Noise reduction devices

Shells, baffles, and diffusers of vent silencers shall be entirely of metal and/or concrete construction. The metal should be corrosion resistant and in accordance with the impingement velocity curve shown as Figure 2. The assembly should be designed and manufactured to avoid any relative movement of the components. If silencers make use of sound-absorbing materials, these shall be non-combustible and essentially free of oil and grease. Examples of such materials are glass fiber or mineral wool.

5.4.8.2 Other accessories

Any other accessory that may come into contact with oxygen shall be constructed from material selected in accordance with the impingement velocity curve shown as Figure 2. Materials that meet requirements of 4.3 shall be selected for their nonmetal components.

Common accessories are:

- pressure sensors and indicators;
- pneumatic control devices;
- thermowells; and
- instrument tubing and instrument manifold valves.

Instrument tubing normally consists of small bore pipes in a non-flowing application, which permits the use of stainless steel tubing without thickness limitation. Dead legs and particle accumulation should be avoided. Instrument valves are in a throttling mode when opened, and the use of exempt materials such as those listed in Appendix D should be considered.

Dial gauges should be provided at the rear with blow-out plugs or bursting disks enabling the oxygen to escape in the event of fracture of the sensing element. Additional safety features such as safety glass and a solid partition between the sensing element and the gauge window should be provided. If sensors use hydraulic fluid, the fluid should not be in direct contact with oxygen, and it should be selected on the basis of the information in 4.3 and 5.5. All pressure sensors and indicators should be clearly marked for oxygen service (e.g., by a visible inscription OXYGEN, NO OIL OR GREASE).

5.4.9 Protection systems

The design and installation of protection systems including pressure, flow and temperature switches, and other devices should take into account the following factors:

- the quality and reliability of the devices;
- failure modes and effects including, for example, power failure, instrument air failure, and instrument circuit failure;
- whether to use trips and/or alarms and, in the case of the latter, the ability of the operator to respond; and
- fail safe requirements and consequence of failure considerations versus supply reliability concerns.

The required Safety Integrity Level of any protection systems should be considered as part of the design. For more information, refer to IEC 61508 and IEC 61511 [35, 36].

5.4.10 Heat exchangers

Caution should be taken when selecting heat exchanger tubing that may be less than 0.125" (3mm) as trace moisture can result in premature catastrophic corrosion of carbon steel. Therefore, carbon steel is not recommended for heat exchanger tubing. Exempt alloys are recommended for heat exchanger tubing; stainless steel tubing can be used at low oxygen velocities (see Figure 2). This publication does not address ambient vaporizers or brazed aluminium heat exchangers.

For oxygen compressors, material selection for heat exchangers is documented in IGC 10, *Reciprocating Compressors for Oxygen Service* as well as EIGA IGC 27, *Centrifugal Compressors for Oxygen Service* [37, 38].

5.5 Lubricants

All components should be designed to function without lubrication. However, if a lubricant is necessary to permit assembly operations or the functioning of a component, it shall be selected from lists of lubricants that have been found acceptable for use with oxygen such as lubricants listed in BAM [22]. ASTM G63 is also a pertinent information source [9]. The lubricant should be distributed on the surfaces to be lubricated and its use shall be kept strictly to a minimum. The lubricant shall be incorporated for life when the component is assembled and no trace shall be discernible from the outside. A deviation is permitted in the case of components where experience and comprehensive testing have demonstrated the safe use of such components.

Lubricants and greases suitable for oxygen service are generally halogenated chlorotrifluoroethylene (CTFE) fluids, which are thickened with silicon oxide. The use of these products should be restricted to dry atmosphere applications as they allow moisture to penetrate the oil film and cause severe corrosion.

CTFE fluids should not be used with components fabricated from aluminium alloys under conditions of high torque or shear because of the danger of reactions with freshly exposed surfaces.

Care shall be taken with the selection of oxygen-compatible lubricants because, depending upon the application, the lubrication properties of CTFE fluids are generally not as good as hydrocarbon-based mineral oils or greases.

6 Cleaning

6.1 General requirements

6.1.1 Cleaning strategy

Cleaning of a piping system can be accomplished either by precleaning all piping before installation and maintaining the clean condition during construction, by completely cleaning the piping system after construction, or by a combination of the two. It is generally preferred to pre-clean piping prior to installation. It is both impractical and impossible to fully inspect a system for cleanliness after construction and final cleaning; it is therefore necessary that a detailed written procedure including the sequence for construction and cleaning be well established and carefully followed throughout the project. The piping system design shall be compatible with cleaning, construction, and pressure testing methods to be used. There should be a written specification for the inspection for cleanliness throughout the material preparation and construction stages. Additional guidance on oxygen cleaning is available in G-4.1, *Cleaning Equipment for Oxygen Service* and EIGA Doc 33 [39, 40].

6.1.2 Standard of cleanliness

A system is considered to be clean for oxygen service when internal organic, inorganic, and particulate matters have been extensively removed. Removal of contaminants such as greases, oils, thread lubricants, dirt, water, filings, scale, weld spatter, paints, or other foreign material is essential. See 6.5.3 for guidance on acceptance criteria.

6.1.3 Cleaning methods

The cleaning of oxygen pipelines may be accomplished by any one or a combination of more than one of the following methods:

- chemical cleaning (acid or alkali) and passivation;
- pigging;
- mechanical scraping;
- grit, sand or shot blasting;
- dry carbon dioxide ice blasting;
- water blasting;
- solvent washing;

NOTE—Solvents prohibited by the Montreal Protocol shall not be used. Refer to relevant national, European, or U.S. regulations.

- high pressure detergent cleaning;
- high temperature detergent cleaning; or
- high velocity gas purge.

Pigs are commonly used for internal cleaning of pipelines. The types of pigs available fall into the following broad categories:

<u>Type</u>	<u>Application</u>
Gauging	To ensure freedom from obstruction
Foam (or soft pig)	Dewatering
	Removal of fine, loose debris and dust

Rubber disk or cup	Dewatering
	Removal of loose debris
Wire brush	Removal of pipe scale
	Removal of adhered particles and rust
Scraper	Removal of pipe scale
	Removal of adhered particles and rust

In general, pigs will be fabricated from materials that might not be totally compatible with oxygen, particularly those made of foam or rubber. It is therefore important to ensure as far as possible that if materials such as foam or rubber are used, they will not adhere to the pipe wall or remain as fragments in the pipeline. The removal of any such particles or fragments can only be achieved by a high velocity gas purge (see 6.3.7 and 6.4.6). However, the correct selection and use of pigs to suit the anticipated condition of the internal surface of the pipe at the various stages of cleaning will minimize the likelihood of damage to the pigs and contamination of the piping system. It is also important that the pigs, the associated launching/receiving traps, and other equipment are compatible with the solvents and cleaning agents to be used and have been cleaned to oxygen service standards.

Note: If pigs are to be used for cleaning the piping system their use should be considered at the design stage to ensure among other things the correct bend radius is specified.

A fill log of all pig runs should be kept. Pigs should be inspected once they are removed from the receiver.

6.1.4 Piping system components

Equipment such as tees, valves, check valves, insulation joints, regulators, meters, filters, and other fittings will normally be purchased as precleaned items for oxygen service and installed after the completion of cleaning operations. If any items of equipment cannot be furnished clean, arrangements shall be made for them to be cleaned at or local to the site to meet the required standards. Visual inspection of equipment items should be carried out just before installation to ensure that the required standard of cleanliness has not been compromised.

Branch lines and parallel lines shall be treated as separate systems for the purpose of cleaning, and the final tie-ins shall be made after cleaning is completed.

6.1.5 Welding

The pipe sections shall be welded together using a recognized welding process. Ultimately, it is essential that the internal weld surfaces are smooth and substantially free of slag, beads, or loose debris thereby preserving the internal cleanliness. Refer to 7.3 for further information on welding requirements.

6.1.6 Pressure testing

The pipeline shall be subject to either a pneumatic or a hydrostatic pressure test at the pressure required by the code to which the pipeline has been constructed. The preference is for a pneumatic test (see 7.3.3). Whichever test method is selected, it shall be conducted at a convenient point in the overall pipeline construction program to suit project requirements and to minimize the likelihood of costly rework. For further details on pressure testing see 7.6.1.

6.1.7 Installation of piping equipment

On completion of final cleaning, all aboveground connections can be installed including precleaned and pre-tested tees, valves, fittings, branch piping, and other items. See 7.6 for non-destructive testing requirements.

6.2 Specification and manufacture of line pipe material

6.2.1 General requirements

All essential requirements for the specification and manufacture of the line pipe that have a direct bearing on the cleaning process should be formally submitted to the piping component suppliers as part of the full technical specification for the purchase of the line pipe. The origin and quality control of the purchased line pipe shall be fully traceable and the relevant documentation submitted to the purchaser for retention.

6.2.2 Codes and standards

Generally, the manufacturing process, material, grade, and inspection requirements for the piping should be in accordance with standards such as EN 10208-2; API Spec 5L specification; or other codes as defined in the project specification as a result of purchasers' requirements, national regulations, or other reasons [41, 42]. The material composition should generally be in accordance with the aforesaid codes and the manufacturer's normal standard for line pipe. However, for pipe that is to be precleaned before installation, it is desirable that the manufacturing process should not include steps that will generate heavy deposits of mill scale on the internal surfaces of the line pipe (see 6.2.4).

6.2.3 Manufacturing process

Examples of common manufacturing practices are high frequency induction (HFI), electric resistance welding (ERW), laser beam welding (LBW), or submerged arc welding (SAW) process. Seamless rolled pipe can also be used. Line pipe manufactured by other processes should not be used without the prior approval of the purchaser. The purchase order issued to the pipe manufacturer or stock list shall prohibit the application of preservatives such as paint, varnish, or lacquer on the internal surfaces of the line pipe.

6.2.4 Heat treatment

Heat treatment for either the longitudinal weld (normally carried out as part of the continuous welding processes) or the pipe body should be such that the finished line pipe is essentially free of mill scale (see 6.2.2).

6.2.5 Hydrostatic test

Regardless of the nature of the pressure test carried out in the field, the manufacturer of the line pipe shall, as part of the manufacturing and quality control process, carry out a hydrostatic test and/or eddy current test (as permitted by the material specification) on each section of the finished pipe. The test should be in accordance with the requirements of the applicable national regulations or codes such as EN 10208-2 or API Spec 5L unless dictated otherwise in the project specification as a result of the purchaser's requirements [41, 42].

6.3 Pre-cleaned piping

6.3.1 General

All pipelines should be constructed with sections of pipe that are largely free of mill scale by virtue of the pipe manufacturing process (see 6.2.2) and that have been precleaned internally either at the manufacturer's works before delivery or local to the site. The method used for precleaning can be either mechanical or chemical, depending on convenience and cost, provided the desired standard of cleanliness can be achieved. External coating for underground pipelines can be carried out before or after internal cleaning is performed as long as precautions are taken to ensure that the external coating process does not compromise the cleanliness standard of the internal surfaces. The open ends of the pipe sections should be sealed after cleaning and coating to prevent contamination of the clean pipe (see 6.3.5).

6.3.2 Pipe fabrication

Line pipe undergoing precleaning for oxygen service should be fabricated in a manner that permits visual inspection along its whole length and, if necessary, recleaning to the required standard. The workshop fabrication of piping for oxygen service should be segregated from other activities.

6.3.3 Pressure testing

Whenever practical, pressure testing of the pipeline system should be carried out pneumatically provided such a test does not contravene the provisions of any of the following:

- relevant design codes;
- national and local regulations;
- internal regulations of the third party (when appropriate); or
- acceptability on the basis of a formal risk assessment.

The requirement for a pneumatic test is dictated by the need to minimize the risk of contamination or corrosion of the oxygen transmission line piping as a result of the introduction of water during a hydrostatic test. However, if pneumatic testing is not acceptable for any reason, pipelines shall be subject to a hydrostatic test (see 6.1.6).

6.3.4 Internal surface finish

The precleaning process, including blowout, aims to achieve as a minimum requirement an internal surface finish in accordance with ISO 8501-1, Specification B SA2 or equivalent [43]. The precleaning and blowout can be carried out at the manufacturer's works (after the hydrostatic test) if so desired. However, if the condition of the internal surfaces of the finished pipe is likely to deteriorate significantly as a result of the period and/or conditions of storage (including transit to site) before installation, the precleaning and blowout should be carried out either on or local to the site. The piping shall be inspected to ensure that the required standard of cleanliness has been achieved (see 6.5).

The formation of rust on the cleaned internal surface can be inhibited by the application of a light phosphate coating. This is common practice after chemical cleaning procedures.

6.3.5 Preparation for shipment

Once the required standard of cleanliness has been achieved, the open ends of the line pipe shall be fitted with strong, close fitting plastic caps to ensure a dust-tight, waterproof seal. The caps shall be secured and sealed with strong adhesive tape. Depending on the period and conditions of storage and transit, a desiccant such as silica gel can be placed inside each length of line pipe to minimize corrosion. If a desiccant is used, it should be held in a container system that can be firmly secured to the inside of the plastic caps to guard against the container being inadvertently left in the pipe during installation. The total number of desiccant bags used may be checked and documented for reference during the installation at site. Any small-bore tappings in the pipe shall be sealed by metal or plastic plugs.

6.3.6 Maintaining cleanliness

For line pipe that has been cleaned before delivery to site, no further cleaning of the pipe sections need be carried out before installation unless visual inspection at site reveals that for whatever reason the cleanliness of the piping has been compromised. In this event, the affected line pipe sections shall be recleaned either on or local to the work site in accordance with an approved procedure. During the installation of the piping the internal surfaces of the line pipe shall be maintained in a clean and dry state (i.e., free of oil, grease, soil, debris, and run-off water). This shall be achieved by the preparation of a formal construction plan (see 7.2) that among other requirements shall include all of the following:

- Keeping pipe trenches free of water and flammable material, particularly in the area of welding and where there are open-ended sections of line pipe;

- Sealing the open ends of pipes with pressure-holding plugs or welded caps at the end of each working day or when welding is not being carried out. As an additional precaution during extended periods of inactivity the piping can be left under pressure with dry, oil-free air or nitrogen at about 0.1 bar gauge (1.5 psig);
- Visual inspection of the line pipe before every closing weld to be made by an authorized person. Formal records of the results should be maintained for future reference;
- Maintaining the cleanliness of inert gas purging devices (e.g., lances, temporary seals);
- All propelling media, gases, and the system for applying them during any type of cleaning operation to be clean and oil-free so they are not a source of contamination; and
- Construction personnel shall wear work clothes that are clean and free from oil contamination and, as far as is practical, shall keep their hands free of oil, grease, and excessive dirt.

During the construction period, the piping will at times be open to atmosphere and will experience some degree of internal surface corrosion due to this exposure. At the completion of construction, a determination of the extent of this surface corrosion should be made and consideration should be given to its removal by a formal pigging procedure and high velocity purge. A light film of surface rust is acceptable.

Construction personnel should remain in the oxygen-clean work area and not move to other work areas using oil or grease.

All tools shall be cleaned and kept aside for use in the oxygen area only. Workbenches covered with clean material should be set up where tools, small parts, etc. can be placed.

In general, the use of lubricants shall be prohibited on either piping or valves intended for oxygen service. If for any reason lubricants are deemed to be necessary for oxygen-wetted parts, they shall be fully oxygen compatible and used only with the prior approval of the purchaser (see 7.4.2 and 7.4.4).

Pressure-holding pipe plugs shall be kept clean and stored in plastic bags when not in use.

6.3.7 Final cleaning

Final cleaning shall be performed at a convenient point in the overall construction program to suit project requirements. The cleaning procedure will depend on a number of factors including, among others, risk of contamination during construction, nature of potential contaminants, and method used for pressure test whether conducted before or after cleaning. In any event, the use of pigs should be considered to provide an indication as to the nature and degree of any residual contaminants remaining in the system. Attention is drawn to the risks associated with those solvents and cleaning agents that are non-flammable in air but exhibit a flammable range in oxygen (see IGC Document 33, AIGA 012/04, for information on flammability limits) [40]. If chemicals, solvents, or detergents have been used for cleaning, it is therefore important that any liquid residues be completely drained or otherwise removed from the system prior to commissioning. See 6.1.3 for a summary of available cleaning methods.

6.3.8 Leak testing and blowout

The completed piping system without equipment can be leak tested with dry, oil-free air or nitrogen at the system design pressure and then following, a high velocity blowout is required. Valves, orifice plates, strainers, filters, and other items of precleaned equipment should not be installed during the blow-out process to protect them from damage or contamination by particulate matter. The final high velocity gas purge should achieve a high velocity (typically 25 m/s [82 ft/s]) sufficient to substantially remove residual particulate matter. The effectiveness of the high velocity gas purge can be subjectively judged by visual examination of the free and unobstructed purge gas plume at the full bore vent outlet pipe. Alternatively, target plates located at the purge gas exit can be used to assess the true effectiveness of the gas purge operation.

The effective removal of particulate matter from the system by the blow-out operation should be demonstrated by the use of target plates mounted at the discharge end of the pipeline. Targets may be polished metal or cardboard on plywood. Targets that have been used are aluminium of hardness

25-35 HB (see BS EN ISO 6505-1) [44]. Suitable grades are 1050 A-0 and H1080 A0. The sheets shall be securely mounted at the discharge end of the pipe, allowing a gap between the plate and the pipe outlet equivalent to half the pipe diameter. As an alternative, steel plates may be used with a uniform smear of oxygen-compatible grease to trap particulate material.

The blowout shall be judged as complete when there is no perceptible evidence of particles on the target detected by the naked eye or touch (i.e. scars or pits >0.2 mm). For grease-smear plates there shall be no evidence of collected particles as detectable by the naked eye.

If nitrogen is used as the purge, gas care shall be taken with the orientation and location of the gas vent to minimize the exposure of personnel to oxygen deficient atmospheres.

6.4 Post-installation cleaning

6.4.1 General

All line pipes should be installed with sections of pipe that are generally in accordance with 6.2. Otherwise there are no other special requirements. It is important, however, to ascertain the likely condition of the piping (e.g., degree of mill scale) as delivered from the stock list or manufacturer's works to ensure that the proposed cleaning method is capable of achieving the desired standard of cleanliness. See 6.3.1 for methods of cleaning.

6.4.2 Pressure testing

See 6.3.3

6.4.3 Internal surface finish

The cleaning process including blowout (if required) should aim to achieve an internal surface finish in accordance with ISO 8501-1, Specification B SA2 [43]. The piping shall be inspected to ensure that the required standard of cleanliness has been achieved (see 6.5).

6.4.4 Maintaining cleanliness

During the installation of the piping system every effort should be made to minimize the ingress of contaminants (e.g., oil, grease, soil, debris, and runoff water). See 6.3.6 for guidance.

6.4.5 Leak testing and blowout

If a blowout is required, see 6.3.8 for details.

6.5 Inspection

6.5.1 Procedure

After satisfactory completion of the construction, testing, and cleaning processes, the piping shall be inspected at both the inlet and discharge ends and at all accessible points to assess the condition of the internal surface. If considered necessary, according to the quality control procedure, samples can be taken at all accessible openings by wiping the internal surface of the pipeline with white, lint-free cloths or filter papers of a type that have not been treated with optical brighteners. If so desired, the wipes used for sampling can be identified, sealed in a polyethylene bag, and retained as part of the pipeline quality control dossier.

The examination should be conducted using one of the following procedures:

- Visual inspection of the internal surfaces using white light to ensure that the cleaning has been effective and that a gray metal finish, free of grease, loose rust, slag, scale, and other debris has been achieved. A light film of surface rust is acceptable;
- Inspection of end sections of internal bore by ultraviolet (UVA) light to verify the absence of oil or grease; and
- Inspection of wipes (if taken) by bright white light and UVA light to verify the absence of oil or grease.

6.5.2 UVA light examination

When UVA light examination is required, all samples and openings shall be inspected by a suitable UVA light source to verify that there is no evidence of hydrocarbon contamination. A slight discoloration of the sample is acceptable providing that the sample does not exhibit fluorescence when subjected to UVA light examination. The following criteria shall generally apply to the selection of the UVA light source to be used for the fluorescent detection of hydrocarbon contaminants on pipe surfaces or wipes:

- The light wavelength shall be in the range 250 nm to 400 nm; and
- The light source shall be a spotlight using either a mercury vapour or halide lamp together with a suitable filter that provides a light intensity of at least 5.0 mW/cm² at 30 cm (12 in). Normally, UVA light sources using fluorescent tubes are not suitable for this application and should be avoided.

In most cases UVA light examination will provide a reliable indication as to the extent of hydrocarbon contamination in a pipeline (see 6.6.3). However, it should be recognized that not all oils and greases fluoresce under UVA light. If for any reason such materials have been used either in the manufacture, long-term storage, fabrication, or construction of the line pipe then other detection methods might be necessary.

6.5.3 Acceptance criteria

Reference should be made to IGC Document 33, Section 4; CGA G-4.1, Section 10; and ASTM G93-96, Sections 9 and 10 for guidance on threshold detection limits and cleanliness acceptance criteria [40, 39, 45].

6.5.4 Remedial action

If at any stage during the precleaning or in-situ cleaning process an acceptable standard of cleanliness has not been achieved and there is evidence of contamination due to heavy corrosion, adhered particulate matter, oil, grease, or similar hydrocarbon-based material present in the debris collected during pigging, the organization responsible for the cleaning shall submit to the purchaser proposals and method statements for achieving a satisfactory standard of cleanliness.

6.5.5 Sealing, purging, and monitoring

Following the piping system inspection and acceptance of the standard of cleanliness, the pipework will be sealed at all open ends with either welded caps or blind flanges and purged with dry, oil-free air or nitrogen (dew point no higher than $-40\text{ }^{\circ}\text{C}$ [$-40\text{ }^{\circ}\text{F}$]) until the dew points of the inlet and exit gas are essentially the same. Once the oxygen content and dew point have reached the required levels, the pipeline system shall be sealed and pressurized with the dry, oil-free gas to about 0.01 MPa (1.5 psig). The pressure shall be monitored on a regular basis and maintained in this condition until the system is required for service with the product gas.

6.6 Records

Records of cleaning activities and details of inspections on oxygen service pipelines should be established and maintained.

7 Construction

7.1 General criteria

The total installation of the piping system including testing and cleaning should be undertaken by an organization with a proven record of experience in pipeline construction. The fabrication, testing, and cleaning procedures shall have been reviewed and approved by the purchaser before the pipeline is installed. The detailed construction program including the sequence of testing and cleaning procedures shall be defined to suit specific project requirements. The design of the piping system shall have made provision for the cleaning and pressure testing methods to be used.

The construction of oxygen piping systems should follow good engineering practice in accordance with recognized national or international piping and construction codes. An important factor to be

considered is the cleanliness of the piping system for oxygen service. Reference should be made to Section 6 for further information on cleaning and inspection procedures.

Systems of work shall be in place to ensure the safety of the construction personnel in the fabrication and erection areas.

Every effort shall be made to ensure the quality and the operational safety of the piping being installed.

The oxygen piping system shall be fabricated and installed in accordance with the piping and construction codes as defined in the project specification.

All necessary precautions and measures should be taken to protect materials and piping from damage caused during off-loading, storing, installation, or other activities. Piping should be carefully stored and handled to prevent contamination of the interior of the pipe and to prevent damage to the exterior protective coating (if applied).

The line pipe shall be fabricated and/or installed in accordance with approved drawings. Installation of the line pipe shall include all manual valves, special piping items, control valves, relief valves, in-line items, and pipe supports as required by the approved drawings.

Whenever practical, prefabrication of pipework to oxygen cleanliness standards should be arranged to enable visual inspection along its whole length.

The fabrication of oxygen service pipework in a workshop environment shall be segregated from other activities to ensure oxygen cleanliness.

Procedures for any remedial work that might be required should be agreed upon with the purchaser prior to the work being performed.

7.2 Construction plan

A formal construction plan should be developed that provides for a comprehensive, logical progression of work including proper supervision, regular inspection, and verification. The following procedures and guidelines can be incorporated in the formal construction plan for any given oxygen pipeline project:

- Whenever practical, assembly work should be scheduled at a late stage in the overall project and started only when all oxygen service piping and components are available on site; and
- A small group of construction personnel and an inspector should be assigned to the oxygen system and every effort made to keep the same personnel on the job until completion.

The guidelines for maintaining cleanliness are summarized in 6.3.6.

7.3 Pipe fabrication and welding

7.3.1 General

Piping shall be assembled by welding except at connection to valves, meters, or other equipment where threaded or flanged joints are permitted.

To preserve the internal cleanliness of the piping, the internal weld surfaces shall be smooth and substantially free of slag, beads or loose debris (see 6.1.5). The required weld surface finish can be achieved broadly by various methods such as:

By using the gas tungsten arc welding (GTAW), also known as tungsten inert gas (TIG), welding process for the root pass in conjunction with, if so desired, an internal argon or other suitable backing gas. Subsequent weld passes can be made using either the GTAW or other weld processes as preferred. This process will in itself produce the desired smooth finish on the internal weld surface. Other welds such as final tie-ins can also use the GTAW root pass to achieve the desired internal weld surface finish; or

By using the manual metal arc (MMA) welding technique, also known as the shielded metal arc welding (SMAW), followed by cleaning of the internal weld surfaces with wire brush or blade tool pigs to remove slag, beads, and loose debris and thereby achieve the desired finish.

Inspection should be made of all pipe spools and components prior to assembly to ensure that flange or weld faces are clean and that there is no dirt or contamination inside the pipe. Any debris or foreign material inside the pipe shall be removed before pipe welds or flange connections are made.

7.3.2 Qualifications

All pipe welding shall be performed in accordance with welding procedures and by welders qualified to the procedures in accordance with the piping code as defined in the project specification.

7.3.3 Backing rings

No backing rings shall be used for the welding of carbon, stainless steel, or Monel piping intended for oxygen service for the following reasons:

- Gaps between the backing ring and the pipe wall can trap dust and debris, which cannot easily be removed during the cleaning processes. Accumulated particulate debris could act as a potential source of combustible material;
- The absence of backing rings facilitates the use of pigs for cleaning operations; and
- Backing rings can act as impact sites.

7.3.4 Preparation for welding

All weld joints shall be prepared in accordance with the approved welding procedure and the relevant piping code. The longitudinal seams of welded pipe in adjoining pipe sections shall be staggered. On precleaned systems, internal line-up clamps for welding should not be used to avoid the risk of contamination. If a system is to be cleaned in place after completion of construction, this requirement can be relaxed provided systems are in place to ensure removal of such devices before the cleaning operation.

7.3.5 Welding requirements for materials

The welding of carbon steel, stainless steel, and Monel shall be conducted in accordance with the relevant piping code (see also 6.5.3).

7.4 Assembly and installation

7.4.1 Alignment

Before bolting up, the alignment deviation of the flange face and flange bolt holes shall not exceed the values defined in the project specification; all bolts shall pass easily through both flanges.

The tolerance on the termination of all piping other than flanged connections shall be as shown in the design drawings and specifications.

7.4.2 Flanged joints

Pipe stress at flanged joints shall be minimized. Piping shall not be hung from flanges of compressors or other equipment without adequate supports.

Gaskets shall be installed in accordance with the design drawings. When gaskets containing non-metal parts are used, non-metals shall be chosen according to 4.3. The use of gasket types or materials other than those defined in the project specification shall be prohibited unless approved by the purchaser. If gaskets are not individually packaged or if the package seal is broken and contamination is suspected, the gaskets should be either rinsed with a compatible solvent or rejected.

Gaskets shall be correctly sized to ensure that no part of the gasket projects beyond the inner wall of the pipe into the flowing gas stream. The use of gasket sealants shall be avoided to prevent extrusion of the sealant material into the pipeline system.

The reuse of any gasket is prohibited; it is essential that new gaskets be inserted every time a flange is released. When a joint leaks on pressure test, the joint shall be remade using new gaskets and bolts.

Gaskets, nuts, and bolts shall be visually inspected to ensure that they are clean and in good condition. A solvent rinse container may be available for washing nuts and bolts just prior to installation. If so desired, a suitable lubricant as defined in the project specification can be applied to bolt threads and bearing faces of nuts and washers before bolts are inserted into flanges and tightened.

Lubricants shall be clearly identified, used sparingly, and their application made under close supervision. Oxygen-compatible lubricants are preferred; however, they can promote corrosion on parts due to their tendency to adsorb moisture. Non-oxygen compatible lubricants have been successfully used for this service; however, great care shall be exercised through formal procedures and rigorous supervision to ensure oxygen-wetted surfaces are not contaminated and that the lubricant is not mistakenly assumed to be oxygen compatible.

Alternatively, lubrication can be avoided by the use of appropriate, corrosion-resistant materials for bolts, nuts, and washers.

Bolting shall be pulled up gradually using a crossover sequence. The bolt type and size shall be matched to the flange and gasket material. If bolt loads are specified, the contractor should use torquing or tensioning procedures to achieve the correct bolt loading. If bolt torque values are specified, the contractor can use torque wrenches via the nuts to develop the necessary bolt load. The use of torque or tensioning equipment might dictate the use of a suitable lubricant on the bolt threads. If no bolt loads or torque values are specified, bolts shall be tightened in accordance with good engineering practice or vendor information to ensure that the joint is capable of holding the test pressure without leakage.

7.4.3 Insulating joints

Insulating joints for cathodic protection systems particularly those of the monolithic/mono block type are prone to damage and leakage if overstressed either laterally or longitudinally. To reduce the likelihood of joint deformation beyond the acceptable limit, it is important that joints are adequately supported/anchored and correctly installed in accordance with design drawings and good construction practices (see also 4.5.2, 4.5.4 and 5.4.5).

7.4.4 Threaded joints

Apart from compression fittings, the use of threaded joints should be restricted to small bore piping. Threaded joints shall be made with an oxygen-compatible tape or sealant such as PTFE thread tape. The use of threaded joints in piping systems shall be limited as far as is practically possible. Clean cut taper threads in accordance with the design requirements shall be used and shall be fully deburred. Unions shall be installed as per the design drawings.

7.4.5 Valves

All valves shall be supplied with identification tags or plates and installed in the location defined by the design drawings. Identification tags or plates shall remain attached to each valve after installation. It is not permitted to interchange valves.

To minimize exposure to damage, valve top works, actuators, and other associated equipment can be stored in a clean condition and installed as required after major construction work has been completed.

All valves shall be installed in accordance with the piping design drawings and handled in a way that maintains their cleanliness and prevents ingress of moisture, oil, dust, and other contaminants. Particular care should be taken with valves, whether manual, automated, or pressure relief, to ensure that both the flow direction and orientation are correct.

The use of valve lubricants should be avoided whenever possible but, if required, they shall be oxygen compatible and used sparingly.

The following precautions shall be observed with respect to the installation of pressure relief valves and other pressure relief devices:

Apart from those required for construction and testing purposes, no pressure relief valves or other pressure relief devices shall be installed until all pressure testing, cleaning, and blowout work have been completed;

All relief valve nozzles not to be used during construction shall be fitted with caps or blind flanges as appropriate to maintain cleanliness during storage; and

All relief valves and piping installed solely for construction and testing purposes shall be removed before the pipeline is put into service;

The purchaser shall be informed of any visible damage to a valve before it is installed.

Before welding any valve into a piping system, the valve shall either be fully opened or the top works removed to prevent thermal distortion of the valve components. Soft seats and other components vulnerable to damage by heat should be removed. After welding, soft seats, and other vulnerable components can be replaced following which the valve should be checked for ease of operation and remedial action taken if excessive force is required to operate the valve.

7.4.6 Supports, guides, and anchors

Supports, guides, and anchors shall be positioned and secured before the installation of the piping. Additional temporary supports can be used during installation, but they shall not be welded or bolted to any permanent structural members. Temporary supports, guides, and anchors shall be removed before the pipeline is commissioned.

All welded connections such as earth clamps or supports attached directly to process piping or equipment intended for service at elevated pressures shall be made before pressure testing. Welding on pressure containing equipment after the successful completion of a pressure test is not permitted.

7.5 Inspection and examination

During construction, regular on-site inspections should be made to ensure that correct procedures for installation and maintenance of pipeline cleanliness are being observed. After completion of construction, the pipeline should be inspected and tested in accordance with the relevant piping code and procedures as defined in the project specification. Such inspections should, as a minimum, verify the following:

- pipe concentricity;
- specified wall thickness;

-
- internal cleanliness;
 - protective coating integrity;
 - absence of mechanical damage (e.g., gouges, dents, etc.);
 - joint preparation;
 - welding fit-up;
 - welding;
 - absence of arc burns; and
 - review of X-ray examination.

7.6 Non-destructive testing

7.6.1 Pressure testing

If permissible, the pressure test should be conducted pneumatically using dry, oil-free air or nitrogen to minimize the possibility of contamination (see 6.3.3). The test shall be carried out in accordance with the code to which the piping system has been designed and constructed. Safety precautions to minimize the potential consequences of a pressure release shall be taken while the test is in progress. If nitrogen is used as the test medium, the risk of exposure of personnel to oxygen-deficient atmospheres shall be assessed and appropriate precautions taken to prevent the risk of asphyxiation.

If it is not permissible to carry out a pneumatic pressure test, a hydrostatic test should be carried out in accordance with the relevant piping code. The test shall be conducted using clean, oil-free water (preferably from a public supply). If so desired, a deoxygenating agent and passivation agent can be added to the water provided that the agents do not create any disposal problems. The filling and testing operations shall be planned as a continuous operation to ensure that water does not remain in the system for any longer than necessary, particularly if freezing ambient temperatures are foreseen during the test period.

After the completion of a hydrostatic test the water should be removed immediately either by draining or pigging or a combination of the two. The piping system should then be dried either by purging with dry, oil-free air or nitrogen to achieve a maximum dew point of $-30\text{ }^{\circ}\text{C}$ ($-22\text{ }^{\circ}\text{F}$) or by a recognized vacuum drying process using oxygen-compatible vacuum pumping equipment.

Dry, oil-free air or nitrogen shall have a dew point of $-30\text{ }^{\circ}\text{C}$ ($-22\text{ }^{\circ}\text{F}$) or lower at 1.013 bar (15 psig) and a hydrocarbon/particle content of less than 1 mg/m³ (see IGC Document 33, AIGA 012/04 [40]).

In the event that welding is required for repairs, pipe tie-ins, or final closing welds, the relevant piping code might waive the need for a pressure test provided that a prescribed alternative method of non-destructive testing is carried out.

7.6.2 X-ray examination

Butt weld joints in the pipeline shall be radiographically examined in accordance with the piping code defined in the project specification. Final closing welds can be subject to 100% X-ray examination without pressure testing as acceptable to the authority having jurisdiction (see 7.6.1). Socket weld and fillet weld joints can be suitably tested using other non-destructive examination in accordance with the applicable code. For socket and fillet welds, dye-penetrant testing is acceptable.

In situations where the radiological hazards presented by X-rays (or Gamma rays) cannot be accommodated by reasonable means, 100% ultrasonic examination by a qualified operator with a specific report for each weld shall be employed.

Longitudinal pipe seams that exist as a result of the pipe manufacturing process are exempt from on-site X-ray or ultrasonic examination.

7.7 Documentation

The following documents relating to the construction and installation of the piping shall be retrieved and retained for reference by the purchaser:

- pressure test report;
- weld procedures and qualification records for each welder;
- weld joint X-ray negatives and reports;
- records of weld tests/rejects/repairs;
- weld map;
- report of internal pipe cleaning and inspection;
- as-built drawings;
- as-built data logs;
- records of construction personnel qualifications;
- material control certificates; and
- other reports and certificates required by local and/or national authorities, the relevant piping code and the project specification.

In addition, for underground pipelines:

- Test report (e.g., Holiday test) for detecting pinholes or defects in the external coating; and
- Cathodic protection and electrical isolation report.

8 Design and construction of control stations

8.1 Function

The function of a process control station is to control and meter gas in conjunction with a supply pipeline. Each process control station is designed and constructed for individual customer requirements and incorporates appropriate process control equipment.

8.2 Design brief

A design brief summarizing the basic requirements (process definition and process and instrument diagram

[P & ID]) should be used as the basis for design.

The design brief should be developed by reference to the following:

- process pattern data supplied by customer;
- environmental, customer, and other statutory requirements; and
- site requirements including interaction with surrounding plant.

A hazard and operability (HAZOP) study and/or risk assessment may need to be considered with the design brief.

8.2.1 Emergency shut-off valves

Emergency shut-off valves (ESOV) may be provided to afford protection against pipeline failures. The closure of the valves can be initiated manually or automatically from a central control room or by

automatic signals derived from high flowrate, low pressure, or rate of decay of line pressure (see also 5.3.2.4).

8.2.2 Isolation valves

(See 5.3)

Isolation valves are normally of gate-, ball-, plug, or butterfly-type design and should be positioned in the fully open or fully closed position. Valves may be manually or automatically operated. Isolation valves made of non-exempt materials shall never be closed during a flowing condition nor opened under a differential pressure greater than 5 psi unless a risk assessment has been completed. See section 5.3.2.5 for more information regarding near equalization of pressure.

Because isolation valves are operated without differential pressure, they may be designed per guidelines shown in Figures 1 and 2. They should not be operated in the throttling or regulating mode, and if so, are not considered isolation valves and shall be designed as throttling valves (see section 8.2.3).

8.2.3 Throttling and process control valves

As defined in section 5.3.2.3, throttling valves operate with high differential pressures and high internal velocities. Throttling valves may be either automatic or manual valves. Throttling valves shall be designed with exempt alloys, or equipped with barriers to protect personnel when operating the valves.

8.2.4 Filters and strainers

(See 5.4.1 and 5.4.2)

Filters may be installed at the inlet to the process control station to protect control devices from particulate matter (originating from the upstream carbon steel pipeline or equipment/machinery) that may be entrained in the gas stream.

For ultra high purity applications (e.g., electronics) more stringent filtration levels (typically less than 5 μm) may be specified.

8.2.5 Flowmeters

(See 5.4.3.)

The invoice meter measures accurately the total quantity of gas passing through the process control station. The meter consists of a primary device and instrumentation to convert the output signal to a volumetric or mass flow value.

Orifice plate meters are frequently used. Bypass provision may also be required to facilitate removal for calibration and maintenance.

The selection of flow meter type is normally based on the accuracy requirements for the required range of gas flow to meet customer requirements. Instrumentation for converting the output from the volumetric primary device into a mass flow may use an integrated electronic system, which may comprise the following:

- pressure transmitter;
- temperature transmitter;
- differential pressure transmitter; and
- mass flow computer.

8.2.6 Flow and pressure control

Flow control devices can be incorporated to overcome erratic flow patterns to produce constant supply irrespective of customer demand or to limit the flow available to the customer. Pressure control systems regulate the variable pipeline pressure to deliver gas at constant pressure to the customer.

Dual pressure control valve streams may be required to give reliable supply and ease of maintenance.

8.2.7 Gas storage

Storage vessels or additional volume of piping may be required to provide buffer capacity to satisfy peaks in customer demand and to provide downstream capacity to facilitate efficient control valve operation.

8.2.8 Spill or vent control

Spill control allows the selected pipeline supply to continue when gas demand falls. This allows automatic venting of the surplus flow to atmosphere without the operation of the pressure relief valve.

8.2.9 Pressure relief and vent valves

(See 5.3.2.6 and 5.3.3.5)

Where required, a pressure relief device is installed downstream of the pressure controllers to protect the system against the abnormally high pressure that would be experienced under failure conditions.

The pressure relieving devices are designed to accommodate the full flow to the system, which could result from control valve failure in the open position at maximum upstream pressure including an allowance for pressure drop. Vent stacks from relief devices shall be arranged to discharge in a safe outdoor location.

8.2.10 Instruments

Instruments are usually controlled by electronics and/or by pneumatic systems. The instrument operation shall be one or a combination of the following:

- electronic using a secure power supply;
- pneumatic using a secure instrument air supply; or
- pneumatic using the service gas.

NOTE—All instrument components used in oxygen service shall be manufactured from compatible materials and shall be suitably cleaned and degreased before installation.

Systems using gaseous oxygen as the service gas shall be installed in an outdoor or well-ventilated location to avoid the risk of oxygen-enriched atmospheres.

8.3 Standards and design codes

Design, fabrication, inspection, examination and testing shall be in accordance with national or international standards such as ASME B31.3 [46].

For designs in copper and copper-nickel only, the allowable design stress shall be obtained by reference to a specific design code such as BS 1306 or ASME B31.3 [47, 46]. Electrical and instrument installations shall be designed and installed in accordance with the relevant international or national standard [35].

8.4 Materials

Due to the many unavoidable restrictions and variations in gas velocity within the pipework and components (e.g., meters, valves, and filters), the designer shall carefully evaluate pressure and flow rates under operating conditions. Exempt materials shall be used where necessary to meet the requirements of Section 4.

Only lubricants formally approved for oxygen service shall be used (see 5.5). It is important to maintain disciplined inspection and quality control procedures from procurement of raw materials and components to final testing, commissioning, and subsequent maintenance.

8.5 Barriers or screens

8.5.1 Barrier requirements criteria

Where compliance with the velocity curves (Figures 1 and 2) as discussed in 4.4.2 and 4.4.3 cannot be ensured in all operational modes, protective personnel barriers or screens shall be considered. Whether a component should be located behind a protective barrier depends upon the material selection, pressure, gas velocity, piping size (see 4.1.2), personnel exposure, siting (see 4.6 and 8.6), and a risk assessment. The function of such barriers or screens is to mitigate if it is not possible to contain the effects of any incident and to provide additional protection for operators, maintenance personnel, and the surrounding environment and equipment.

8.5.2 Design criteria

When barriers are used the following guidelines apply:

- The barriers shall protect personnel and, if so desired, adjacent equipment from hazards that occur during an oxygen combustion fire. They shall withstand loads from high-temperature combustion, released fluid pressure, and molten metal spatter. These loads vary according to the pressure of the oxygen and the proximity of the barrier to the breach of the pipe or component;
- Oxygen station barrier materials should be capable of withstanding the thermal and erosive loading generated during an oxygen-promoted metal fire. However, it shall also be acknowledged that oxygen promoted metal fires may vary considerably in terms of energy, thermal, and erosive loading as well as potential consequences at a specific site. Hence, the requirements for barrier materials may need to be defined via a risk analysis.. The barrier material that is close to a potential fire breach point should be capable of impeding an oxygen lance burning at approximately 2760 °C (5000 °F) placed at 15 cm (6 in) from the barrier material for a minimum of 3 s. The recommended lance should be 1.85 cm (0.75 in) nominal pipe diameter, fed with gaseous oxygen at a pressure between 0.8 MPa and 1.5 MPa (100 psig and 200 psig). The barrier should also be able to withstand the breach jet load on the barrier surface caused by the pressurized oxygen release. The jet load force for a barrier design is known to be proportional to PD^2 , where P is the nominal gas pressure and D is the nominal pipe diameter. In practice, a reducing factor could be used depending on the piping configuration and system volume. The detailed calculation of jet loads is outside the scope of this document. The user should refer to specialists with expertise in gas dynamics and structural design of barriers for these calculations;
- Barrier materials should be non-flammable such as concrete, reinforced masonry or insulation reinforced with metal structural sheets. The fire barrier membrane materials may also be asbestos free to follow national regulations. For barriers not close to any potential fire breach point, steel plate can be used;
- Barriers shall be designed to withstand applicable loads from wind, snow, and seismic activity;
- Barriers may be in any configuration but should have features that will prevent any molten metal splash from being deflected past the barrier;
- Vertical barriers open to the sky or building roof are acceptable;

-
- The barrier should preferably be at least 30 cm (12 in) away from any component having an oxygen fire potential;
 - Attention should be given to barriers located in the area adjacent to bends, bypass, and emergency shut-off valves and related piping;
 - Barrier height should be at least 2.5 m (8 ft) and block any line of sight view of the equipment from walkways, permanent platforms, or public buildings within 15 m (50 ft). The barrier should have no apertures except for piping or equipment penetrations where the maximum clearance should be no greater than 2 cm (0.8 in); and
 - Barriers shall be constructed such that maintenance personnel and operators can work safely outside the barriers. In cases where there are two control stations to ensure continuity of oxygen supply, a barrier should be placed between the two stations.

8.5.3 Operational requirements

Personnel are not allowed to enter an area enclosed by a barrier while the piping system is under oxygen pressure without an approved procedure.

Equipment that shall not be located within the protective barriers includes:

- operator controls including instrument air valves and pressure reducers;
- instrument readouts and equipment on which maintenance shall be made during operation;
- emergency shut-down switches;
- check valves (unless individually protected with its own barrier);
- emergency shut-off valves (unless individually protected with its own barrier); and
- sampling valves.

Manual valves located within barriers that need to be operated while oxygen is flowing shall be equipped with an extension wheel located outside the barrier so any ejection of the valve spindle cannot strike the operator.

8.6 Location

The location of oxygen stations should be chosen to avoid the immediate proximity of vulnerable areas and equipment such as flammable product storage tanks, aboveground flammable pipelines, public roads, public buildings, car parks, and transfer stations. Vessels or aboveground piping in service with flammable fluids should be located as far away as practical from oxygen stations. Mechanical joints such as flanges in aboveground flammable fluid piping, particularly piping in service with hydrogen, should not be located close to an oxygen station to minimize the risk of fire in the event of simultaneous leaks or failures.

Oxygen stations should be located where there is no danger of oil contamination or projected material from nearby equipment and machinery. If there is a nearby public or internal plant road, a vehicle barrier rail should be installed to protect the station from impact damage. The station should be fenced to restrict access by unauthorized persons. Exits should open outwards into areas that are free of obstructions.

Smoking shall be forbidden within a minimum of 5 m (17 ft) from the oxygen station. This distance can be increased depending on the risk involved at a specific location. Activities involving the use or production of flames, sparks, or other ignition sources shall also be forbidden except as authorized by a safety work permit.

An acceptable standard of lighting shall be provided to illuminate the station to ensure personnel safety.

For stations located inside enclosures, the risk of oxygen-enriched atmospheres, atmosphere monitoring, and ventilation requirements shall be considered.

The exposure of people, equipment, and activities adjacent to an oxygen station can be minimized by appropriate separation or safety distances. The selection of separation distances depends on a number of factors including the following:

- the stored energy level in the system;
- the function and complexity of the station, i.e., control, metering and/or isolation;
- environmental considerations;
- public and personnel exposure;
- exposure of equipment and adjacent activities; and
- consequence of gas release.

It is convenient to use the potential energy of the gas inventory in an oxygen control station as a basis for determining separation distances. The potential or stored energy in an oxygen station can be expressed as $P \bullet D^2$ where P is the normal maximum operating pressure (bars) and D the pipe diameter (cm). For control stations, three categories of energy release level together with appropriate safety distances have been used:

- Category 1: $P \bullet D^2 > 3000$, $P > 4$, $D > 2.5$.
- Category 2: $P \bullet D^2 < 3000 > 1500$, $P > 4$, $D > 2.5$.
- Category 3: $P \bullet D^2 < 1500$, $P > 4$, $D > 2.5$.

For PD^2 above 3000, a specific risk assessment should be performed to determine if safety distances greater than listed in Appendix E are necessary.

For stations intended for isolation or metering purposes only and where there are no automatic flow control or pressure reducing valves, the risk of failure is significantly reduced and the energy release level is therefore of less significance.

Typical arrangements for the siting of the oxygen stations in relation to other areas and equipment can be found in the table of Appendix E for each of the defined energy release levels. The distances refer to stations without barriers (except for vehicle barriers) as summarized in 8.5.2. The safety distances indicated in Appendix E may be reduced by the use of specific design or installation measures such as the use of exempt material throughout the station and/or by the installation of barriers or screens provided that these can be justified by a detailed site risk assessment procedure. The stations considered in this table are the control stations (categories 1, 2, and 3) and those for isolating and/or metering purposes only (category 4).

8.7 Earthing, grounding

The resistance to earth (or ground) of the station pipework should not exceed 10 Ohms at any point throughout the installation; tests shall be conducted from a known earth point. If necessary cross flange bonding may be required to achieve the stated minimum value. If cross bonding has been adopted, measures shall be taken to prevent corrosion of component parts.

Pipework systems should not be used for earthing associated equipment. The method to be adopted is supplementary earthing from a system earth point.

Pipework systems together with all other common services shall be bonded at a common point.

All test results including reference earth point shall be recorded and periodic testing undertaken.

8.8 Fabrication

Process control stations shall be fabricated in accordance with the approved design.

All butt welds shall be subject to examination and a non-destructive testing in accordance with the relevant design code. Verification that the required standard has been achieved shall be confirmed by a quality assurance authority or authorized inspector.

8.9 Installation

All pipes and components shall be cleaned, degreased, and prepared before installation and scrupulous cleanliness maintained thereafter (see Section 6). However, should contamination occur during installation, additional cleaning shall be carried out with analytical checks to ascertain that all traces of the cleaning agent have been removed.

Installation shall be carried out by contractors approved in their particular discipline, i.e., mechanical, civil, electrical, instruments. Installation work shall be completed in accordance with the design drawings and specifications. The completed installation should be inspected and approved by the relevant technical authority.

8.10 Testing

8.10.1 Post fabrication

Following completion of fabrication, the pipework shall be pressure tested in accordance with a national or international standard. If hydrostatic testing is used, the pipework shall be thoroughly drained, dried, and cleaned after testing.

8.10.2 Post installation

Completed installations shall undergo a pneumatic test with dry, oil-free nitrogen or dry, oil free air in accordance with a national or an international standard (see 7.6.1).

8.11 Commissioning

The preparation of a suitable commissioning procedure should be undertaken with details of the following accommodated:

- interaction with customer processes; and
- safety considerations.

A responsible person shall be appointed to control all aspects of the commissioning procedure.

8.11.1 Safety

When practicable, non-essential personnel should be excluded from a minimum 20 metre distance from piping, valves and equipment during the first pressurization and then first flowing of oxygen through a new piping system. Thus only personnel required to operate valving during commissioning of the system should be allowed inside this exclusion area and these operators should have the training outlined in 9.1.1. The responsible person shall coordinate and control the commissioning and shall ensure that the customer and all personnel are properly briefed. Normally a commissioning program and procedure will be prepared by the responsible person and discussed with all concerned before commissioning starts. All gas supplier and customer standing orders and safety instructions shall be observed.

When nitrogen is used as the test gas, precautions against asphyxiation shall be specified. Vent pipes should be fitted, where necessary, to ensure that gas is discharged to a safe area.

8.11.2 Procedure

The commissioning procedure should start after satisfactory completion of pressure testing and the issue of the relevant test certificates. The procedure should include the following precommissioning checks:

- P & ID;
- relevant material, cleaning, authenticated calibration and test certificates are available;
- warning notices and instruction plates are posted;
- filter elements are fitted, if and where specified; and

-
- satisfactory operation and adjustment of:
 - meters;
 - flow controllers;
 - spill valves;
 - pressure controllers;
 - safety valves (if fitted);
 - safety shut-off valves (if fitted);
 - shut-off valves; or
 - safety devices, alarms and trips.

8.11.3 Filters

Initially on a new process control station due to high velocity test and purge flowrates during commissioning, any filters may receive a considerable amount of foreign matter from the pipeline and may choke rapidly.

During commissioning the filter differential pressure gauges should be monitored especially in the first phases of commissioning in order to detect when filter element changes are required. Such a monitoring exercise should also be carried out following maintenance/shut-down/modification.

8.12 Operation

Process control stations are normally automatic in operation once the controls have been set. The only manual operations required are:

- opening and closing of isolating valves to suit process and maintenance requirements;
- monitoring of gauges and other indicator displays to ensure the process control station or components are operating within limits;
- maintenance of a clean process control station area and particularly the exclusion of flammable products; and
- completion of items defined under the planned preventative maintenance system.

Personnel entrusted with the operation of the process control station shall have been trained in the operating techniques required, the potential hazards associated with oxygen, and in the emergency procedures.

9 Operation, monitoring, and maintenance

9.1 General safety instruction

- Before performing work on oxygen systems, a safety work permit should be issued. Guidance on work permit systems may be found in publications such as EIGA Doc 40 [48];
- Smoking is forbidden in stations and within a safety distance of 5 m (17 ft) (see also 8.6);
- Naked flames are prohibited in the safety zone (see also 8.6);
- Ensure that all traces of oil and grease are removed;
- Cap open pipes ends when not working on the pipe;
- Earthing of any equipment, such as welding equipment, onto oxygen piping systems while in oxygen service is not permitted;
- The cathodic safety equipment shall not be checked during storms when there is a high risk of lightning;

- Procedures should ensure that personnel do not remain in the area of oxygen stations during storms when there is a high risk of lightning; and
- As for other pipelines, provisory grounding is recommended during maintenance work (risk of alternating induced current created by a ground defect on a nearby electric power line).

9.1.1 Personnel for operation and maintenance

In addition to being trained in work safety knowledge, personnel who operate and maintain oxygen systems shall also have specific training and understanding of oxygen safety requirements. They shall be familiar with the location of the pipelines, the stations, and the control equipment. All the relevant operating and safety procedures shall be available to operations personnel.

Subcontractors' personnel shall be informed about and have access to all the relevant safety information.

Operations and maintenance personnel should work with clean hands, work clothing, and gloves that are free of lint, fibers, and uncontaminated by oil or grease.

9.1.2 Operating isolation valves

Whereas control valves may be designed for operation with large pressure differences, this may not be the case with conventional shut-off valves, which might not be designed for use in throttling mode. An isolation valve not fabricated from exempt materials may only be operated after minimizing the pressure differential by the use of a bypass valve or other specific procedures. Provisions shall be made for monitoring the pressure difference across isolation valves regardless as to whether they are locally or remotely controlled. An isolation valve can be used in throttling service provided it is manufactured from exempt materials. By previous definition, the valve then is defined as a process control valve.

9.1.3 Welding and cutting work

Any welding on in-service oxygen pipelines and piping could cause localized heating and/or adversely affect the integrity of the piping system and therefore shall be avoided.

The only exceptions are:

- drilling small openings in depressurized pipelines and piping during connection work; and
- welding on cathodic protection studs using a stud welding unit as explained below.

A process qualification shall be made beforehand in order to ensure that little or no heat is generated on the inside of the piping during the time the bolt is being welded on. This activity requires equipment and procedures specific to the work involved; it may only be carried out under the supervision of personnel trained in this process and relevant procedures. The process qualification shall verify that the pipe metallurgy and properties are not adversely affected by the process. Despite good experience with such technique, it is preferred that the process be carried out when the oxygen line is out of service.

9.1.4 Oxygen enrichment and deficiency

Work shall only be carried out in well-ventilated areas where normal ambient air is available.

The following limits should be adhered to:

- upper limit: 23.5% by vol (oxygen enrichment); and
- lower limit: 19% by vol (oxygen deprivation).

NOTE—In the United States, according to 29 CFR 1910.143, the lower limit is 19.5% by vol (oxygen deprivation) [49].

The ambient air shall be checked over a wide area around the place of work.

Particular care is required when working inside buildings, within walled areas, and in ditches. The risk is considerably reduced when working in the open.

Oxygen can collect or concentrate in low lying areas if its temperature is equal to or less than that of the surrounding air. The human senses cannot detect changes to the concentration of oxygen in the ambient air. Checking the oxygen concentration using naked flames is strictly forbidden. The oxygen concentration at the workplace and in the environment should be checked using equipment such as a portable oxygen analysis unit. These devices shall be checked and calibrated at regular intervals.

9.1.5 Shutdown/startup of pipelines and piping systems

Written procedures are required for shutdown/startup and maintenance of pipelines. The personnel involved in the work including contractors shall be informed of the specific risks related to oxygen and the tasks to be performed.

Authorization for these activities by a responsible person shall be given as follows:

- prior to starting maintenance work, after shut-off procedures are completed; and
- prior to repressurizing the pipe, when maintenance work is completed and cleanliness for oxygen service has been verified.

No repair work may be carried out on equipment and plant until the work area has been cordoned off. When carrying out maintenance on components during pipeline operations that does not require disconnection of the system, or activities involving no hot work, isolation by closing a single valve is acceptable provided the system can be depressurized satisfactorily. A check valve cannot be used as a shut-off mechanism for maintenance work.

A positive shutoff is required if major work such as cutting and welding is being carried out. This shutoff can be carried out by:

- complete disconnection of the section concerned from the pipeline system;
- installing blind flanges;
- closure and mechanical locking of two valves arranged in tandem with an open venting valve between them (if the valve has an electric drive, the power should also be disconnected): double block and bleed valve; and
- closing a valve and placing a sealing balloon (bubble) inside the pipe with an intermediate bleed valve is a procedure that may be used if there are no other possibilities.

Tags should be placed to indicate that the equipment has been locked in the shut-off position.

Continuous monitoring of the oxygen concentration shall be made.

After dismantling an item of equipment, the pipe opening should be sealed since leaks, chimney effects, air pressure changes, and heated gas can cause release of oxygen.

9.1.6 Venting and pressure relief

Venting:

- Large quantities of oxygen shall be vented to atmosphere, preferably outside buildings and enclosures, in a location where neither personnel nor vulnerable items of equipment are exposed to oxygen-enriched atmospheres;
- Compressors and vehicles with combustion engines operating in oxygen-enriched atmospheres are particularly dangerous;and
- Venting should not take place directly beneath high voltage overhead lines.

Pressure relieving:

- When the pressure is being relieved, an auxiliary valve in throttling mode may be installed downstream of the actual blow-out valve. The auxiliary valve protects the actual blow-out valve during the venting procedure and therefore guarantees its functionality (tightness). The auxiliary valve should be installed downstream of the blow-out valve and kept closed until the blow-out valve is fully open. Venting can then take place using the auxiliary valve.

9.1.7 Purging

Nitrogen or dry air, free of oil and grease, shall be used to purge oxygen from the pipeline. A purging program including all branches shall be followed in order to avoid leaving any oxygen pocket in the pipeline system.

When using nitrogen, it shall be ensured that unauthorized access to the outlet is prevented and that no one can be endangered by either oxygen-enriched or oxygen-deficient atmospheres.

Rooms, walled-in areas, or ditches can be aerated by extraction fans or supplied with fresh air.

9.1.8 Tools

Tools and accessories that are used (including, for example fasteners and connecting pieces) shall be clean and free of oil and grease.

9.2 Commissioning pipelines, piping, and stations

Supplier's and manufacturer's instructions for commissioning the equipment and plant shall be followed. After the successful completion of strength and tightness testing as per the applicable regulations and drying (if the pipeline has been subjected to a hydrostatic test), the pipeline can be put in service. If possible, new pipelines shall be blown through with a large quantity of dry oil-free nitrogen using as large an outlet as possible to remove dust from the pipeline (see also 6.3.8 and 6.4.5).

When commissioning starts, the system shall first be purged with oxygen so the air or nitrogen that is already in the pipe is removed. The purging process is carried out using throttling and bypass valves, if present (depending on the nominal diameter of the pipeline) via the last valve under pressure. The oxygen should be introduced in a specific direction in order to ensure oxygen purity.

The purity of the oxygen should be measured at all outlets using analysis equipment. If the purity is adequate at the outlet, the relevant valve can be closed.

When the system has been purged and all the purging points have been closed, the piping can be pressurized using a bypass, a throttling valve, or a control valve in order to slowly pressurize the pipe up to the operating pressure.

The flange connections should be checked for leaks at regular intervals during commissioning.

9.3 Operation and monitoring

Supplier's and manufacturer's instructions for the equipment and systems shall be followed. Pipeline and stations shall be kept in good working order from an operational and safety point of view.

The operator shall follow a preventive maintenance program including all safety and technical monitoring measures. A detailed description of the work to be carried out shall be laid down in work instructions.

An example of a preventive maintenance program can be seen in Appendix F, which illustrates the main tasks to be performed. The frequency at which inspections are performed will be dictated by national and/or established company practices.

9.4 Information to third parties, work adjacent to pipelines, and update of documents

9.4.1 General

The maintenance of pipelines does not concern just technical and operational considerations. Statistics from pipeline companies show that more than two accidents out of three occurring on underground pipelines are due to external events.

To protect pipelines and ensure the reliability of supply, it is necessary that third parties be informed of the location of the pipelines, any work adjacent to the pipelines, and information regarding the installation of new pipelines.

9.4.2 Flow of information

National regulations, when they exist, shall be followed.

These regulations usually require:

- that operators of underground structures (pipes, cables, etc.) submit a declaration to the local authorities concerned;
- that contractors performing earthworks in the area of underground structures inform the operators of those underground structures, about the nature of such work in the form of a declaration; and
- that operators respond to the contractors in a timely manner.

In the absence of national regulations, a similar plan for information flow should be adopted.

9.4.3 Summary of work

A summary of work carried out on pipelines or near pipelines and also of work not performed should be made by the pipeline operator.

When work is performed adjacent to pipelines, the summary should be formalized by the issue of a written document countersigned by the site manager.

9.4.4 Records

Records of the following should be made by the pipeline operator:

- requests from contractors;
- replies to those requests, with the transmitted documents; and
- work supervision documentation.

9.4.5 Updating of pipeline drawings

Updating of pipeline documents, in particular pipe installation drawings, should be carried out on existing pipelines to reflect deviations and modifications that occurred when work was performed.

9.5 Specialized surveys

In addition to the routine monitoring of the cathodic protection system potentials, a Close Interval Potential Survey (CIPS) should be performed at 5 year intervals, and implementation of an integrity management program on the pipeline should be performed in accordance with applicable regulations Problems with cathodic protection systems for the pipeline identified by annual surveys, close interval surveys, or other means, may be diagnosed using a variety of techniques, such as:

- close interval potential survey;

- alternating current voltage gradient (ACVG) survey or direct current voltage gradient (DCVG) survey;
- current attenuation survey / pipeline current mapping survey (PCM); and
- Pearson survey.

A full list of above ground survey techniques can be found in NACE SP 0502, *Standard Practice – Pipeline External Corrosion Direct Assessment Methodology* [50].

These indirect inspection techniques may be applied as an integral part of a pipeline integrity management program.

9.6 Damage to the pipeline system

9.6.1 Leakage

If a leakage of product from the pipeline is suspected and cannot be located through visual or audible evidence, the pipeline should be isolated in sections and pressure tested to identify the source of the leak or prove that the pipeline is sound.

9.6.2 Revalidation

Consideration should be given to revalidation (a detailed inspection including a pressure test) to establish the pipeline's suitability for continued service following a leakage, fire or other incident not attributable to third party interference, or a significant modification to the pipeline system.

10 General protective measures

10.1 Emergency response plan

An emergency procedure document is required to ensure that all operating staff and others who may be involved, including the public authorities, are adequately informed of the action to be taken in the event of an emergency. Procedures shall be developed to meet the particular needs of each individual pipeline system. National laws or regulations may dictate the form and content of such a procedure; however, the following subjects should be considered when compiling such procedures.

10.1.1 Liaison with public authorities and other consultees

The effective handling of a pipeline incident will often require the cooperation of public authorities (e.g., police, fire, public utilities, etc.). A list of emergency contacts should be established and copies of the relevant sections of the emergency procedure should be circulated to those authorities that may be involved.

10.1.2 Description of pipeline system

This should include all relevant technical data such as routing, length, diameter, pressure of the pipeline, location, and drawings of control stations including location of isolating valves.

10.1.3 Control centres

The role and location of the control centre for dealing with an emergency should be established, and communication media (e.g., telephone, radio, e-mail and/or facsimile) should be identified. Clear instructions for dealing with emergencies shall be established and formalized.

10.1.4 Notification of an incident

The incident may be detected by operators at a pipeline control centre or be notified by a third party through the observation of some abnormal condition on site. The control centre should be responsible for identifying the precise location of the incident, recording all details, and passing the information to the emergency response team without delay.

10.1.5 Alerting procedure

The control centre shall alert personnel on call. The emergency procedure should clearly identify the initial action to be taken by all personnel on receiving an emergency call. Any restrictions on entering land should be included. Provision shall be made for the mobilization of a responsible person at the site together with staff capable of assessing and dealing with the scale of the operation.

The alerting procedure should also include requirements to inform all concerned when normal conditions are restored.

10.1.6 Shutting down a pipeline

A clear procedure and understanding with the public authorities regarding the isolation and shut down of the pipeline in an emergency situation should be established. It is important that the pipeline control centre take charge of these events in the interests of the safety of all involved.

10.1.7 Emergency equipment

Equipment to deal with the emergency shall be kept in a state of readiness at an appropriate location.

Typical examples are transportation for equipment and manpower, effective communication system between control centre and the incident location, analysis equipment, fire extinguishers, protective clothing and safety devices, lighting sets and power supply, repair materials, and tools.

10.1.8 Remedial action

A detailed assessment of the action to be taken in dealing with the emergency can only be established following an initial assessment at the site.

However general guidelines on the approach to be taken should be indicated in the procedure (e.g., steps to be taken in dealing with a fire).

10.1.9 Pipelines with cathodic protection

If a pipeline has been severed, the cathodic protection system should be isolated and temporary bonds established if required.

10.1.10 Incident report form

Details of the incident should be compiled and recorded on the form required by the legislative requirements of the country concerned and/or the company reporting procedure.

10.1.11 Emergency exercises

To ensure that the emergency procedure adequately covers the requirements of the pipeline system for which it is drawn up, it is recommended that emergency exercises be carried out periodically.

10.2 Power supplies and lightning strikes

The power installation and lightning protection in the stations shall be installed in accordance with applicable standards and specifications such as NACE SP0177, *Mitigation of Alternating Current and Lightning Effects on Metallic Structures and Corrosion Control Systems* [51].

The pipeline may be affected by alternating current if it runs parallel to overhead high-voltage cables or direct current if adjacent to tram/railways. The induced effect of the alternating or direct currents on the relevant pipeline sections can be minimized by taking suitable measures such as splitting the pipeline into several sections using insulating flanges and active/passive earthing. For more information, refer to EN 50162 'Protection against Corrosion by Stray Current and CEN 15280 evaluation of AC corrosion likelihood [52, 53].

The cathodic protection should not be affected by these measures even for short periods.

Particular care shall be taken to protect installed electrical equipment from overloading. It is particularly important to consider the need for protection against short circuits and earth faults on overhead high voltage cables using direct current decoupling devices such as polarization cells.

10.3 Fire

The specific fire risks that can occur in oxygen systems are:

- Spontaneous combustion occurring inside the oxygen system, which can rapidly develop into a fire. Generally, this fire will self-extinguish after a few seconds, but the mass of oxygen released may create an oxygen-enriched atmosphere; and
- Combustion in oxygen-enriched air, which can be dealt with using conventional fire-fighting methods after the supply of oxygen has been cut off.

The only effective way of dealing with oxygen-fed fires is to isolate the supply of oxygen (see 10.6.3). Under oxygen-enriched conditions, appropriate firefighting media include; water, dry chemical (powder), or carbon dioxide. The selection needs to take into account the nature of the fire (e.g., electrical, etc.) Fires on persons or their clothing for example shall be extinguished by water as covering in a fire blanket will still allow oxygen-enriched clothing to burn.

Firefighting equipment should be properly installed and maintained. Operating personnel should know where it is located, how to operate it, and which equipment to use for which type of fire [54].

It is dangerous to enter an area with a high oxygen concentration in order to extinguish the fire or to help a person who is on fire since the rescuer's own clothing may also ignite.

If safety showers are available, the water supply shall be protected against the risk of freezing, where required.

Persons who have been in oxygen-enriched air shall not come into contact with ignition sources (cigarettes, welding torches, sparks, etc.) and immediately leave the area. These people shall undo or loosen their clothing and ventilate it for at least 15 min in order to remove the excess oxygen.

When a fire occurs, the following actions should be taken, although the order in which they are taken will need to be adapted to the situation:

- rapid risk assessment;
- warn personnel on site;
- leave the danger zone;
- bring the equipment into a safe condition (emergency shut-off, turn off using valves, etc.);
- notify the fire brigade and police if necessary;
- notify supervisors and the emergency crew;
- give first aid to injured persons; and
- block access to the area, including the surrounding roads that are affected.

10.4 Oxygen deprivation hazards and precautions

Persons exposed to oxygen-deficient atmospheres may immediately lose consciousness. Do not attempt to assist a person who is in an oxygen-deficient atmosphere without breathing or rescue equipment. Without such equipment the rescuer is exposed to the same hazard as the person in difficulty.

The rescuer shall wear a safety harness and line and be monitored by another person who is outside the danger zone.

The person who is suffering from oxygen deprivation shall immediately be given first aid such as artificial respiration or administration of oxygen until a doctor arrives.

10.5 Accident and damage report

If a pipeline accident occurs, a thorough investigation should take place. The report should contain an exact description on the conditions of the pipeline system during the last minutes before the accident; the material involved; and the consequences of the accident such as a secondary ignition, injury to people and damage to equipment or property.

The cause of the accident/damage should be determined and remedied. A typical method for investigating oxygen pipeline accidents is described in ASTM G145 [55].

10.6 Safety management system

Consideration should be given to establishing a specialized form of safety management system commonly referred to as a pipeline integrity management system (PIMS). Such a system enables formal control of key aspects of safety management to be established and demonstrated.

The system should provide detailed information specific to the particular pipeline, to cover the following subject headings.

10.6.1 Notification to authorities and consultation on routing

These are normally stipulated in the prevailing legislation and rules applying to the country in which the pipeline is to be installed.

10.6.2 Design and construction

Overall design and construction practice is dictated by the relevant design standards, codes of practice, and specifications acknowledged in the country concerned. In addition to these, industry and/or company standards and specifications that relate to the particular product to be transmitted are applied.

10.6.3 Shut-down systems

Shutdown may be manual or automatic. Shut-down devices (e.g., emergency shut-off valves) may be actuated by a leak detection system or by sensing high flow, low pressure, or rate of decay of system pressure.

10.6.4 Operations

A control strategy is devised to control the pipeline supply safely within the design envelope. Variables incorporated into the control strategy can include:

- Pressure: to ensure that the required delivery pressure from the pipeline is maintained. Protection against excess pressure is generally not an issue since pipelines are normally designed to withstand pressures in excess of the maximum that can be developed by the production unit. A suitable pressure

relief device may be required upstream of the pipeline to provide protection against overpressure beyond the design criteria;

- Temperature: to ensure that cryogenic liquids from the storage units do not enter the pipeline system.
- Flow: to match customer demand by product flow into the pipeline; and
- Product purity: to ensure any product that does not meet specification does not enter the pipeline system.

Any product disposal needed to maintain the required pipeline conditions is normally achieved through controlled venting on the production site.

10.6.5 Control of third party interference

Measures typically employed are:

- marker posts on the pipeline route;
- distribution of "as laid" drawings and information on the pipeline route to landowners, local authority planners, and other interested parties;
- similar information distributed to "one call" systems, a single point of contact where information on all pipelines and services can be obtained (where applicable); and
- regular patrols of the pipeline by foot or aerial survey to search for unauthorized interference (see also 10.6.10).

10.6.6 Maintenance and inspection

A disciplined planned preventative maintenance and defect rectification system (including routine patrols of the pipeline) is normally employed.

- Typical examples of the tasks included in such program are:
- routine testing of cathodic protection system;
- visual leak check on aboveground flanges;
- visual check for signs of unauthorized interference with the pipeline system;
- visual check for signs of land subsidence;
- visual check for any accidental damage to the system;
- visual check for any development activities in the vicinity of the pipeline; and
- check that all pipeline marking devices are in place.

10.6.7 Major accident prevention policies and safety management systems

A document detailing the organization and personnel, hazard identification and evaluation, operational control, management of change, planning for emergencies, monitoring performance, and audit/review may be prepared (dependent upon the perceived extent and nature of the major accident hazards presented by the pipeline and local regulations and practice).

10.6.8 Emergency planning

An emergency plan is prepared so any incident can receive effective response. This plan is specific to the parent site(s) and defines the roles of local personnel in an emergency situation. It also identifies any emergency contacts both internal and external to the operating company. The plan is structured to be locally self-sufficient.

Personnel who could be called on to deal with an incident shall receive training appropriate to their role in such an event. Any special protective clothing and equipment that might be required is kept readily accessible and is maintained in a fit condition for use.

10.6.9 Information to the public and interested parties

Pipeline plans and documentation shall be filed with the appropriate authorities and other parties who may have an interest in the pipeline (e.g., railway, mining authorities, road authorities, fire and police departments). Where appropriate, information is also provided to the public by means of marker posts along the route of the pipeline (see also 4.5).

10.6.10 Land use planning

The pipeline operator can exercise some control over the land area defined by his wayleave/easement agreement. Land outside the limits of this right of way is not however controlled by the pipeline operator. Such land may be controlled by the governing authority.

10.6.11 Accident reporting

Accident reporting is normally included in the legislative requirements of individual member states or local authorities.

Industry associations/reviews of accident causes and data are shared with member companies who also have their own internal safety reporting and management systems.

11 References

- [1] ASTM G124, *Test Method for Determining the Combustion Behavior of Engineering Materials in Oxygen-Enriched Atmospheres*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [2] ASTM G88, *Standard Guide for Designing Systems for Oxygen Service*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [3] ASTM G128, *Standard Guide for the Control of Hazards and Risks in Oxygen Systems*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [4] F. Heinrich Lienkamp: *Evaluation of the usefulness of security standards, selection and cleaning of materials, resources and appliances in oxygen technology for the application under high partial oxygen pressures*. 1. Auflage 1996.
- [5] ASTM STP 986, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 3rd Vol. (1988), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [6] ASTM STP 1197, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 6th Vol. (1993), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [7] ASTM G-125, *Standard Test Method for Measuring Liquid and Solid Material Fire Limits in Gaseous Oxidants*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [8] ASTM G94, *Standard Guide for Evaluating Metals for Oxygen Service*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [9] ASTM G63, *Standard Guide for Evaluating Materials for Oxygen Service*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [10] ASTM STP 1040, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 4th Vol. (1989), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [11] ASTM STP 1111, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 5th Vol. (1989), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

-
- [12] ASME Paper 93-WA /PID-3, Zawierucha, R., R.F. Drnevich, D.E. White, and K. Mclroy, "Materials and Systems Considerations for Applications Involving Oxygen-Enriched Atmospheres," ASME Winter Annual Meeting, New Orleans, LA, November 28-December 3, 1993 American Society of Mechanical Engineers, Three Park Ave., New York, NY 10016. www.asme.org
- [13] Mclroy, K., R. Zawierucha, and J.F. Million, "A Review of the Promoted Ignition/Combustion Behavior of Engineering Alloys," TMS 1994 Materials Week, Rosemont, Illinois, October 2-6, 1994.
- [14] ASTM STP 1267, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 7th Vol. (1995), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [15] Zawierucha, R., K. Mclroy, and J.F. Million, "Flammability of Selected Heat Resistant Alloys in Oxygen Gas Mixtures," Heat Resistant Materials II: Conference Proceedings of the 2nd International Conference on Heat Resistant Materials, September 11-14, 1995, pp. 97-104 Gatlinburg, TN, ASM International, 9639 Kinsman Road, Materials Park, OH 44073 www.asminternational.org.
- [16] ASTM STP 910, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 2nd Vol. (1986), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [17] ASTM G74, *Standard Test Method of Ignition Sensitivity of Materials to Gaseous Fluid Impact*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [18] ASTM G86, *Standard Test Method for Determining Ignition Sensitivity of Materials to Mechanical Impact in Pressurized Oxygen Environments*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [19] ASTM G72, *Standard Test Method for Autogenous Ignition Temperature of Liquids and Solids in High - Pressure Oxygen-Enriched Environment*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [20] ISO 11114-3, *Transportable Gas Cylinders - Compatibility of Cylinder and Valve Materials with Gas Contents—Part 3: Autogeneous Ignition Test in Oxygen Atmosphere*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com
- [21] ASTM G114, Standard practice for Aging Oxygen-Service Materials Prior to Flammability Testing, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [22] List of non-metallic materials compatible with oxygen by BAM Federal Institute for Materials Research and Testing (Leaflet M034-1 (BGI 617-1)). www.bam.de/en
- [23] ASTM STP 812, *Flammability and Sensitivity of Materials in Oxygen -Enriched Atmospheres*, 1st Vol. (1983), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [24] ASTM STP 1319, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 8th Vol. (1997), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [25] ASTM STP 1395, *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, 9th Vol. (2000), ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [26] ASTM Manual 36, *Standard Specification for Carbon Structural Steel*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [27] API STD 1104, *Welding of Pipelines and Related Facilities*, American Petroleum Institute, 1220 L St. NW, Washington, DC 20005. www.api.org
- [28] DIN 30670, *Polyethylene coatings of steel pipes and fittings; requirements and testing*, American National Standards Institute, 25 W. 43rd St., New York, NY 10036. www.ansi.org
- [29] DIN 30678, *Polypropylene coatings for steel pipes*, American National Standards Institute, 25 W. 43rd St., New York, NY 10036. www.ansi.org
- [30] AFNOR NF A49-710, *Steel tubes. External coating with three polyethylene based coating. Application through extrusion*, AFNOR, 11, St. Francis of Pressense 93571 La Plaine Saint-Denis Cedex. www.afnor.org

- [31] AFNOR NF A 49-711, Steel tubes. External coating with three polypropylene layers coating. Application by extrusion, AFNOR, 11, St. Francis of Pressense 93571 La Plaine Saint-Denis Cedex. www.afnor.org
- [32] NACE SP0169, *Control of External Corrosion on Underground or Submerged Metallic Piping Systems*, NACE International, 1440 South Creek Drive, Houston, TX 77084. www.nace.org
- [33] BS EN 12954, Cathodic protection of buried or immersed metallic structures. General principles and application for pipelines, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>
- [34] ASME Boiler & Pressure Vessel Code, Section VIII, American Society of Mechanical Engineers, Three Park Ave., New York, NY 10016. www.asme.org
- [35] IEC 61508, Functional Safety of Electrical/Electronic/Programmable Electronic Safety-Related Systems – ALL PARTS, International Electrotechnical Commission, 3, rue de Varembé, P.O. Box 131, CH-1211 Geneva 20, Switzerland. www.iec.ch
- [36] IEC61511, Function Safety – Safety Instrumented System for the Process Industry Sector – ALL PARTS, International Electrotechnical Commission, 3, rue de Varembé, P.O. Box 131, CH-1211 Geneva 20, Switzerland. www.iec.ch
- [37] IGC 10, *Reciprocating Compressors for Oxygen Service*, European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium. www.eiga.org. AIGA 048/08, *Reciprocating Compressors for Oxygen Service*
- [38] IGC 27, *Centrifugal Compressors for Oxygen Service*, European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium. www.eiga.org. AIGA 071/11, *Centrifugal Compressors for Oxygen Service*
- [39] CGA G-4.1, *Cleaning Equipment for Oxygen Service*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com
- [40] EIGA Doc 33/06, *Cleaning of Equipment for Oxygen Service*, European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium. www.eiga.org. AIGA 012/04, *Cleaning of Equipment for Oxygen Service*
- [41] BS EN 10208-2, *Steel pipes for pipelines for combustible fluids. Technical delivery conditions. Pipes of requirement class B*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>
- [42] API SPec 5L, *Specification for Line Pipe*, American Petroleum Institute, 1220 L St. NW, Washington, DC 20005. www.api.org
- [43] ISO 8501-1, *Preparation of Steel Substrates Before Application of Paints and Related Products–Part 1: Visual Assessment of Surface Cleanliness*, American National Standards Institute, 25 West 43rd St., New York, NY 10036. www.ansi.org
- [44] BS EN ISO 6505-1, *Metallic materials. Brinell hardness test. Test method*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>
- [45] ASTM G93, *Standard Practice for Cleaning Methods for Material and Equipment used in Oxygen-Enriched Environments*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org
- [46] ASME B31.3, *Process Piping*, American Society of Mechanical Engineers, Three Park Ave., New York, NY 10016. www.asme.org
- [47] BS 1306, *Specification for copper and copper alloy pressure piping systems*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>
- [48] EIGA Doc 40/02, *Work Permit Systems*, European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium. www.eiga.org. AIGA 011/04, *Work Permit Systems*

[49] *Code of Federal Regulations*, Title 29 (Labor), Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402. www.gpo.gov/fdsys

[50] ANSI/NACE SP0502, *Pipeline External Corrosion Direct Assessment Methodology*, NACE International, 1440 South Creek Drive, Houston, TX 77084. www.nace.org

[51] NACE SP0177, *Mitigation of Alternating Current and Lightning Effects on Metallic Structures and Corrosion Control Systems*, NACE International, 1440 South Creek Drive, Houston, TX 77084. www.nace.org

[52] BS EN 50162, *Protection against corrosion by stray current from direct current systems*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

[53] CEN/TS 15280, *Evaluation of A.C. Corrosion Likelihood of Buried Pipelines. Application to Cathodically Protected Pipelines*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

[54] IGC 04, *Fire Hazards of Oxygen and Oxygen-Enriched Atmospheres*, European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium. www.eiga.org . AIGA 005/10 *Fire Hazards of Oxygen and Oxygen Enriched Atmospheres*

[55] ASTM G145, *Guide for Studying Fire Incidents in Oxygen Systems*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

[56] BS EN 10027-2, *Designation systems for steels. Steel numbers*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

[57] ASTM DS56JOL, *Metal Alloys in the Unified Numbering System (UNS)*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

12 Additional references

ASTM G122, *Standard Test Method to Evaluate the Effectiveness of Cleaning Agents*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

ASTM G126, *Standard Terminology Relating to the Compatibility and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

ASTM G127, *Standard Guide for the Selection of Cleaning Agents for Oxygen Systems*, ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428. www.astm.org

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269. www.nfpa.org

NFPA 53, *Recommended Practice on Materials, Equipment and Systems used in Oxygen-Enriched Atmospheres*, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269. www.nfpa.org

CGA G-4, *Oxygen*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com

CGA G-4.3, *Commodity Specification for Oxygen*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com

CGA G-4.6, *Oxygen Compressor Installation and Operation Guide*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com

CGA P-8, *Safe Practices Guide for Air Separation Plants*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com

CGA G-10.1, *Commodity Specification for Nitrogen*, Compressed Gas Association, Inc, 14501 George Carter Way, Suite 103, Chantilly, VA 20151. www.cganet.com

EN 1797-1, *Cryogenic Vessels—Gas Material Compatibility—Part 1: Oxygen Compatibility*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

EN 12300, *Cryogenic Vessels—Cleanliness for Oxygen Service*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

ISO 13623, *Petroleum and Natural Gas Industries—Pipeline Transportation Systems*, American National Standards Institute, 25 West 43rd St., New York, NY 10036. www.ansi.org

ISO 13847, *Petroleum and Natural Gas Industries—Pipeline Transportation Systems—Welding of Pipelines*, American National Standards Institute, 25 West 43rd St., New York, NY 10036. www.ansi.org

ISO 7291, *Gas Welding Equipment—Pressure Regulators for Manifold Systems used in Welding, Cutting, and Allied Processes up to 300 bar*, American National Standards Institute, 25 West 43rd St., New York, NY 10036. www.ansi.org

ISO/15589-1, *Petroleum and natural gas industries -- Cathodic protection of pipeline transportation systems -- Part 1: On-land pipelines*, American National Standards Institute, 25 West 43rd St., New York, NY 10036. www.ansi.org

97/23/EC, Pressure Equipment Directive (PED), European Commission, http://ec.europa.eu/contact/index_en.htm

EN 13445, *Unfired Pressure Vessel*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

EN 13480, *Metallic Industrial Piping*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

ASME B31.8, *Gas Transmission and Distribution Piping Systems*, American Society of Mechanical Engineers, Three Park Ave., New York, NY 10016. www.asme.org

CSA Z 662-99, *Oil and Gas Pipeline Systems*; General Instruction N° 1-2, Canadian Standards Association, 5060 Spectrum Way, Mississauga, ON L4W 5N6, Canada. www.csa.ca

"Unfallverhütungsvorschrift Sauerstoff (BGV-Nr.7), 1997"

Arbeitsgemeinschaft Druckbehälter- Merkblätter (AD-Merkblätter)

TRFL, Technische Regel Fernleitungen

BS PD 8010-1, *Code of practice for pipelines. Steel pipelines on land*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

BS 7361, *Cathodic protection. Code of practice for land and marine applications*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

BS 4515 Part 1 and 2, *Specification for welding of steel pipelines on land and offshore*, British Standards Institution, 389 Chiswick High Rd., London W4 4AL, United Kingdom. <http://shop.bsigroup.com/>

NOTE—The following references encompass metals and non-metals flammability investigations and discuss systems operating in high pressure oxygen environments:

McIlroy, K., R. Zawierucha, and R.F. Drnevich, "Promoted Ignition Behavior of Engineering Alloys in High-Pressure Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: 3rd Volume, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 85-104.

Zawierucha, R. and K. McIlroy, "Promoted Ignition - Combustion Behavior of Selected Engineering Alloys in Oxygen Gas Mixtures," *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: 4th Volume, ASTM STP 1040, J.M. Stoltzfus, F.J. Benz, and J.S. Stradling, Eds., ASTM, West Conshohocken, PA, 1989, pp. 145-161.

McIlroy, K. and R. Zawierucha, "The Effects of Testing Methodology on the Promoted Ignition - Combustion Behavior of Carbon Steel and 316L Stainless Steel in Oxygen Gas Mixtures," *Symposium on Flammability*

and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 4th Volume, ASTM STP 1040, J.M. Stoltzfus, F.J. Benz, and J.S. Strading, Eds., ASTM, Philadelphia, 1989, pp. 38-53.

Zawierucha, R., K. Mclroy, and R.B.Mazzarella, "Promoted Ignition-Combustion Behavior of Selected Hastelloys® in Oxygen Gas Mixtures." *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 5th Volume*, ASTM STP 1111, Joel M. Stoltzfus and Kenneth Mclroy, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1991, pp. 270-287.

Mclroy, K. and R. Zawierucha, "Promoted Ignition-Combustion Behavior of Precipitation Hardened Engineering Alloys," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 5th Volume*, ASTM STP 1111, Joel M. Stoltzfus and Kenneth Mclroy, Eds. American Society for Testing and Materials, Philadelphia, 1991, pp. 288-297.

Mclroy, K. and R. Zawierucha, "Promoted Ignition-Combustion Behavior of Carbon Steel in Oxygen Gas Mixtures," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 6th Volume*, ASTM STP 1197, Dwight D. Janoff and Joel M. Stoltzfus, Eds. American Society for Testing and Materials, West Conshohocken, PA, 1993, pp. 87-111.

Werley, B.L., H. Barthélémy, R. Gates, J.W. Slusser, K.B. Wilson, and R. Zawierucha, "A Critical Review-Enriched of Flammability Data for Aluminium," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 6th Volume*, ASTM STP 1197, Dwight D. Janoff and Joel M. Stoltzfus, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1993 pp. 300-345.

Mclroy, K., R. Zawierucha, and J.F. Million, "A Review of the Promoted Ignition/Combustion Behavior of Engineering Alloys," TMS 1994 Materials Week, Rosemont, Illinois, October 2-6, 1994.

Zawierucha, R., K. Mclroy, and J.F. Million, "Promoted Ignition-Combustion Behavior of Light Metals in Oxygen-Enriched Atmospheres," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 7th Volume*, ASTM STP 1267, Dwight D. Janoff, William T. Royals and Mohan, V. Gunaji, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1995, pp. 69-80.

Zawierucha, R., K. Mclroy, and J.F. Million, "Flammability of Selected Heat Resistant Alloys in Oxygen Gas Mixtures," Heat Resistant Materials II: Conference Proceedings of the 2nd International Conference on Heat Resistant Materials, September 11-14, 1995, Gatlinburg, TN, ASM International, Materials Park, OH, pp. 97-104.

Mclroy, K., R. Zawierucha, and J.F. Million, "Promoted Ignition-Combustion Behavior of Alternative High Performance Engineering Alloys in Oxygen-Enriched Atmospheres," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 8th Volume*, ASTM STP 1319, W. T. Roayls, T.C. Chou, and T.A. Steinberg, Eds., American Society for Testing and Materials, 1997, pp. 157-169.

Zawierucha, R. and C.J. Henningson, "Materials Performance in Thermal EOR Environments," Paper 84-35-40 Presented at the 35th Annual Meeting of the Petroleum Society of CIM, Calgary, Alberta, 10-13 June 1984.

Zawierucha, R. and C.J. Henningson., "Materials Performance in Thermal Enhanced Oil Recovery Environments," *Journal of Canadian Petroleum Technology*, May-June 1985, pp. 75-79.

Zawierucha, R., R.F Drnevich, K. Mclroy, and P. Knecht, "Materials Compatibility and Systems Considerations in Thermal EOR Environments Containing High Pressure Oxygen," SPE./DOE Paper 14922, SPE, DOE Fifth Symposium on EOR, Tulsa, OK, April, 1986.

Zawierucha, R., R.F Drnevich, K. Mclroy, and P. Knecht, "Material Compatibility and Systems Considerations in Thermal EOR Environments Containing High Pressure Oxygen," *Journal of Petroleum Technology*, November, 1988, pp. 1471-1484.

Zawierucha, R., R.F. Drnevich, K Mclroy, and T.R. Schulte, "Utilization of High Pressure Oxygen in Enhanced Oil Recovery," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D.W. Schroll, Ed., American Society of Testing and Materials, Philadelphia, 1988, pp. 328-345.

Zawierucha, R. and J.F. Million, "Promoted Ignition-Combustion Behavior of Engineering Alloys at Elevated Temperatures and Pressures in Oxygen Gas Mixtures," *Flammability and Sensitivity of Materials in Oxygen-Enriched Environments: 9th Volume*, ASTM STP 1395, T.A. Steinberg, Harold D. Beeson and

Barry F. Newton, Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000, pp.119-133.

Williams, R.E., F.J. Benz, and K. McIlroy, "Ignition of Steel Alloys by Impact of Low-Velocity Iron/Inert Particles in Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 72-84.

Benning, M.A. and B.L. Werley, "The Flammability of Carbon Steel as Determined by Pressurized Oxygen Index Measurements," *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 910, American Society for Testing and Materials, Philadelphia, 1986, pp. 153-170.

Benz, F.J., R.C. Shaw, and J.M. Homa, "Burn Propagation Rates of Metals and Alloys in Gaseous Oxygen," *Symposium on Flammability and Sensitivity of Materials in Oxygen -Enriched Atmospheres*, ASTM STP 910, American Society for Testing and Materials, West Conshohocken, PA, 1986, pp. 135-152.

Benning, M.A., J.S. Zabrenski, and N.B. Le, "The Flammability of Aluminium Alloys and Aluminium Bronzes as Measured by Pressurized Oxygen Index," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 54-71.

Stolfus, J.M., J.M. Homa, R.E. Williams, and F.J. Benz, "ASTM Committee G-4 Metals Flammability Test Program: Data and Discussion," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 28-53.

Slusser, J.W. and K.A. Miller, "Selection of Metals for Gaseous Oxygen Service," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812, B.L. Werley, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 167-191.

Zabrenski, J.S., B.L. Werley, and J.W. Slusser, "Pressurized Flammability Limits of Metals," *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 4th Volume*, ASTM STP 1040, J.M. Stolfus, F.J. Benz and S.S. Stradling, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989 pp. 178-194.

Steinberg, T.A., M.A. Rucker, and H.D. Beeson, "Promoted Combustion of Nine Structural Metals in High Pressure Gaseous Oxygen: A Comparison of Ranking Methods," *Symposium on Flammability and Sensitivity in Oxygen-Enriched Atmospheres: 4th Volume* ASTM STP 1040, J.M. Stolfus, F.J. Benz and S.S. Stradling, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989 pp. 54-75.

Dieguez, J.M., L. Bothorel, A. de Lorenzo, and A. Faupin, "Ignition Testing of Hollow Vessels Pressurized With Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp.368-388.

Chou,T.F., N.O. Lemcoff, and R.L. Henningston, "A Promoted Ignition Test Apparatus for Evaluating the Flammability of Metallic Materials," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 9th Volume*, ASTM STP 1395, T.A. Steinberg, B.E. Newton and H. D. Beeson, Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000, pp.437-455.

F. Heinrich Lienkamp: Evaluation of the usefulness of security standards, selection and cleaning of materials, resources and appliances in oxygen technology for the application under high partial oxygen pressures.1. Auflage 1996

Wegener, W., C. Binder, P. Hengstenberg, K.P. Herrmann, and D. Weinert, "Test to Evaluate the Suitability of Materials for Oxygen Service," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, Philadelphia, 1988, pp 268-278

Daniel, J.A., R.C. Christianson, J.M. Stolfus, and M.A. Rucker, "A Hazards Analysis Method for Oxygen Systems Including Several Case Studies," *Flammability and Sensitivity of Materials in Oxygen-Enriched*

Atmospheres: 6th Volume, ASTM STP 1197, Dwight D. Janoff and Joel M. Stoltzfus, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1993, pp 360-372.

Ikeda, G.K. "Oxygen Index Tests to Evaluate the Suitability of a Given Material for Oxygen Service," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812, B. L. Werley, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1983, pp. 56-67.

Benning, M.A., "Measurement of Oxygen Index at Elevated Pressures," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812, B. L. Werley, Ed., American Society for Testing and Materials, 1983, pp. 68-83.

Lowrie, R., "Heat of Combustion and Oxygen Compatibility," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812, B. L. Werley, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1983, pp. 84-96.

Bryan, C.J. and R. Lowrie, "Comparative Results of Autogenous Ignition Temperature Measurements by ASTM G 72 and Pressurized Scanning Calorimetry in Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume*, ASTM STP 910, M. A. Benning, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1986, pp. 108-117.

Swindells, I., P.F. Nolan, and R.K. Wharton, "Spontaneous Ignition Temperatures of Non-metals in Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D. W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 279-285.

Wegener, W., C. Binder, P. Hengstenberg, K.P. Herrmann, and D. Weinert, "Tests to Evaluate the Suitability of Materials for Oxygen Service," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 268-278.

Wharton, R.K., "An Assessment of the Critical Oxygen Index Test as a Measure of Material Flammability," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP 986, D. W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1987, pp. 279-285.

Moffett, G.E., M.D. Pedley, N. Schmidt, R.E. Williams, D. Hirsch, and F.J. Benz, "Ignition of Non-metallic Materials by Impact of High-Pressure Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 3rd Volume*, ASTM STP, 986, D.W. Schroll, Ed., American Society for Testing and Materials, West Conshohocken, PA, 1988, pp. 218-232.

Lockhart, B.J., M.D. Hampton, C.J. Bryan, "The Oxygen Sensitivity/Compatibility Ranking of Several Materials by Different Test Methods," *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 4th Volume*, ASTM STP 1040, Joel M. Stoltzfus, Frank J. Benz, and Jack S. Stradling, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989, pp. 93-105.

Wharton, R.K., P.F. Nolan, and I. Swindells, "Further Studies of Factors that Affect the Spontaneous Ignition Temperatures of Non-metallic Materials in Gaseous Oxygen," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 4th Volume*, ASTM STP 1040, J. M. Stoltzfus, F.J. Benz, and J.S. Stradling, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989, pp. 106-124.

Currie, J.L., R.S. Irani, and J. Sanders, "The Ignition Behavior of Silicone Greases in Oxygen Atmospheres," *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres, 4th Volume*, ASTM STP 1040, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989, pp. 125-141.

Irani, R.S., J.L. Currie, and J. Sanders, "Evolving Non-Swelling Elastomers for High Pressure Oxygen Environments," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 4th Volume*, ASTM STP 1040, Joel M. Stoltzfus, Frank J. Benz, and Jack S. Stradling, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1989, pp. 309-331.

Hirsch, D.B., R.L. Bunker, and D. Janoff, "Effects of Oxygen Concentration Diluents, and Pressure on Ignition and Flame-Spread Rates of Non-metals," *Flammability and Sensitivity of Materials in Oxygen-*

Enriched Atmospheres: 5th Volume, ASTM STP 1111, Joel M. Stoltzfus and Kenneth McIlroy, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1991, pp. 179-190.

Vagnard, G., G. Delode, and H. Barthélémy, "Test Methods and Interpretation of Results for Selecting Non-Metallic Materials for Oxygen Service," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 5th Volume*, ASTM STP 1111, Joel M. Stoltzfus and Kenneth McIlroy, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1991, pp. 489-505.

Barthélémy, H., G. Delode, and G. Vagnard, "Ignition of Materials in Oxygen Atmospheres: Comparison of Different Testing Methods for Ranking Materials," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 5th Volume*, ASTM STP 1111, Joel M. Stoltzfus and Kenneth McIlroy Eds., American Society for Testing and Materials, West Conshohocken, PA, 1991, pp. 506-515.

Hirsch, D.B. and R.L. Bunker, "Effects of Diluents on Flammability of Non-metals in High-Pressure Oxygen Mixtures," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 6th Volume*, ASTM STP 1197, Dwight D. Janoff and Joel M. Stoltzfus, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1993, pp. 74-80.

Chou, T.C. and A. Fiedorowicz, "Oxygen Compatibility of Polymers Including TFE-Teflon®, Kel-F® 81, Vespel® SP-21, Viton® A, Viton® A-500, Fluorel®, Neoprene®, EPDM, Buna-N, and Nylon 6,6," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 8th Volume*, ASTM STP 1319, W.T. Royals, T.C. Chou, and T.A. Steinberg, Eds., American Society for Testing and Materials, West Conshohocken, PA, 1997, pp. 319-349.

D'Imperio, V.J. and B.L. Werley, "Oxygen Compatibility of FKM Elastomers," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Eighth Volume*, ASTM STP 1319, W. T. Royals, T. C. Chou, and T. A. Steinberg, Eds., American Society for Testing Materials, West Conshohocken, PA, 1997, pp., 350-358.

Waller, J.M., J.P. Haas, H.D. Beeson, "Polymer-Oxygen Compatibility Testing: Effect of Oxygen Aging on Ignition and Combustion Properties," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 9th Volume*, ASTM STP 1395, T.A. Steinberg, B.E. Newton, and H.D. Beeson, Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000, pp. 73-86.

Hirsch, D., C. Bryan, H. Barthélémy, T. Chou, and C. Binder, "An Analysis of Autoignition Temperature Round Robin Test Data," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: 9th Volume*, ASTM STP 1395, T.A. Steinberg, B. E. Newton, and H. D. Beeson, Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000, pp. 510-520.

Beeson, H.D., W.F. Stewart, and S.S. Woods, "Safe Use of Oxygen and Oxygen Systems," ASTM Manual Series MNL36, American Society of Testing and Materials, West Conshohocken, PA, 2000, pp.8-11, pp. 60-67.

Appendix A—Description of promoted ignition combustion test method (Informative)

1 Criteria

In this test method the test specimen is ignited in an oxygen atmosphere by a promoter, for more information see Section 12. The test specimen may be completely consumed in which case it is adjudged to be flammable. If combustion arrest occurs after a minimal burn, the result indicates that the specimen is not flammable. Various burn lengths between combustion arrest and complete consumption are indicative of transitory behaviour. Arbitrary burn length criteria may be established as being indicative of a burn. Selection of burn criteria requires an understanding of the promoted ignition-combustion transition curve and the safety design factors required. ASTM STP 1111 describes the promoted ignition-combustion transition curve in considerable detail [11]. A determination that the test alloy is not flammable is the basis for a determination that it is exempt from the velocity limitation. A flammable determination would require imposition of a velocity limitation.

2 Specimen configurations

The most common specimen in use in promoted ignition-combustion tests is the rod configuration with a nominal diameter of 3.2 mm (0.125 in) and length ranging between 10 cm and 15.3 cm (4 in and 6 in). However, in making flammability assessments, diameters greater or less than 3.2 mm (0.125 inch) may be utilized. Technical papers on promoted ignition-combustion testing that describe various test specimens are found in ASTM STP Series [23, 16, 5, 10, 11, 6, 14, 24, 25].

3 Promoter

Promoter selection may involve consideration of the type of contaminant most likely to be encountered in service. Iron wire, iron-hydrocarbon, aluminium, magnesium and pyrofuze® (aluminium-palladium composite wire) promoters have been utilized by various investigators. Previously cited references should be reviewed in this regard.

4 Oxygen purity

Oxygen atmospheres used in flammability tests can be chosen to suit potential applications. The bulk of published data involves standard purity 99.5+% oxygen. However, metals flammability data obtained with substantially lower oxygen purities exists. Premixed cylinder blends or point-of-use blends both have been utilized in flammability experiments. Previously cited references should be consulted on this test parameter.

5 Test vessels for promoted ignition-combustion testing

5.1 General

There are two types of vessels used in metals promoted ignition-combustion testing that may be referred to in the literature. One of these is the static or fixed volume tester. The other is the flow tester, which is also referred to as an oxygen-index (OI) apparatus. Descriptions of these testers are found in ASTM STP Series [5, 6, 10, 11, 13, 14, 15, 16, 23, 24, 25].

5.2 Static tester

Static testers have generated data over the 3.55 MPa to 34.5 MPa (500 psig to 5000 psig) range. One area of concern is that at lower pressure, the test atmosphere may be diluted by combustion products from the test procedure and false indications of non-flammability may be generated.

5.3 Flow Tester

The low pressure limitation of the static tester can be overcome by using a flow tester. Continuous flow of oxygen past the test specimen occurs, and results can be obtained at relatively low pressure. Contaminant buildup can be minimized using this approach.

5.4 Interpretation of results and design safety factors

If promoted ignition-combustion tests are conducted over a wide range of pressures, the data may take the form as shown in ASTM STP 1111 [11]. Three distinct zones may be observed: burn resistance (minimal specimen consumption), transition zone, and self-sustained burning (substantial to complete specimen consumption).

Design criteria by which a material is exempt from velocity limitation are based upon a burn length of 3 cm (1.2 in) or less, within which combustion is arrested . Exemption pressures in this publication based upon burn resistant behaviour are inherently conservative. The exemption pressure for stainless steel has been further reduced based on industry experience.

It is necessary to test at least three to five test specimens at each test pressure, use of smaller specimen numbers may be misleading particularly if combustion arrest occurs. ASTM STP 1040 is also of significance relative to ranking methods [10].

**Appendix B—Potential Ignition Mechanisms
(Informative)**

The following ignition mechanisms are known to be active in gaseous oxygen (GOX) piping system when the contributing factors are present.

IGNITION MECHANISMS	CONDITIONS	CONTRIBUTING FACTORS
Particle Impact	Particle(s) present Velocities greater than Figure 2 up to sonic Impact point Flammable targets related to operating conditions	Density, quantity, and composition of particles present Impact point in the flow path of the particle; ignition enhanced as angle approaches perpendicular High pressure drop
Adiabatic Compression	Rapid pressurization Exposed non-metal or contamination close to the end High pressure ratio	Quick-opening valve Volume of gas pressurized Function of final pressure, initial temperature, and pressure ratio (incl upstream pressure). Low AIT of nonmetals can lead to ignition at pressure greater than 10 barg
Promoted Ignition / Kindling Chain	Ignition mechanism present and active Flammable materials to kindle or propagate	Usually non-metals Ignition and combustion of a flammable material (e.g. contamination) igniting a less flammable material
Mechanical Friction	Two or more rubbing surfaces Relative motion Mechanical load Galling	High speed and/or high load on rubbing surfaces (usually leading to severe surface disruption) More severe with aluminium alloys High rotational velocity or high oscillation/vibration frequency under normal load
Mechanical Impact	Single or repeated impact loading Non-metal or metal at point of impact	Porous material (exposed to LOX in most cases) Quick closing valve Chattering check or relief valve
Thermal Ignition	External heat capable of heating a material to its AIT in a given environment A material with an AIT below the temperature created by the heat source in a given configuration and environment Flash point of the lubricant or other flammable contamination	Open flame Smoking Sparks Welding Thermal runaway Heat source Heat which is capable of auto-igniting a flammable material or a flammable gas mixture
Electrical Arcing	Electrical power source Arc with sufficient energy to melt or vaporize materials Flammable material exposed to ignition from arcing	Ungrounded or short-circuited powered components in the presence of oxygen (incl. electric motor, electrical control equipment, instrumentation, electrical cables, etc.) Lightning strike

Less common ignition mechanisms include resonance, static discharge, and flow friction. Some are currently not well understood.

Resonance occurs when there is a resonance cavity in the piping, when acoustic oscillations within a resonant cavity cause a rise in temperature (often audible), and when there is flammable particulate or debris in the resonant cavity. Short dead end tees may resonate when there is a high velocity flow in the other legs.

Static discharge occurs when there is an electrostatic charge accumulation, the discharge energy is sufficient for ignition, and there is flammable material exposed to discharge.

Flow friction is believed to exist when there is a leak or pressure differential, exposed non-metal is in the flow path, and pressure is greater than 30 bar.

For more information about these less common ignition sources, see ASTM G63, ASTM G88, and ASTM Manual 36 [9, 2, 26].

**Appendix C—Table of nominal alloy compositions and ranges
(Normative)**

Material type or alloy	EN-MAT. No.	UNS No.	Nominal composition range
Brass alloys 1)		2.0380	Various 55-85 Cu, 15-44 Zn, 1-3 (Sn, Pb, Fe)
Cobalt alloys			
Stellite 6	Stellit 6	R30006	55.5Co, 29 Cr, 4.5W, 3Ni, 1C, 7 (Fe, Si, Mn, Mo)
Stellite 6B	Stellit 6B	R30016	53Co, 30Cr, 4.5W, 3Ni, 1C, 8.5 (Fe, Si, Mn, Mo)
Copper	2.0090	C10100	99.9+Cu
Copper-nickel alloys	2.0882	C70600	67-87 Cu, 10-31 Ni, 1-2 (Fe, Mn, Zn)
Ferrous castings (non-stainless)			
Gray Cast Iron	0.6030	F12801	3C, 2Si, 0.8Mn, Bal. Fe
Nodular Cast Iron	0.7040	F32800	3.6C, 2.7Si, 0.4Mn, Bal. Fe
Ni Resist Type D2	0.7673	F43010	20Ni, 3C, 2Si, 2Cr, 1Mn, Bal. Fe
Ferrous castings, (stainless)			
CF-3 2)	1.4308	J92500	19.5Cr, 10Ni, 2Si, 1.5Mn, Bal. Fe
CF-8 2)	1.4308	J92600	19.5Cr, 10Ni, 2Si, 1.5Mn, Bal. Fe
CF-3M	1.4408	J92800	19Cr, 11Ni, 3Mo, 1.5Si, 1.5Mn, Bal. Fe
CF-8M 3)	1.4408	J92900	19Cr, 11Ni, 3Mo, 1.5Si, 1.5Mn, Bal. Fe
CG-8M 4)	1.4439	J93000	20Cr, 12Ni, 3Mo, 1.5Si, Bal. Fe
CN-7M 5)		N08007	21Cr, 29Ni, 4Cu, 3Mo, 1.5Si, 1.5Mn, Bal. Fe
Nickel alloys			
Monel 400	2.4360/2.4366	N04400	67Ni, 32Cu, 1Fe
Monel K-500	2.4375	N05500	66.5Ni, 30Cu, 3(Al, Ti)
Nickel 200	2.4060/2.4066	N02200	99.0 Ni min.
Hastelloy C-276	2.4819	N10276	56Ni, 16Cr, 16Mo, 4Fe, 3W, 2.5Co
Inconel 600	2.4816	N06600	76Ni, 15Cr, 9Fe
Inconel 625	2.4856	N06625	60Ni, 22Cr, 9Mo, 5Fe, 4Nb
Inconel X-750	2.4669	N07750	74Ni, 15.5Cr, 7Fe, 2.5Ti, 1Al
Stainless steels, wrought			
304	1.4301/1.4306	S30400	19Cr, 9Ni, 2Mn, 1Si, Bal. Fe
304L	1.4301/1.4306	S30403	19Cr, 9Ni, 2Mn, 1Si, Bal. Fe
316	1.4401/1.4404	S31600	17Cr, 12Ni, 2Mn, 3Mo, 1Si, Bal. Fe
316L	1.4401/1.4404	S31603	17Cr, 12Ni, 2Mn, 3Mo, 1Si, Bal. Fe
321	1.4541	S32100	18Cr, 11.5Ni, Ti 5XC min., Bal. Fe
347	1.4550	S34700	18Cr, 11.5Ni, Nb 8XC min., Bal. Fe
410	1.4006/1.4024	S41000	13Cr, 1Mn, 1Si, Bal. Fe
430	1.4016/1.4742	S43000	17Cr, 1Mn, 1Si, Bal. Fe
17-4PH 6)	1.4542/1.4548	S17400	17Cr, 4Ni, 4Cu, 1Si, Bal. Fe
X3 Ni Cr Mo 13-4	1.4313	S41500	13Cr, 4.5Ni, 1Mo, 1Si, Bal. Fe
Carpenter 20 Cb-3	2.4660	N08020	35Ni, 20Cr, 3.5Cu, 2.5Mo, Bal. Fe
Tin bronzes	2.1080	Various	85-89Cu, 5-11Sn, 5-10 (Zn, Pb, Ni)
1)	Aluminium brasses not included		NOTE: EN-MAT is EN 10027-2, <i>Designation systems for steels—Part 2, Numerical Systems</i> [56]. UNS No. is <i>Metal Alloys in the Unified Numbering System</i> , Ninth edition, ASTM [57]
2)	Cast analogs of 304L/304 stainless steel		
3)	Cast analogs of 316L/316 stainless steels		
4)	Cast analog of 317 stainless steel		
5)	Alloy 20		
6)	Age hardened condition		

**Appendix D—Table of exemption pressures and minimum thicknesses
(Normative)**

Engineering alloys	Minimum thickness	Exemption pressure
Brass Alloys 1)	None specified	20.68 MPa (3000 psig)
Cobalt alloys 2)		
Stellite 6	None specified	3.44 MPa (500 psig)
Stellite 6B	None specified	3.44 MPa (500 psig)
Copper ³⁾	None specified	20.68 MPa (3000 psig)
Copper- Nickel ALLOYS 1) 3)	None specified	20.68 MPa (3000 psig)
Ferrous castings, non-stainless		
Gray Cast Iron	3.18 mm (0.125 in)	0.17 MPa (25 psig)
Nodular Cast Iron	3.18 mm (0.125 in)	0.34 MPa (50 psig)
Ni Resist Type D2	3.18 mm (0.125 in)	2.07 MPa (300 psig)
Ferrous castings, stainless		
CF-3/CF-8,CF-3M/CF-8M,CG-8M	3.18 mm (0.125 in)	1.38 MPa (200 psig)
CF-3/CF-8,CF-3M/CF-8M,CG-8M	6.35 mm (0.250 in)	2.6 MPa (375 psig)
CN-7M	3.18 mm (0.125 in)	2.58 MPa (375 psig)
CN-7M	6.35 mm (0.25 in)	3.44 MPa (500 psig)
Nickel alloys 3)		
Hastelloy C-276	3.18mm (0.125 in)	8.61 MPa (1250 psig)
Inconel 600	3.18mm (0.125 in)	8.61 MPa (1250 psig)
Inconel 625	3.18 mm (0.125 in)	6.90 MPa (1000 psig)
Inconel X-750	3.18mm (0.125 in)	6.90 MPa (1000 psig)
Monel 400	0.762 mm (0.030 in)	20.68 MPa (3000 psig)
Monel K-500	0.762 mm (0.030 in)	20.68 MPa (3000 psig)
Nickel 200	None specified	20.68 MPa (3000 psig)
Stainless steels, wrought		
304/304L, 316/316L, 321, 347	3.18 mm (0.125 in)	1.38 MPa (200 psig)
304/304L, 316/316L, 321, 347	6.35 mm (0.250 in)	2.58 MPa (375) psig)
Carpenter 20 Cb-3	3.18 mm (0.125 in)	2.58 MPa (375 psig)
410	3.18 mm (0.125 in)	1.72 MPa (250 psig)
430	3.18 mm (0.125 in)	1.72 MPa (250 psig)
X3 NiCrMo 13-4	3.18 mm (0.125 in)	1.72 MPa (250 psig)
17-4PH (age hardened condition)	3.18 mm (0.125 in)	2.07 MPa (300 psig)
Tin bronzes	None Specified	20.68 MPa (3000 psig)

NOTE—This list does not include all possible exempt materials. Other materials may be added based on the results of testing as described in 4.2.1.

Note - These exemption pressures are applicable for temperatures up to 200 °C (392 °F).

Note - Exemption pressure is defined in Section 3.

1) Cast and wrought mill forms.

2) These cobalt alloys are commonly used for weld overlay applications for wear resistance. Use at exemption pressures above those specified in Appendix D should be justified by a risk assessment or further testing (as described in 4.2.1).

3) Nickel alloys have been used safely in some applications at thicknesses less than those shown in Appendix D. Use of thinner cross sections should be justified by a risk assessment or further testing (as described in 4.2.1).

**Appendix E—Table of minimum safety distances (without barriers) for oxygen control and isolating/metering stations
(Informative)**

Nature of exposure	Category 1 stations ³	Category 2 stations	Category 3 stations	Category 4 stations
Aboveground pipeline (flammable fluid) without close proximity of mechanical joints (see 8.6).	15m	6m	2m	2m
Buried tank (flammable fluid)	5m	2m	2m	2m
Pressure vessel (non-flammable fluid) with $P \cdot V > 200$ bar m ³ water capacity ($P \cdot V > 100\,000$ psi ft ³)	5m	3m	3m	2m
Flammable product storage	8m	5m	2m	2m
Liquid hydrogen storage	15m	15m	15m	15m
Transformer station	15m	6m	3m	2m
Administrative building with openings or air conditioning intake owned by customer	10m	8m	8m	2m
Public building	15m	10m	10m	2m
Public road/railway/car park	15m	10m	6m	2m
Internal road/ railway	3m	3m	3m	2m
High tension electric cable (aboveground)	10m	6m	5m	2m
Boundary of user's property	15m	10m	2m	2m
Internal car park	15m	6m	2m	2m
Flame and/or spark producing activities. For smoking restrictions (see 8.6).	15m	8m	3m	2m
<p>NOTES</p> <p>1 Category 1 Stations: $P \cdot D^2 > 3000$, $P > 4$ bars, $D > 2.5$ cm. Category 2 Stations: $P \cdot D^2 < 3000 > 1500$, $P > 4$ bars, $D > 2.5$ cm. Category 3 Stations: $P \cdot D^2 < 1500$, $P > 4$ bars, $D > 2.5$ cm. Category 4 Stations: Isolating and/or metering purposes only.</p> <p>2 Oxygen stations should not be beneath high-tension cables without protection.</p> <p>3 <u>For PD^2 above 3000, a specific risk assessment should be performed to determine if safety distances greater than listed in Appendix E are necessary.</u></p>				

**Appendix F—Example of preventive maintenance programme
(Normative)**

NOTE—Intervals shown are only examples and do not reflect required or universal practice.

a. Pipeline systems

Flyover ¹⁾		Checking interval						When required
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	
	Underground pipelines		X					
	Overground pipelines		X					
On-foot inspection								
	Underground pipelines	X ²⁾			X			
	Overground pipelines	X ²⁾			X			
	Leak test							X
	Inner pipeline inspection							X
	Effect of mining (subsidence)							X

¹⁾ Flyover are used for long pipelines.
²⁾ If there are no flyovers.

b. Slide valve shafts and stations

On-foot inspection		Checking interval						When required
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	
	General condition				X			
	Pipeline condition		X					
	Supports				X			
	Leak check (audible)		X					
	Leak check (brushing test)				X			
	Internal filter inspection					X		

c. Anticorrosion systems

Checking		Checking interval						When required
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	
	Operating status				X			
	Measurement/readout (stray current)	X						
	Measurement/readout (parasitic current)		X					
	Adjust protection system				X			
	Remote transmission/alarm							X
	Electrical isolation (isolating flange)				X			
	Electrical isolation (tubular jacket)						X	
	Pipe/ground potential, on/off						X	
	Pipe/ground potential, on				X			
	CIPS							X (5 years)

d. Safety equipment in the production areas

Equipment checking for preventing unacceptable pressures								
		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Limit value marking				X			
	Accuracy and limit monitoring				X			
	Alarms and switching sequences				X			
Equipment checking for preventing unacceptable temperatures								
		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Limit value marking				X			
	Accuracy and limit monitoring				X			
	Alarms and switching sequences				X			
Equipment checking								
		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Restrict quantity of escaping gas		X					

e. Checking for station safety equipment

		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Safety shut-off valves, shut-off valves				X			
	Safety valves						X	
	Restrict quantity of escaping gas		X					
	Gas removal sensors (ambient air)		X					
	Roof and radial ventilators				X			
Checking of other equipment		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	External medium-controlled slide valves				X			
	Manually operated valves				X			
	Display instruments					X		
Checking of electrical lightning protection earthing systems		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Local systems and operating equipment					X		
	Emergency power supply				X			
	Lightning protection and earthing						X	

f. Safety equipment at the operating control point

Equipment checking for		Checking interval						
		1 Month	1/4 Year	1/2 Year	1 Year	2 Year	3 Year	When required
	Detecting losses				X			