



SAFE DESIGN AND OPERATION OF CRYOGENIC ENCLOSURES

AIGA 079/23

Revision of AIGA 079/18

Asia Industrial Gases Association

N0 2 Venture Drive, #22-28 Vision Exchange, Singapore 608526

Tel: +65 67055642 Fax: +65 68633379

Internet: <http://www.asiaiga.org> | LinkedIn Profile: <https://www.linkedin.com/company/asiaigaorg>



SAFE DESIGN AND OPERATION OF CRYOGENIC ENCLOSURES

As part of a program of harmonisation of industry standards, the Asia Industrial Gases Association (AIGA) has published AIGA 079, "*Safe Design and Operation of Cryogenic Enclosures*", jointly produced by members of the International Harmonization Council and originally published by the European Industrial Gases Association (EIGA) Doc 170, "*Safe Design and Operation of Cryogenic Enclosures*".

This publication is intended as an international harmonised publication for the worldwide use and application by all members of the International Harmonisation Council whose members include the Asia Industrial Gases Association (AIGA), Compressed Gas Association (CGA), European Industrial Gases Association (EIGA), and Japan Industrial and Medical Gases Association (JIMGA). Each association's technical content is identical, except for regional regulatory requirements and minor changes in formatting and spelling.

Disclaimer

All publications of AIGA or bearing AIGA's name contain information, including Codes of Practice, safety procedures and other technical information that were obtained from sources believed by AIGA to be reliable and/ or based on technical information and experience currently available from members of AIGA and others at the date of the publication. As such, we do not make any representation or warranty nor accept any liability as to the accuracy, completeness or correctness of the information contained in these publications.

While AIGA recommends that its members refer to or use its publications, such reference to or use thereof by its members or third parties is purely voluntary and not binding.

AIGA or its members make no guarantee of the results and assume no liability or responsibility in connection with the reference to or use of information or suggestions contained in AIGA's publications.

AIGA has no control whatsoever as regards, performance or non-performance, misinterpretation, proper or improper use of any information or suggestions contained in AIGA's publications by any person or entity (including AIGA members) and AIGA expressly disclaims any liability in connection thereto.

AIGA's publications are subject to periodic review and users are cautioned to obtain the latest edition.

Table of Contents

1	Introduction	1
2	Scope and purpose.....	1
3	Definitions	1
3.1	Publication terminology.....	1
3.2	Technical definitions	2
4	Design considerations	3
4.1	Types of insulation.....	3
4.2	Enclosure casing	4
4.3	Piping design.....	5
4.4	Enclosure materials of construction.....	6
4.5	Load calculation.....	7
4.6	Structure beams and process equipment support.....	7
4.7	Foundations.....	7
4.8	Enclosure bottom.....	8
4.9	Maintenance facilities	9
4.10	Protection of small bore lines.....	9
4.11	Protection from cryogenic embrittlement.....	9
4.12	General design considerations for equipment aging.....	9
4.13	Special considerations for flammable and toxic fluids.....	9
5	Construction	10
6	Operation of cryogenic enclosures	12
6.1	Purge gas – Air separation unit processes	12
6.2	Purge gas – Processes with flammable or toxic gases	14
6.3	Maintenance.....	16
7	Enclosure hazards.....	16
7.1	General hazards.....	16
7.2	Overpressure.....	17
7.3	Unsafe compositions	19
7.4	Cold temperatures.....	20
7.5	Equipment erosion.....	20
7.6	Feedstocks containing oxides of nitrogen.....	21
8	Troubleshooting.....	21
8.1	Process leaks and detection	23
8.2	Ice on enclosure external surfaces and piping.....	25
8.3	Purge gas sampling.....	26
8.4	Purge gas flow and pressure changes	26
8.5	Operating with process leaks	26
8.6	Emergency condition guidance	27
9	Changes, modifications, and repairs to cryogenic enclosures.....	28
9.1	Management of change	28
9.2	Structural members and panels	28
9.3	Insulation removal	29
9.4	Confined space entry.....	29
9.5	Equipment isolation	29
9.6	Perlite removal from piping and process equipment	29
9.7	Piping and equipment.....	30
10	Training.....	30
11	Quality assurance	30
12	References	31

Appendix A – Cryogenic coldbox located pressure equipment (Informative)	33
Table 1 – Enclosure upset scenarios symptoms and consequences	21
Table 2 – Example of a coldbox located pressure equipment annual inspection checklist.....	33
Table 3 – Example of a coldbox located pressure equipment inspection checklist	36
Figure 1 – Casing pressure versus time	18

Amendments from 079/18

Section	Change
	Editorial to align style with IHC associations

Note Technical changes from the previous edition are underlined

1 Introduction

Cryogenic processes often operate inside enclosures that insulate the process equipment and interconnecting piping from ambient air and temperature. This prevents many problems, including excessive heat leak into the process and water freezing around the equipment. In many cases, the enclosure is purged with a dry gas to prevent ambient air from entering the enclosure and creating hazardous mixtures.

2 Scope and purpose

Cryogenic enclosures can create potential process safety hazards. This publication identifies general hazards and provides guidance to reduce their frequency and consequences. It provides safety guidance and addresses design and operating practices only as they affect safety.

This publication addresses both cryogenic air separation unit (ASU) and hydrogen / carbon monoxide (HYCO) processes. A number of existing publications cover special requirements of these processes and their equipment [1, 2, 3, 4].¹

This publication is primarily to document current practices and is intended to apply to new facilities. It is recognised that some existing plants may not meet all recommendations or requirements from this publication. This publication is not intended to be applied retroactively, including where this publication uses the word “shall”.

This publication does not cover the following:

- generally accepted engineering practices for structures and process equipment. Only those issues that are specific to cryogenic enclosures are included;
- enclosures for processes producing liquid hydrogen or helium. The extreme cold temperatures of these processes require specialised knowledge and practices that are beyond the scope of this publication; and
- external structures on / attached to the cryogenic enclosure for example, platforms, ladders, vents, lightning arrestors, etc. For more information on the safe location of oxygen and nitrogen vents relative to the location of platforms and ladders, see AIGA 067, *Safe Location of Oxygen and Inert Gas Vents* [5].

3 Definitions

For the purpose of this publication, the following definitions apply.

3.1 Publication terminology

3.1.1 Shall

Indicates that the procedure is mandatory. It is used wherever the criterion for conformance to specific recommendations allows no deviation.

3.1.2 Should

Indicates that a procedure is recommended.

3.1.3 May

Indicates that the procedure is optional.

¹ References are shown by bracketed numbers and are listed in order of appearance in the reference section.

3.1.4 Will

Is used only to indicate the future, not a degree of requirement.

3.1.5 Can

Indicates a possibility or ability.

3.2 Technical definitions

3.2.1 Air separation unit

Separates air into its components. An ASU is assumed to operate at cryogenic temperatures.

3.2.2 Coldbox and cylindrical enclosure

Enclosure containing insulation that separates a cryogenic process from the surrounding environment. The terms coldbox or box are often used to refer to an enclosure with a rectangular cross section, and the term cylindrical enclosure to refer to an enclosure with a cylindrical cross section. However, the term coldbox is sometimes used to refer to all enclosures, regardless of cross section shape.

3.2.3 Cryogenic

Temperatures less than approximately $-90\text{ }^{\circ}\text{C}$ ($-130\text{ }^{\circ}\text{F}$) [6].

NOTE Cryogenic processes require insulation to reduce heat transfer from the surrounding environment.

3.2.4 Derime

Periodic preventive maintenance procedure where the process equipment is warmed up while simultaneously being swept with clean dry gas to remove any accumulated moisture, carbon dioxide, and atmospheric impurities.

NOTE Also known as defrosting, de-icing, and thawing.

3.2.5 Enclosure

Structure that retains the insulation and surrounds the equipment.

NOTE Cryogenic processes are often insulated by placing the cryogenic equipment and piping in one or more enclosures that are filled with insulation.

3.2.6 HYCO

Processes that cryogenically process gaseous mixtures containing hydrogen (H_2) and / or carbon monoxide (CO).

3.2.7 Perlite eruption

Rapid, uncontrolled displacement of perlite within the insulation space that can result in a violent perlite release. It is commonly caused by the rapid vaporisation of pooled cryogenic liquid in the perlite that has suddenly been warmed, moved, or physically disturbed.

3.2.8 Perlite release

Uncontrolled spillage of perlite to the environment.

4 Design considerations

The cryogenic enclosure shall be designed and constructed in accordance with the applicable national and local building code including seismic and wind loads for the installation location. If there is no national or local building code, an internationally accepted building code shall be applied by the manufacturer.

4.1 Types of insulation

The enclosure has one or more types of insulation to reduce heat leak into the process piping and equipment. The most common insulation methods used are perlite, mineral wool, and vacuum.

4.1.1 Perlite

Perlite is an inert volcanic glass that forms an odourless, non-flammable, non-toxic lightweight powder aggregate when expanded by heat. It is a highly effective insulating material used to reduce refrigeration losses or heat leak into the cryogenic enclosure.

CAUTION: *Since it is a lightweight powder, it can become an asphyxiation hazard if inhaled or if a person becomes submerged in perlite, which can result in death or serious injury.*

4.1.2 Mineral wool

Mineral wool is a wool-like inorganic material produced by blowing steam or air through molten slag or rock. Mineral wool shall be non-combustible and contain less than 0.5% by weight of organic material [7]. Industry experience has shown that this level of organic material is operationally acceptable. One test for combustibility of materials is addressed in ISO 1182, *Reaction to fire tests for products-Non-combustibility test*, which may be used to test for organic materials [8].

Mineral wool should have a pH between 6 and 9.5. If the pH is outside of this range and the mineral wool becomes wet, it becomes corrosive to piping and equipment.

4.1.3 Vacuum

With vacuum insulation, the item to be insulated is placed within some type of enclosure. A vacuum is pulled on the annular space between the item and the enclosure, which reduces heat transfer by convection. The heat leak can be further reduced by placing insulation (typically perlite, metal foils, or other super insulation) within the space to further reduce heat leak through conduction or radiation.

Vacuum insulation provides more resistance to heat leak than mineral wool or perlite. Vacuum insulation may be considered, particularly for small coldboxes or piping. Such insulation leads to a better insulation and more compact enclosures, which are convenient for transport and on-site erection.

With vacuum insulation, no nitrogen purge is needed. For enclosures with vacuum insulation, the vessel walls shall be designed to withstand full vacuum conditions. Helium leak tests are generally required during assembly to detect small leaks.

If the filling of insulating material (for example, perlite) is performed by vacuum suction, precautions shall be taken to avoid damaging piping lines or connections in the annular space, for example, controlling the rate of filling, reinforcing the supports of small lines or connections.

Vacuum gauge or fittings should be installed to verify the vacuum level within the annular space, which will allow the insulating properties to be confirmed during operation.

Relief devices (rupture disks and / or lift plates that can be maintained by vacuum suction) shall be installed to protect the annular space against overpressure. When an insulation barrier is placed upstream of the relieving device, it shall be designed not to restrict the relieving capacity.

Getters or adsorbents may be used in the annular space to trap various gases, which can be released in the annular space. Because oxygen can enter the annular space inadvertently (for example, leaks

from ambient air), the compatibility of these getters or adsorbents with oxygen shall be considered [9, 6].

Superinsulation typically consists of thin metal foils to reduce radiant heat transfer. The thin metals can be combustible in oxygen. A risk assessment shall be performed when using super insulation.

4.2 Enclosure casing

The enclosure casing is typically made from carbon steel plates. The plates can be bolted or welded together to enclose the insulation. The plates can then be attached to a frame or support structure, or the plates can be self-supporting. Damage to the enclosure beam structure could damage equipment or reduce the support to process equipment and piping.

The enclosure cross section can be rectangular or cylindrical. The enclosure can be over-pressurised in case of leaks or higher purge gas pressure (see 7.2).

4.2.1 Cylindrical enclosures

Cylindrical enclosures surround the cryogenic equipment and piping. Equipment is typically not supported from the enclosure structure; rather it is supported with a separate support system.

If a cylindrical enclosure is pressurised to the point of failure, the pressure-volume (PV) energy will likely be significantly larger than a similarly sized rectangular enclosure. This is particularly true if the enclosure is designed for vacuum insulation. The possibility of higher stored PV energy shall be considered in the design of cylindrical enclosures (see 7.2).

4.2.2 Rectangular enclosures

Rectangular enclosures have a structural skeleton of beams, and some or all equipment and piping are supported from these beams. Metal plates are attached to structural frame. The plates can be attached to the frame on either the inside (towards the insulation) or the outside (towards the ambient).

Rectangular enclosures can contain less pressure before failure. Damage to the enclosure beam structure could damage equipment or reduce the support to process equipment and piping.

4.2.3 Perlite filling / removal nozzles

Perlite filling / removal nozzles should be located to allow safe access for adding and removing perlite. Nozzles may be added to the coldbox at multiple levels including the roof. It is recommended to locate removal nozzle(s) at the platform levels for access. The distance between nozzles is typically 10 m to 12 m (32 ft to 39 ft). Details of perlite filling and removal procedures are given in AIGA 032, *Perlite Management* [10].

4.2.4 Enclosures with multiple sections

Enclosures may have multiple sections depending on process and equipment layout. Design consideration should be given to installation of isolation barriers between enclosure sections that would prevent perlite from flowing from one section to another. Isolation barriers reduce the possibility of perlite bridging that can lead to collapse when removing perlite from adjacent sections. Isolation barriers should allow for purge gas flow. See 6.1.3.

4.2.5 Overpressure protection

The cryogenic enclosure shall be equipped with overpressure protection device(s). The number, size, and location of the overpressure protection device(s) shall take into account, at a minimum, the dimensions of the cryogenic enclosure, the presence of internal partitions, and / or potential leak points such as flange connections (see 7.2). When an insulation barrier is placed upstream of the relieving device, it shall be designed not to restrict the relieving capacity.

4.3 Piping design

Piping shall be designed and manufactured to a recognised piping code such as American Society of Mechanical Engineers (ASME) B31.3, *Process Piping* that takes into account temperature, pressure, fluid, and service conditions to which the piping will be operated [11].

Piping and vessels shall be protected by overpressure relief devices in accordance with the applicable code.

Leaks from process equipment and piping, whether large or small, can overpressure the enclosure and / or create hazardous atmospheres. Therefore, design and construction methods shall be used to reduce the probability of leaks.

Piping within the perlite insulation space should have welded joints because these joints significantly reduce the possibility of leaks. Butt welds are preferred as these joints can have improved non-destructive testing (NDT) such as full radiographic examination. Mechanical joints (such as bolted flanges or threaded connections) shall be avoided, where feasible. Where mechanical joints are used, a blanket or stuffing box of mineral wool shall be used to isolate a potential mechanical joint leak. Cryogenic pump and turbine boxes that are segregated from the main cryogenic enclosure may be insulated with perlite without blankets or stuffing boxes on mechanical joints, if the consequences from a leak are assessed to be low. The mineral wool stuffing box prevents a leak from causing perlite erosion of the equipment (see 7.5) and also allows for easier maintenance. These isolated small enclosures should have their base or floor sloped above perlite's angle of repose. This ensures that perlite will naturally fill underneath and around these enclosures and insulate the enclosures [10].

All process pipes and utility lines, shall be designed so that the thermal and mechanical stresses are less than the maximum allowable for the design life of the plant, which minimises the risk of line failure. Taking into account the piping support system including pipe penetrations, stresses shall be considered for the following:

- nozzles;
- transition joints;
- process bellows, flexible joints, or braided hose;
- valve or other piping equipment weaker than connected pipes, and
- flanges.

All instrument tubing shall be installed so that the thermal and mechanical stresses are acceptable for the design life of the plant.

All operating modes shall be considered in the design, including:

- expected number of cooldown and warm-up cycles, such as start-up with or without liquid injection, shutdown and deriming for the design life of the enclosure;
- relative movement of small bore lines attached to larger bore lines during cooldown, warm up, and thaw cycles, which can cause high stresses leading to failure; and
- piping that cycles as part of normal operation such as piping for cryogenic adsorbers.

Dead-ended, non-flowing piping requires seal loops to prevent cryogenic liquids from flowing by gravity towards the enclosure surface. Seal loops should be routed to provide adequate vaporisation of cryogenic liquid to form a vapour lock. Omitting the seal loops will result in excessive process heat leak, boiling of the cryogenic liquid, and potential accumulation of unsafe mixtures. This excessive heat leak can result in ice forming on the enclosure surface (see 8.2). Some examples of this piping are drains from cryogenic equipment and the high pressure side of liquid level taps [2].

Other piping design items that shall be considered are:

- protection of small bore lines (see 4.10);
- free movement of tubing within pipe supports;
- piping loads from perlite insulation;
- supporting process piping that operates with two phase flow during any mode of operation to prevent excessive vibration from causing cyclic fatigue cracking;
- design and selection of specialised joints used to join dissimilar metals such as those utilising explosion-bonded material; and
- if the piping can be exposed to oxygen-enriched fluids, it shall be designed for oxygen service [4, 5, 12].

4.4 Enclosure materials of construction

Structural elements shall be manufactured from materials compatible with the temperature that they are exposed to during normal operations. See 4.6. Due to low temperature embrittlement, the temperature rating of the specific carbon steel grade used shall be confirmed for the normal operating temperature.

Bolted panels on the cryogenic enclosure shall be sealed using a gasket, mastic, or other sealant to prevent water from entering the enclosure.

When constructing the enclosure, materials such as valve boots, wiring insulation, and sealants that are not oxygen compatible may be used in small amounts.

Enclosures surfaces shall be protected from corrosion due to atmospheric conditions. Areas that are particularly susceptible to atmospheric corrosion are:

- flat horizontal sections such as roofs or the top of horizontal ducts; and
- areas where the enclosure surface can have water trapped against it such as the contact zone between plates and external beams.

Corrosion can eventually lead to a breach in the enclosure surface, potentially causing three problems:

- Moisture / rainwater can enter the enclosure, which will reduce insulation effectiveness and create ice. The ice can restrict the movement of piping or equipment as the process cools down or warms up. Restricting the movement can damage the piping or equipment, in turn leading to process leaks;
- Release of purge gas; and
- Release of perlite.

Corrosion protection can be provided by painting, other surface treatment, or material selection. Corrosion protection is usually only provided on the external enclosure surface. Internal corrosion protection is typically not needed because the enclosure is purged with dry nitrogen. Internal corrosion protection is only used if extensive corrosion is anticipated during construction.

Elastomer sealants and metal bolts shall be appropriate for the expected atmospheric corrosion environment to which they will be exposed. This design precaution will avoid a possible breach in the enclosure from a corrosion failure.

Top horizontal plates (such as the roof) shall be designed to provide natural drainage of rainwater. A welded roof provides the maximum protection from rainwater ingress or ice damage. Any penetrations,

access panels, or elastomeric boots can be prone to water leakage. These shall be designed and maintained to prevent water ingress.

The enclosure shall be periodically inspected and maintained. Particular care should be taken in case the coldbox is located in areas with potentially corrosive atmospheres such as a heavy industrial area or in the proximity to the sea.

4.5 Load calculation

The design of the enclosure shall consider the expected loads imposed during the life of the enclosure. These include, but are not limited to, the following:

- Transportation (if any), which can include road, rail, and ship;
- Lifting (if any);
- Erection;
- Fluid pressure from the purge gas or fluidised perlite (see 7.2);
- Different operating modes, both warm and cold. Both shall include the cases with and without process fluid, and also if the system is pressurised or not. Any transient modes shall also be considered (see 4.3);
- Perlite load on piping, equipment, enclosure and foundations, and
- Environmental conditions on-site such as snow, wind, and earthquakes.

4.6 Structure beams and process equipment support

The main part of the support structure is usually constructed of carbon steel. However, portions of the support structure can become colder than the embrittlement temperature of carbon steel. These supports shall be made of materials compatible for the anticipated temperatures.

Consideration shall be given to reducing cold conduction between the cryogenic and non-cryogenic portions of the enclosure, particularly through the equipment support structures. This may require placing distance between the process pipes or equipment, coldbox structure members, and / or the enclosures surfaces to prevent cold migration.

Structural members in the cold zone of the enclosure will contract if they become cold. The loads that this contraction imposes on the outer structure and plates shall be considered in the enclosure design.

Combustible material shall be avoided for any supports.

4.7 Foundations

Foundations for cryogenic equipment have the potential for the lower side of the concrete to reach a temperature of 0 °C (32 °F) or less, resulting in the freezing of the subsurface and subsequent frost heaving effects. Frost heaving generally depends on soil conditions, ambient temperatures, and the amount of water available in the soil. The build-up of large layers of ice under cold foundations can take years. To prevent frost heaving at coldbox foundations, the soil under the foundations shall be kept from freezing. A site-specific evaluation should be performed to rate the potential for this effect to occur. Where such a possibility exists, consideration shall be given to one of the following mitigation techniques:

- On small foundations, the heat leak into the area from the atmosphere can cancel the cooling effect through the foundation;

- Provide an air circulation space that is open to atmosphere between the cold equipment or enclosure bottom and the top of the concrete;
- Provide an elevated foundation that has an air circulation space between the top of the soil and the bottom of the concrete foundation slab;
- Provide electric heating cables in the concrete foundation. The heaters and junction boxes should be accessible for periodic checks and maintenance; and
- Install open air conduits in the foundation that rely on convection.

Installation of a temperature sensor(s) on the foundation should be considered to measure the cooling of the soil. If installed, this temperature sensor can also provide information if internal leaks have collected at the bottom of cryogenic enclosure being exposed to low temperatures.

The equipment anchors from within the cryogenic enclosure to the foundation shall be manufactured from material compatible with the anticipated low temperatures such as stainless steel. Cryogenic enclosure casing anchors to the foundation and any rebar within the concrete shall use materials compatible with the foundation's minimum anticipated low temperature at the installation site.

4.8 Enclosure bottom

Typically, industry practice for ASUs is to construct the lower enclosure sections from carbon steel. The floor is either carbon steel or concrete. It is recognised that carbon steel will crack and release small amounts of fluids and (in some cases) perlite, if it comes into contact with cryogenic liquid(s). Industry experience shows that small leaks do not immediately affect the structural integrity of the overall enclosure and do not pose a significant risk to personnel. Cryogenic enclosures that are not directly mounted on a concrete foundation, but elevated by legs, plinths, or other structural columns require a solid enclosure bottom. The enclosure bottom material selection shall be based on the minimum ambient temperature and the minimum expected operating temperature of the insulation material adjacent to the enclosure bottom. This enclosure bottom may be fitted with temperature probes to alarm on temperatures lower than the expected operation conditions, which can indicate there is an internal leak. It should be noted that cold spots can be very localised and the installed temperature elements might not detect all leaks, so they should not be seen as a replacement of regular visual checks for cold spots. The elevated enclosure bottom should not be operated at temperatures less than the materials minimum allowable design temperature.

See 8.1 for the procedures that should be used to determine the risk of such a leak and the time period in which the leak shall be repaired.

For HYCO boxes, see 4.13.

Cryogenic pumps are more susceptible to liquid leaks because:

- they are often installed with bolted flanges for maintenance;
- they have rotating parts that require seals, which can develop leaks; and
- their motion creates vibrations, which can lead to leaks.

Therefore, for pumps installed in enclosures, one or more of the following leak detection methods may be installed:

- temperature detector(s) below the pumps (typically near the enclosure floor);
- seal leak detectors; or
- temperature switch on the pump shaft.

These leak detection methods may trigger one or more of the following:

- shutdown of the pump;
- closing pump isolation valves; or
- alarm to alert the operator of an abnormal situation.

4.9 Maintenance facilities

During enclosure design, consideration should be given to what sections could need maintenance access. If the enclosure is insulated with perlite, sections that need access should have means provided to be isolated without removing perlite from the entire enclosure. Ducts or stuffing boxes may be installed to allow removal of insulation at the local area rather than the entire box.

Some of the process equipment requires regular maintenance, such as expansion turbines and pumps. Typically, this equipment is installed in a separate section and has its own isolated and dedicated enclosure, which is insulated. An enclosure with separate sections has special considerations for its purge gas system; these are described in 6.1.3. Where possible, these dedicated enclosures shall be designed so that maintenance work can be performed by personnel working outside the enclosure. This eliminates the need for personnel to physically enter the enclosure.

Ladders may be installed inside the enclosure for construction or to allow repair of equipment and piping. These ladders shall either have safety cages or safety cable to prevent falls.

4.10 Protection of small bore lines

Small bore lines, particularly instrument tubes, are susceptible to damage in the construction phase, cooling down and warming up, and maintenance of the enclosure equipment. Consideration shall be given to protecting these lines from damage due to falling objects or inadvertent construction climbing. Any protection support shall account for the expansion and contraction of these lines during operation.

4.11 Protection from cryogenic embrittlement

When valves and cryogenic piping are installed adjacent to or penetrating the cryogenic enclosure, consideration shall be given to preventing cold migration from the valves and piping to the coldbox cladding that could result in cold embrittlement. Vents from the coldbox shall be directed away from the cladding to a safe location.

4.12 General design considerations for equipment aging

The cryogenic enclosure supplier should consider the following during the design stage to avoid leaks and structural degradation:

- fatigue from thermal cycles for process equipment and piping; and
- corrosion of carbon steel members.

4.13 Special considerations for flammable and toxic fluids

The consequences of releasing process fluids are more severe if the process contains toxic or flammable fluids. Therefore, additional requirements are needed for HYCO enclosures.

Each specific plant shall have a risk assessment. If the risk assessment shows a significant hazard exists, the consequence of the leak shall be mitigated by one or more of the following:

- Purge gas flow rates sufficient to dilute and remove small leaking flows from the enclosure;
- Alarms and / or shutdowns, based on the monitoring devices;

- Protect non-cryogenic compatible materials from being impacted by cryogenic liquids such as catch basins or baffles / plates to divert the liquid flow to safe areas; or
- A cryogenic liquid retention basin constructed of materials suitable for cryogenic temperatures. The basin shall be sized to give time to shut down the plant and purge the remaining liquid from the process equipment. The basin does not need to be sized to contain the entire process inventory. The basin support shall be designed to withstand the load corresponding to the basin full of cryogenic liquid.

At least one method for detecting liquid leaks shall be used. The most common methods are low temperature detection devices or sampling the enclosure purge gas composition and / or pressure. These are discussed further in 4.8 and 6.2.

If an enclosure has a pump, the consequence of a leak shall be mitigated by either:

- enclosure floor constructed of cryogenic compatible materials; or
- liquid retention basin installed under the pump.

During construction, additional quality assurance requirements may be considered to ensure that the piping and equipment are constructed in accordance with the design. This may include extra NDT and extra inspection.

Due to possible flammable and toxic fluid release, metal plates of HYCO enclosures shall be continuously welded to ensure the tightness. Use of mastic instead of continuous welding is not allowed. To ensure the seal weld integrity, inspection or other quality assurance methods may be required.

In certain parts of the process in HYCO boxes, the process temperature can be less than the liquefaction temperature of nitrogen. If the process fluids become colder than the nitrogen liquefaction temperature, either during a process upset or normal operating conditions, then special considerations could be necessary to prevent the nitrogen purge from condensing on equipment and piping. Some methods to prevent or minimise this include:

- Wrapping the cold equipment (i.e., equipment operating at less than -196°C [-320°F]) in special insulation and preventing nitrogen from circulating through this area;
- Using a different composition of purge gas to prevent nitrogen condensation; and
- Using vacuum insulation to minimise heat leak and prevent nitrogen circulation to the cold equipment.

5 Construction

Cryogenic enclosures have special construction requirements:

- The erection plan for a shipped / unpacked enclosure shall clearly identify piping and equipment temporary supports that were installed only for shipping. These supports shall be tagged or coloured with a bright colour with identification that they are to be removed prior to commissioning the cryogenic enclosure. It is recommended that a checklist be used to confirm that they have been removed;

WARNING: *Failure to remove these supports can restrain piping movements during cooldown and could potentially lead to piping failure, which can result in death or serious injury.*

- Specific erection, fabrication, and inspection plans are required for field erected cryogenic enclosures as the number of interconnecting piping, tubing, structural members, and casing joints require detailed procedures as compared to a shop fabricated cryogenic enclosure that arrives at the site as a complete assembly;

- Enclosures that are shipped via maritime transport shall be sealed to prevent sea water ingress;
- When installing mineral wool, care shall be taken so as to not damage or crush small bore lines;
- All hot work and cutting operations performed inside any enclosure shall take care not to inadvertently damage adjacent equipment;
- Procedures or controls shall be used for materials brought within the enclosure to ensure no foreign substances or incompatible materials are left inside;
- Piping and equipment shall be pressure and leak tested before installing insulation. It is critical to find all leaks before insulation is installed because once insulation is installed it will be difficult to detect or fix the leak. Also, leaks in perlite can erode equipment (see 7.5). Small leaks might not be immediately observed; it is good practice to use leak detection fluid on joints and wait several minutes to ensure that any leaks are found;
- When installing specialised joints used to join dissimilar metals, proper procedures shall be used to prevent damage from excessive heat exposure during welding and brazing work;
- Expansion joints are engineered piping elements. They shall be installed in accordance with the manufacturer's instructions;
- Installation of small bore lines and instrumentation tubing shall follow manufacturer's design details including routing and supports. These lines shall not be used as hand and step holds given their small size as they can be easily damaged;
- Rain and other liquid water shall be completely excluded from the cryogenic enclosure when installing the insulation. The enclosure needs to be carefully monitored during construction to ensure any openings are sealed or covered up to prevent rainwater ingress. Rainwater entering the enclosure insulation will saturate the perlite or mineral wool and this liquid water will be very difficult to remove from the granular insulation by purging alone during the start-up of the plant;
- Water shall be excluded from structured aluminium packing (aluminium structured packing is sometimes inside vessels). Liquid water can enter a vessel either from rain or condensation of humid air. If liquid water contacts aluminium structured packing, it can react to form hydrogen. There are documented instances of liquid water contacting structured packing for long periods and the top of the column was sealed. A significant amount of hydrogen collected at the top of the column and exploded when the top pipe was cut open;
- It is important to keep the insulation dry after it is installed. This requires installing the insulation as late in the construction period as possible. After the insulation is installed, the following shall be done:
 - Seal all openings to prevent water ingress; and
 - Start the purge as soon as it is available.
- As the plant becomes cold, the atmosphere in the enclosure will contract, drawing in atmospheric air unless a purge is established;
- The density of perlite when installed should be measured. If the density is greater than the design value, the insulating properties are reduced and the loads on the piping, enclosure, and equipment will be increased;
- It is not common industry practice to flow gas into the enclosure during construction to test for tightness or sealing;
- A cold test is where the piping and equipment is cooled down before insulation is installed. This can help to find some leaks. However, industry experience is that when proper design and

construction procedures are followed, cold tests are not effective in finding additional leaks. In addition, cold tests will also bring significant amounts of water inside the enclosure, which shall be removed prior to installing the insulation; and

- Consideration should be given for a mechanical joint (such as a bolted flange) to be tightened in cold condition before installing insulation. For example, turboexpander, liquid pump, or valve box enclosures.

6 Operation of cryogenic enclosures

Although, cryogenic enclosures are fairly simple to operate, they do have operating requirements that necessitate periodic inspection and maintenance. The most important operating requirement for non-vacuum insulated cryogenic enclosures is to keep positive pressure throughout the enclosure (see 6.1.5) within operating bounds by ensuring adequate purge gas pressure, flow, and composition to avoid moisture ingress into the enclosure leading to ice formation and to prevent oxygen condensation. For vacuum insulated cryogenic enclosures, it is important to ensure that the vacuum is maintained. If vacuum is degraded, it should be investigated and corrected immediately.

The manufacturer shall supply procedures and recommendations for operating scenarios. These typically include:

- start up from warm condition that includes cooling the enclosure at a rate that does not create excessive thermal stresses;
- start up from a cold condition;
- normal operation (see 6.1, 6.2, and 6.3);
- shutdown, where the enclosure will remain in a cold condition;
- warming the enclosure from cold to ambient temperature, either for maintenance or an extended shutdown; and
- maintaining the enclosure at a warm temperature.

The enclosure operator shall follow the manufacturer's recommendations and procedures unless these are modified with proper management of change (MOC) procedures [13].

General guidance on identifying and resolving abnormal conditions is given in Section 8. However, if specific guidance from a manufacture differs from Section 8, the manufacturer's guidance shall be followed.

6.1 Purge gas – Air separation unit processes

This section gives guidance for enclosure purge gas systems for ASUs.

6.1.1 Composition

Moisture-free, oil-free nitrogen shall be used for the purge gas, except as noted in the following paragraphs. During normal operation, the nitrogen purge comes from the cryogenic process or vaporised liquid, has less than 1 part per million by volume (ppmv) water (−76 °C [−105 °F]), and is considered moisture-free. Nitrogen with higher dewpoints (up to −40 °C [−40 °F] or 128 ppmv) may be used for short periods. The nitrogen coming from the cryogenic process or vaporised liquid is deemed to be oil-free, provided it is compressed without contacting a lubricant.

Nitrogen has a liquefaction point of 77 K (−196 °C [−320 °F]) at 1.0133 bara (14.696 psia) and the coldest part of the process will be slightly warmer than this temperature. As a result, the purge nitrogen will not liquefy.

In the ASU process, the pure nitrogen, whether liquid or vapour, will be under slight pressure (for example, 0.1 bar [1.45 psi]) and therefore will be 1 or 2 degrees warmer than nitrogen at atmospheric pressure.

The maximum oxygen concentration in the nitrogen purge shall be determined to avoid oxygen condensation on cold equipment and piping. A typical specification is less than 5% oxygen; however, the manufacturer's specification shall be followed. The condensed liquids will create potential hazards as if there was a liquid leak, including over pressurisation, liquid pools within perlite, cold migration, and unsafe atmospheres.

Moisture-free, oil-free air purge gas may be used for short periods to cooldown or start up from warm conditions. As soon as nitrogen is available from the process, it shall be used for purging the enclosure. This minimises the potential to condense air on process piping and equipment. Nitrogen purge gas shall be used when restarting up under cold conditions unless otherwise stated in the manufacturer's operating procedures.

If nitrogen purge gas is not available during extended periods for shutdown and cold standby, the operating procedures shall have instructions on how the enclosure is kept moisture-free. In these cases, dry, oil-free air may be specified by the manufacturer.

Some processes (for example, high pressure nitrogen generators) can be operated safely using moisture-free, oil-free air for enclosure purging, because all process conditions are greater than the dew point of air. For clean atmospheric pressure air, this is $-191.3\text{ }^{\circ}\text{C}$ ($-312.3\text{ }^{\circ}\text{F}$). When considering if air can be used, the actual atmospheric pressure and composition of air shall be considered, including trace contaminants. Trace contaminants can significantly raise the dew point of air.

Nitrogen-rich gas that is recovered from some parts of the cryogenic processes might not be suitable as an enclosure purge gas. Hydrocarbon gas impurities in the recovered nitrogen can elevate the nitrogen dew point, increasing the likelihood of forming a hydrocarbon-rich liquid phase inside the cryogenic enclosure.

6.1.2 Pressure

The pressure of the purge gas shall be greater than atmospheric at all points in the enclosure to prevent oxygen, trace contaminants, and moisture in the air from entering the cryogenic enclosure. When designing the system, both the frictional and static pressure changes shall be considered. The purge gas is colder than the surrounding atmospheric air, and therefore, it will tend to have a greater density. This greater density means that at elevations above grade, the static pressure will decrease more rapidly inside the enclosure than in the surrounding atmosphere. This difference in static pressure between the purge gas and atmospheric air shall be considered when determining the desired purge gas pressure within the enclosure.

Measurements shall be used to ensure that there is positive pressure at all points within the enclosure. These may be a combination of pressure and / or flow measurements, with the number and type determined by the manufacturer. The measurements may be local indicators or in the control system. The pressure measurement system *should* also have low and high pressure alarms. Unmanned air gas plants shall have the pressure measurements and low and high pressure alarms in the control system.

The purge gas flowrate and inlet pressure may also be indicated locally or in the control system.

Changes in purge gas pressures or flows should be monitored. Changes can indicate a blockage or leak within the cryogenic enclosure and / or purge gas system and should be investigated (see Section 8).

6.1.3 Injection system

There is significant flow resistance to the purge gas within the perlite or mineral wool. Due to this resistance, it may be necessary to inject the purge gas at multiple points within the enclosure to ensure that the purge gas pressure is maintained at all points.

It may be desirable to have separate enclosures or sections of the enclosure. These sections typically contain pumps or expanders, or large equipment items (this does not refer to small mineral wool packed boxes for flanged valves). If purge gas does not flow between these sections, then each shall have its own purge gas supply system that can be isolated for maintenance or process operation. Each separate system should have its own flow and / or pressure monitoring.

The injection system shall be designed so that the purge gas velocity is less than the perlite fluidisation velocity, which prevents eroding equipment and / or piping (see 7.5).

6.1.4 Venting

ASU enclosures may have some type of vent. However, some ASU systems do not have a continuous vent. As long as there is positive purge pressure in all sections of the enclosure, a continuous sweep of the entire coldbox is not necessary.

Often the vent pressure control is a weighted disk to maintain a backpressure on the enclosure.

Nitrogen is injected into the enclosure to make up any losses from leaks plus any vented nitrogen.

The vent, if present, shall be located to prevent personnel from being exposed to an oxygen-deficient atmosphere.

Vents may have a desiccant moisture trap to prevent water from entering the enclosure if air is pulled in during an upset. A moisture trap adds flow resistance to the vent and this shall be accounted for in sizing the purge gas and vent system.

6.1.5 Sample points

In the event of a suspected leak within the enclosure, it is useful to be able to measure the purge gas composition. These manual measurements are useful to determine the existence, location, and size of any leaks within the enclosure. (Because nitrogen is used as the purge gas, measuring the composition will not be able to determine nitrogen leaks). Means to measure the purge gas composition shall be provided at sampling points on the enclosure. The number and location of sampling points should take into account enclosure dimensions, the presence of internal partitions, or potential leak points such as flanged connections. See also 7.3 and 8.3.

6.2 Purge gas – Processes with flammable or toxic gases

The most common cryogenic processes with flammable or toxic gases have carbon monoxide or hydrogen. Special considerations are needed for these enclosures.

6.2.1 Composition

The purge gas for HYCO cryogenic enclosures shall be non-flammable and contain less than 1% oxygen (also moisture-free and oil-free). The lower oxygen concentration is to ensure that flammable atmospheres are not formed. Nitrogen is typically used as purge gas. Air shall never be used as a backup, temporary, or start up enclosure purge since the possibility of a leak inside the enclosure during the start up would lead to the formation of a flammable mixture inside the enclosure. The liquefaction point of carbon monoxide is 82 K (–191 °C [312 °F]), which is slightly warmer than nitrogen.

6.2.1.1 Hydrogen – Specific hazards

Hydrogen has a molecular weight of 2.016 g/mol and air has a molecular weight of 28.95 g/mol. Therefore, any small leaks will dissipate very readily to the upper atmosphere.

A large leak will form a flammable mixture with the oxygen in the air. Hydrogen has very low ignition energy. The flammable mixture can ignite from many external sources, or even the velocity of the escaping gas can provide sufficient ignition energy. The flame produced is light blue and cannot be seen in the daytime (it can be seen at night). Ultraviolet (UV) flame detectors may be installed to aid in sensing hydrogen leaks and flames.

DANGER: Because hydrogen fires are difficult to see during daylight, personnel working in proximity to hydrogen shall be trained in the hazards and safety procedures to avoid getting burned.

6.2.2 Pressure

The pressure of the purge gas shall be greater than atmospheric at all points in the enclosure to prevent oxygen, trace contaminants, and moisture from entering the cryogenic enclosure.

Due to the size of the enclosure it is very difficult, if not impossible, to perform a leak test, so it is necessary to assume there will be small leaks in the enclosure. Failure to maintain the purge pressure greater than the prevailing barometric pressure could allow atmospheric air into the cryogenic enclosure, creating the hazards associated with oxygen and moisture. Some potential upset scenarios that could lead to this condition are:

- Rapid rise in barometric pressure;
- High velocity wind impacting the enclosure surface; or
- Sudden process change either due to rapid operator changes or upsets that lowers the process temperature to less than -196°C (-320°F), which is the liquefaction temperature of the nitrogen purge gas. The rapid liquefaction of the purge gas could potentially place a portion of the enclosure in a slight vacuum.

The manufacturer shall consider these possible scenarios when designing the enclosure and developing the operating procedures. The design and procedures shall ensure that the purge gas pressure is sufficient to prevent air ingress.

6.2.3 Injection system

See 6.1.3 for general information on injection points.

6.2.3.1 Positive flow is required to sweep out small leaks

A positive flow of purge gas is required to sweep out any small leaks arising from process equipment. This avoids accumulating the process gases (carbon monoxide and hydrogen). Therefore, the flowrate of the purge gas shall be indicated either in the control room (with the control system or other monitoring equipment) or in the field. There shall be low flow alarms to warn the operator of potential unsafe conditions.

6.2.3.2 Pressures and flows to the control system

The following monitoring devices shall be installed in the control system:

- purge pressure indication;
- purge flowrate indication;
- low purge pressure alarm;
- enclosure high pressure alarm; and
- low purge flow alarm.

Other instrumentation may be added, either as required by a risk assessment or to aid in troubleshooting.

6.2.4 Venting

HYCO cryogenic enclosures shall be vented with a dedicated vent not shared with other systems in the facility. This isolation eliminates backflow from other processes and limits the means by which air enters the enclosure. If there is a leak in the process, then hydrogen and carbon monoxide will be present in the purge gas vented from the enclosure. The vent shall be designed and located considering the possibility that it can contain flammable or toxic gases. The composition of the purge gas vent shall be monitored either continually or periodically. The manufacturer shall provide the maximum concentrations that are allowed during operation of flammable and toxic components in the enclosure purge gas.

6.2.5 Sample points

Measuring the purge gas composition within the enclosure is useful to determine the existence, location, and size of any leaks within the enclosure. The number and location of sample points should consider the enclosure size, the probability and consequence of process leaks, and the presence of internal partitions or potential leak points.

Multiple sample points may be piped together so that the enclosure purge gas composition can be more easily monitored. The separate sample points can then be used individually to better determine the source of a leak. See also 8.3.

6.3 Maintenance

Periodic maintenance and inspection tasks for cryogenic enclosures should include but are not limited to:

- maintaining roof to prevent water ingress;
- preventing rust to maintain enclosure;
- maintaining valve boots;
- checking for process leaks, typically only visual for ice spots;
- inspecting and maintaining overpressure protection devices;
- checking functioning of purge gas system per manufacturer's recommendations for purge pressure and / or flow;
- checking perlite level, particularly immediately after initial plant commissioning or reinstalling perlite;
- checking the moisture trap on the purge gas outlet, if present; and
- other requirements per manufacturer's recommendations.

AIGA 056, *Safe Practices Guide for Cryogenic Air Separation Plants* provides guidance on coldbox maintenance for ASUs [2].

7 Enclosure hazards

7.1 General hazards

There are several types of hazards that can potentially occur in a cryogenic enclosure:

- Gaseous or liquid leak from the process can overpressure the enclosure. A liquid leak can create pressures greater than the leak source if the cryogenic liquid rapidly vaporises;

- Enclosures are typically not designed as pressure containing vessels or structures. However, other design considerations such as wind and seismic loading can result in a structure that can contain some significant amount of pressure. If the internal pressure exceeds this unintended design pressure, then the enclosure will fail releasing both pressure and insulation. Enclosures that can withstand greater internal pressure before failing include those with cylindrical cross sections and those designed to normally operate with full vacuum (to minimise heat leak);
- Gaseous or liquid leak from the process can create a toxic or flammable mixture (depending on the composition of the process fluids);
- If the gas inside the enclosure has a composition different from design, then it can liquefy on the process piping. This liquefaction will further change the fluid compositions. These differing compositions can create hazards, possibly due to either oxygen enrichment or flammability;
- If liquids form or collect within the enclosure, they can embrittle or weaken the enclosure outer panels and structural members of the enclosure. If the panels fracture from exposure to cold temperature, this will lead to release of perlite, and the fragments themselves could pose a hazard to personnel in the plant; and / or
- High velocity vapour jet into perlite will fluidise the perlite, eroding equipment and piping in a short time.

7.2 Overpressure

Coldbox casings are constructed to have minimal leaks and are internally purged to exclude ambient air from the enclosure. Pressurisation of the internal volume greater than the normal purge pressure can occur from any of the following:


- excess purge gas;
- leaking process fluids; or
- rapid vaporisation of cryogenic pools and leaks, which can occur if the liquid is disturbed or warmed.

Consideration shall be given to relief of this over-pressurisation and the structural design of the coldbox during these events.

Over-pressurisation can occur rapidly and the flowrate is difficult to predict. The size of liquid pools and the vaporising heat leak, pressure and size of line breaks, and failed purge gas regulation can result in gas flows that exceed normal casing relief capacity. Additionally, the insulation retards gas flow and results in flow resistance between the line break and casing pressure relief device.

In the case of loose fill perlite, fluidisation occurs even at a low gas flowrate. Pressures at the source of the release can lift the entire column of perlite above the release. This results in a combined total pressure of the casing static pressure and the pressure due to the weight of the column of perlite. Depending on the size or configuration of the relief device, some initial choking of the relief device can also occur as the perlite begins to flow through the device. Once flowing, the density of the flowing gas is a combination of the gas and flowing media. This phenomenon shall be considered when sizing the enclosure relief device.

Figure 1 indicates the general trends of the pressure load on the casing wall during over pressurisation of an enclosure.

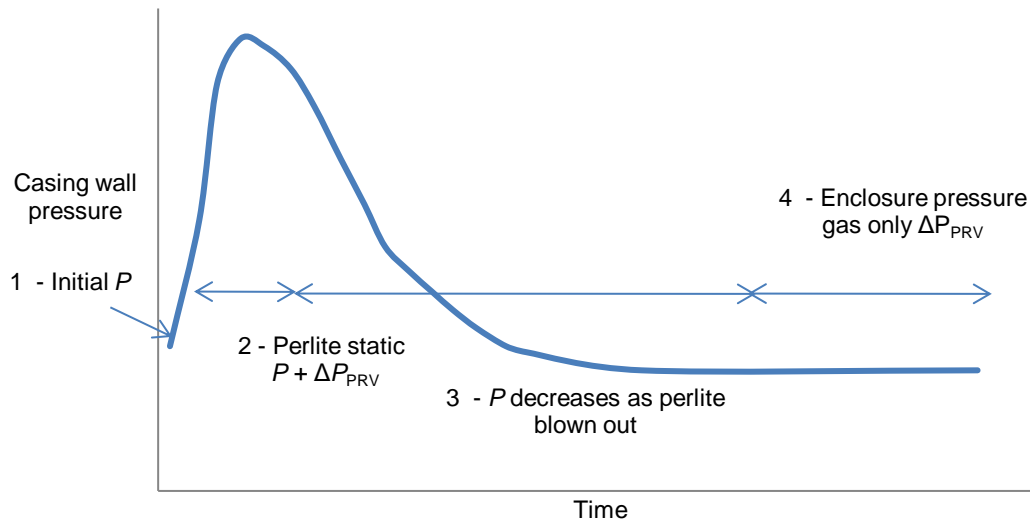

LEGEND

- 1 = Initial casing pressure consisting of the purge gas pressure plus static perlite load.
- 2 = Static head of fluidised perlite, plus pressure drop through relief device.
- 3 = Decrease in static pressure as perlite is blown from the enclosure.
- 4 = Enclosure pressure, where the perlite has been blown out of the enclosure. There is less static perlite head because the perlite has been blown out. The only back pressure is from the gas flow through the casing relief device or any breach.

Figure 1 – Casing pressure versus time

Leaks can also partially fluidise the perlite, which can create an empty space around the leak point. This space can suddenly collapse, causing a sudden pressure rise and possibly deform the enclosure.

The enclosure design shall consider the possibility of overpressure events. Small to medium size over-pressurisation events (such as excessive purge gas flow and small leaks) are typically relieved by placing one or more relief devices on the top or side of the casing. The location and direction of relief devices shall consider the surrounding area and potential perlite engulfment of personnel in the area. For breakaway relief devices, designs should consider incorporating a restraining mechanism to prevent endangering personnel.

The experience of the industry is large releases of gases or liquids into the enclosure are rare events when using proper design and operating procedures. However, it is recognised that it is impossible to design an enclosure that can withstand a large release of gas or liquid such as if a large diameter pipe fails. Such a scenario will cause the enclosure to fail, releasing pressure and perlite to the environment.

Considerations for scenarios where the enclosure fails due to overpressure:

- Manufacturer may provide likely weak spots in the casing that will fail in a significant overpressure event;
- When plates are used as structural support (as in a stress-skin design), consideration shall be given to the losing one or more of these plates in an over-pressurisation event; and
- Site emergency plans shall be developed that define the measures to take in the event of a vapour, liquid, or insulation release from the cryogenic enclosure. An emergency plan for perlite releases is discussed in AIGA 032 [10]. With proper design / operating procedures and emergency plans; it is extremely unlikely that personnel will be injured by such an event.

Cylindrical casings can retain significantly more pressure than an equivalent square or rectangular casing. The resultant relief of this pressure in an uncontrolled manner can be much more damaging than in a rectangular enclosure. The cylindrical enclosure can fail in one of three locations:

- cylinder-to-foundation attachment (typically bolts);
- cylinder itself; or
- cylinder-to-roof attachment.

7.3 Unsafe compositions

If a fluid is released from the process into the cryogenic enclosure, it can create an unsafe atmosphere. It shall be recognised that the insulating material generally has a high resistance to flow, and the composition can vary greatly within the enclosure. Caution shall be used to ensure that the measured composition is representative of the enclosure area being considered.

The following potential hazardous compositions can occur.

7.3.1 Oxygen-deficient atmospheres

The atmosphere within the enclosure generally contains insufficient oxygen to sustain life. This is the typical composition. It is necessary for all operating personnel to be trained in this hazard and to use appropriate procedures, equipment, and personal protective equipment (PPE).

WARNING: Nitrogen atmospheres do not support life, and unconsciousness or death can occur within a few breaths.

In some severe weather climates, the enclosure may be located within a larger building. This will allow operating and maintenance tasks to be completed in a more controlled environment. In this case, there is an additional enclosure hazard: leaks from the enclosure can create a hazardous atmosphere within the building. A risk assessment shall be performed and mitigation and countermeasures shall be used.

The general hazards of oxygen-deficient atmospheres and countermeasures are discussed in several publications [12, 14, 15, 16, 17].

7.3.2 Oxygen-enriched atmospheres

In processes that contain oxygen-enriched fluids, a process leak has the potential to create an oxygen-enriched atmosphere. This can be detected by analysing the cryogenic enclosure atmosphere. An oxygen-enriched atmosphere within the enclosure creates the following hazards:

- It raises the dew point of the purge gas and this can liquefy on cold process piping and equipment. This liquid can migrate in the enclosure and expose non-cryogenic materials to cryogenic temperatures;
- The oxygen-enriched atmosphere can leak from the enclosure and expose personnel to the hazardous atmosphere;
- When the enclosure is shut down and personnel enter to repair a leak, this can potentially expose the repair personnel to the hazardous atmosphere; and
- The atmosphere within might not be uniform at all locations, so sample point readings might not be representative of the composition in all locations.

The general hazards of high oxygen atmospheres are discussed in publications [12, 18].

7.3.3 Flammable or toxic atmospheres

For HYCO processes, a process leak can form a flammable or toxic mixture inside the enclosure. This can lead to a flammable / toxic mixture external to the enclosure due to enclosure leaks. A flammable or toxic atmosphere within the enclosure creates the following hazards:

- It raises the dew point of the purge gas and this can liquefy on cold process piping and equipment. This liquid can migrate in the enclosure and expose non-cryogenic materials to cryogenic temperatures;
- Leaks from the enclosure, which can expose personnel to the hazardous atmosphere;
- When the enclosure is shut down and personnel enter to repair a leak, this can potentially expose the repair personnel to the hazardous atmosphere; and
- The atmosphere within might not be uniform at all locations, so sample point readings might not be representative of the composition in all locations.

7.3.4 Moisture

While not a specific hazard in itself, if water enters the enclosure it can create operating problems and personnel hazards. If water enters the enclosure either as liquid (typically from rain) or as vapour (either with the purge gas or by leaking in from outside), it will freeze and form ice. The ice can agglomerate with perlite or mineral wool. These frozen masses will restrict piping movement during cool down and increase the likelihood of a leak. In perlited enclosures the agglomerates can become very large and heavy and fall through loose perlite, potentially damaging equipment.

7.4 Cold temperatures

Equipment within the enclosure typically encounters a wide range of temperatures, from the lowest possible temperature in the process to the highest expected ambient temperature. This can range from -196°C to 65°C (-320°F to 149°F). The enclosure is designed to withstand the temperatures that can be expected at each location in all operating modes, including process upsets.

During normal operation, the insulation ensures that the enclosure panels are near ambient temperatures. Therefore, the enclosure panels are typically not manufactured from cryogenic compatible materials. In the event of a process leak, panels can crack as discussed in 4.6 and 4.8. Site emergency plans shall be developed that define the measures to take in the event of a vapour, liquid, or insulation release from the cryogenic enclosure. An emergency plan for perlite releases is discussed in AIGA 032 [10].

Abnormal conditions can create ice either in the interior or on the exterior of the enclosure. Some possible causes of ice formation are described in 8.2. If a significant amount of ice accumulates, it can break free and fall. It can also break free during derime and warming up of the enclosure. If large ice spots are observed, consider restricting access to the enclosure and surrounding area to prevent personnel from being injured by falling ice. Also, it may be necessary to construct temporary protection for critical equipment.

7.5 Equipment erosion

Any leak within a perlite insulated cryogenic enclosure should be investigated. After determining the risk of continued operation (see 8.1), the leak shall be repaired as soon as practical. A small leak can fluidise and circulate the perlite, enlarging the hole and possibly eroding adjoining piping or equipment quite rapidly. This erosion can occur very quickly, causing significant damage in a short time, even as quickly as a few hours. The erosion will occur more rapidly with a vapour leak than a liquid leak. Higher pressure vapours will erode at a much greater rate than lower pressure vapours; however, low pressure vapours can erode equipment at a relatively high rate. Copper and aluminium will erode more quickly than stainless steel.

7.6 Feedstocks containing oxides of nitrogen

Feed stocks that contain both trace amounts of oxides of nitrogen (mixtures of nitric oxide (NO) and nitrogen dioxide (NO₂), also known as NO_x) and conjugated dienes present an explosion hazard. At cryogenic temperatures, oxides of nitrogen and the conjugated dienes will form a gum that collects in the cryogenic process equipment. The gum can decompose explosively when warmed such as in a defrost. The process equipment shall be defrosted or solvent washed periodically to remove the gum before the gum accumulates to unsafe levels [19, 20].

8 Troubleshooting

This section describes the possible symptoms and causes of abnormal operational conditions and their respective corrective actions. Table 1 gives troubleshooting guidelines. It lists various scenarios, how they can be detected, and the potential consequences. The short-term consequences are the immediate conditions from the scenario. The potential ultimate consequences are the potential results if no mitigating actions are taken and the hazard is left unabated.

Table 1 – Enclosure upset scenarios symptoms and consequences

Scenario	Possible symptoms ¹⁾		Consequences	
	Monitoring	Indication	Short term	Potential ultimate
Increased leakage from enclosure	Purge gas flowmeter	Increase, if purge gas is on pressure control	Increased nitrogen leakage to environment	a) Atmospheric air enters enclosure if purge gas flowrate is insufficient to maintain positive pressure in enclosure b) <u>Ice forms within the enclosure restraining movement of equipment resulting in potential damage</u> c) <u>Removal of ice is difficult even during deriming</u>
	Purge gas pressure	Decrease, if purge gas flow is in manual or flow control		
	<u>Visual inspection</u>	<ul style="list-style-type: none"> • <u>Failed valve boots</u> • <u>Casing cracks or corrosion</u> • <u>Casing safety valves leaking</u> • <u>Ice on enclosure exterior</u> 		
ASU process gas leak: nitrogen-rich gas	Coldbox pressure	Increase	No change	a) Equipment <u>and piping</u> erosion b) Enclosure overpressure c) Perlite release
	Portable oxygen detector	No change		
	<u>Visual inspection</u>	<ul style="list-style-type: none"> • <u>Failed valve boots</u> • <u>Casing safety valves leaking</u> • <u>Ice on enclosure exterior</u> 		
ASU process gas leak: oxygen-rich gas	Coldbox pressure	Increase	Oxygen-rich mixture	a) Equipment <u>and piping</u> erosion b) Enclosure overpressure c) Oxygen reaction d) Perlite release
	Portable oxygen detector	% oxygen > inlet purge		

Scenario	Possible symptoms ¹⁾		Consequences	
	Monitoring	Indication	Short term	Potential ultimate
	<u>Visual inspection</u>	<ul style="list-style-type: none"> • <u>Failed valve boots</u> • <u>Casing cracks</u> • <u>Casing safety valves leaking</u> • <u>Ice on enclosure exterior</u> 		e) Oxygen saturated perlite f) <u>Depending on the composition of the gas, it can condense on colder surfaces</u> g) <u>Perlite eruption caused by the enriched liquid oxygen rapidly vaporising during a derime of the process</u>
HYCO process gas leak	Coldbox pressure	Increase	Flammable and/or toxic mixture	a) <u>Equipment and piping erosion</u> b) Enclosure overpressure c) Explosion or fire d) Flammable/toxic gas release e) Perlite release
	Flammable or toxic gas detector	Concentration greater than alarm point		
HYCO hydrogen leak	Bottom pressure indicator	Less than or equal to 0 mbar	Significant hydrogen leak	a) Potential flammable gas mixture forms at enclosure vent or leak points, with hydrogen fire b) Perlite or cryogenic liquid release c) Toxic or flammable gas release d) Large explosion
ASU process liquid leak: nitrogen-rich liquid	Coldbox pressure	Increase	No change	a) Embrittlement of structural supports b) Enclosure overpressure c) Cryogenic liquid release d) Perlite release e) <u>Perlite eruption caused by liquid nitrogen rapidly vaporising</u> f) <u>Enclosure failure</u>
	Foundation temperature indication	Low temperature		
	Visual inspection	<ul style="list-style-type: none"> • Ice on enclosure exterior • Visible vapour exiting enclosure • <u>Failed valve boots</u> • <u>Casing cracks with or without perlite blowing out</u> • <u>Casing safety valves leaking</u> 		
	Portable oxygen detector	No change		
ASU process liquid leak: oxygen-rich liquid	Coldbox pressure	Increase	a) <u>Oxygen rich mixture</u> b) <u>Casing cracks</u>	
	Foundation temperature indication	Low temperature		

Scenario	Possible symptoms ¹⁾		Consequences	
	Monitoring	Indication	Short term	Potential ultimate
	Visual inspection	<ul style="list-style-type: none">• Ice on enclosure exterior• Visible vapour exiting enclosure• <u>Failed valve boots</u>• <u>Casing cracks with or without perlite blowing out</u>• <u>Casing safety valves leaking</u>		a) Embrittlement of structural supports b) Enclosure overpressure c) Oxygen reaction d) Cryogenic liquid release e) Perlite release f) Perlite saturated with liquid oxygen g) <u>Perlite eruption caused by enriched liquid oxygen rapidly vaporising</u> h) <u>Enclosure failure</u>
	Portable oxygen detector	% oxygen greater than inlet purge		
HYCO process liquid leak	Coldbox pressure	Increase	Flammable and/or toxic mixture	a) Embrittlement of structural supports b) Enclosure overpressure c) Explosion or fire d) Flammable/toxic gas release e) Cryogenic liquid release f) Perlite release
	Foundation temperature indication	Low temperature		
	Visual inspection	<ul style="list-style-type: none">• Ice on enclosure exterior• Visible vapour exiting enclosure		
	Flammable or toxic gas detector	Concentration greater than alarm point		
ASU loss of purge gas	Pressure indicator	Approximately 0 mbar	a) Atmospheric air enters enclosure b) Oxygen-rich mixture	a) Liquefied air inside enclosure b) Ice forms within enclosure c) Equipment or piping damage d) Perlite or cryogenic liquid release e) Oxygen saturated perlite f) <u>Perlite eruption caused by liquid rapidly vaporising</u>
	Purge gas flow indication	Low flow or low alarm		
	<u>Visual inspection</u>	<u>Ice on enclosure exterior</u>		
HYCO loss of purge gas	Pressure indicator	Approximately 0 mbar	a) Atmospheric air enters enclosure b) Oxygen-rich mixture	a) Liquefied air inside enclosure b) Ice forms within enclosure c) Equipment or piping damage d) Perlite or cryogenic liquid release e) If simultaneous process leak, then formation of flammable mixture inside enclosure
	Purge gas flow indication	Low flow or low alarm		
	Flammable or toxic gas detector	Normal		
	Portable oxygen detector	Oxygen detected		

¹⁾ Some scenarios may have more than one symptom.

8.1 Process leaks and detection

Process leaks give rise to different abnormal operation depending on quantity and temperature of the liquid or gases released. In case of small leaks, they might not immediately affect mechanical integrity

of the structure. However, they can cascade into a larger event / consequence resulting in catastrophic failure of the pipe itself or adjacent piping. Leaks can be deduced by routine means such as:

- ice spots or blocks on the external side of the enclosure;
- vapours from the bottom of the enclosure;
- purge gas pressure or flow changes;
- insulation space purge gas composition changes;
- low temperatures as detected by temperature probes (if probes are installed);
- thermal imaging of the casing;
- foundation temperatures;
- enclosure casing cracks;
- insulation blowing out of the enclosure casing;
- insulation blowing out of valve boots;
- peeled enclosure casing paint; or
- venting of enclosure casing safety devices.

Large leaks can be detected by the previous symptoms. They can also change the operating parameters and be detected by these process changes:

- pressures;
- temperatures, or
- decreases in liquid levels or cryogenic liquid production.

In extreme cases, a leak can freeze the ground surrounding the foundation, causing it to heave. The enclosure will then tilt and is no longer vertical. This indicates a significant safety hazard and should be investigated immediately.

Rotating equipment such as pumps or turbines are more likely to leak, so temperature indication or seal leak detectors may be helpful in detecting the leak sources. Temperature indicators at the base of the enclosure can detect leaks for cryogenic liquids.

After identifying the leaking points, the risk of continued operation shall be assessed. Items to be considered shall include:

- size of leak;
- composition of the fluids leaking from the process (for example, flammable, toxic, oxidisers);
- gas or liquid leak—depending on the composition and location of the leak, gas can condense;
- source pressure of the leak—high pressure versus low pressure;
- physical location of the leak within the enclosure;
- elevation and proximity to the enclosure casing;

- potential for the leak becoming worse;
- potential for equipment damage, including equipment erosion (see 7.5);
- consequence of releasing process fluids to the enclosure or atmosphere;
- possibility and consequence of enclosure failure including offsite impact to traffic and residential areas;
- risk of ice build-up on the enclosure panels and restriction of access to platforms and valves as a result of ice accumulation;
- risk of perlite eruption;
- risk of damage to equipment or small bore piping located near ground level from ice accumulation falling off the enclosure panels during significant change in weather causing melting of ice;
- type of insulation;
- operating history;
- integrity of the enclosure casing and components (likelihood of ice accumulation within the insulation);
- size of the enclosure; and
- any other items identified by the risk assessment team.

Based on the local operations site findings, a risk assessment shall be completed by subject matter experts in accordance with company procedures. The results of this risk assessment may determine that the plant can continue to run for an extended time, that additional testing, monitoring, and / or mitigation is necessary, or require immediate shutdown and repair of the unit. If the repair requires perlite to be removed, AIGA 032 gives guidance for safely removing perlite [10].

Conditions shall be monitored for any changes and the risk assessment shall be reviewed and updated as needed.

Once a leak has been identified, it is imperative that the process pressure be greater than the purge gas pressure at all times. Failure to do so will allow perlite to flow into the process equipment. Once perlite is in the equipment, it is extremely difficult to remove. Perlite within process equipment can create both operating and safety problems.

WARNING: *If perlite becomes lodged within portions of an ASU, it can create areas where oxygen and hydrocarbons can collect together. This can lead to a serious explosion that can damage equipment and injure or kill personnel. Further guidance can be found in AIGA 032 and AIGA 035, Safe Operation of Reboilers / Condensers in Air Separation Units [10, 3].*

8.2 Ice on enclosure external surfaces and piping

Ice on the external face of an enclosure indicates excessive heat leak. This can be caused by one of the following:

- process leaks with relative cold transfer from the process to the enclosure;
- locally missing insulation inside coldbox;
- degradation of insulation due to moisture entering the coldbox (typically caused by rainwater ingress or loss of purge gas);

- loss of vacuum in the case of vacuum jacketed enclosures; or
- improperly designed piping (see 4.3).

If the enclosure surface or external piping has ice, it may indicate that hazardous mixtures are accumulating within process piping by concentrating some components (see 4.3). Therefore, any ice should be investigated to ensure that a safety hazard is not present.

Ice spots on top can also be due to settling of perlite level some weeks after the initial start up. More frequent inspections should be performed during this period to identify if such settling has occurred. Inspection and refilling should be carried out, where necessary.

The presence of ice can be a safety hazard (see 8.1). In addition to ice spots, thermography or thermal imaging can detect cold or warm areas on the enclosure. Thermal images can be useful in identifying operating problems.

8.3 Purge gas sampling

As described in 6.1.5 and 6.2.5, sampling points should be provided at different elevations and orientations of the coldbox. Sampling purge gas at different elevations and analysing for oxygen can indicate leaks from oxygen containing process streams. Leaks of nitrogen cannot be detected in this way because the purge gas is nitrogen.

In the case of HYCO plants, continuous or periodic analysing on purge gas outlet for the main representative components (for example, hydrogen, methane, and carbon monoxide) shall be carried out. Greater than normal concentrations can indicate a process leak.

8.4 Purge gas flow and pressure changes

Enclosure casing pressure and purge gas flowrate indications can be useful for detecting process leaks inside the enclosure. Any significant change in flowrate or pressure during operation shall be investigated since these can signify leaks or blockages that could affect enclosure operation and safety.

8.5 Operating with process leaks

Upon completion of a risk assessment that concludes that the plant can continue to operate (as noted in 8.1), the operating staff should proceed with caution noting that prolonged leaks can impact plant integrity and safety in areas such as:

- Low temperature embrittlement:
 - Cryogenic enclosure casing should be inspected for ice formation and cracking. Potential insulation material release and perlite eruption or, ultimately, enclosure structural failure can result from low temperature embrittlement
 - Concrete foundation and embedded rebars. When available, foundation temperature and / or foundation heaters should be monitored for abnormally low temperatures. Potential weakening of the enclosure foundation and anchor bolts system can result in loss of structural stability
 - Cryogenic enclosure main support members. Designs that incorporate structural members as part of the enclosure casing design can be cooled to a condition that reduces their strength. Ultimately, structural failure of the cryogenic enclosure can result from low temperature embrittlement;
- Enclosure over-pressurisation:
 - Cryogenic enclosure casing pressure shall be monitored as process leaks can result in pressures exceeding the design pressure rating of the casing. In addition to the

insulation space high pressure alarm, visual indications such as casing overpressure devices venting, bulging valve boots, casing cracks, and bulges in the casing are some indications of overpressure. Ultimately, structural failure of the enclosure can result from overpressure;

- Oxygen enrichment of the enclosure insulation space:
 - Enriched oxygen process leaks can increase the oxygen content in the cryogenic enclosure insulation space. The composition of the insulation space gas shall be periodically checked at various sample locations
 - Enriched oxygen can condense in the insulation space and pool as a liquid. This liquid can be rapidly vaporised when disturbed or warmed causing a perlite eruption and / or over-pressurisation of the cryogenic enclosure
 - Enriched oxygen atmosphere can be an oxidiser for an energy release if combustible material is present in the insulation space;
- Incorrect or unstable process instrumentation indications:
 - Broken or cracked instrumentation tubing can result in incorrect or unstable level, pressure, and / or flow indications for the process. These abnormal values can aid in determining which lines have been damaged. In addition to the risk of process leaks into the cryogenic enclosure, operating at incorrect or unstable process values can lead to an unsafe operating condition;
- Reboiler energy releases due to loss of liquid submergence:
 - Inadequate reboiler submergence due to incorrect liquid level measurement from broken or cracked reboiler level instrumentation lines
 - Inability to maintain minimum submergence due to loss of refrigeration caused by broken or cracked instrumentation or process lines;
- Erosion can cause a leak to cascade into a larger event / consequence resulting in catastrophic failure of the pipe itself or adjacent piping and equipment; and
- Perlite ingress into the process can cause equipment and small bore piping pluggage, which causes operating and safety issues. Pluggage of reboilers is of particular concern due to safety issues.

8.6 Emergency condition guidance

The site emergency plan shall consider including the following items.

In the event of leaks being suspected or discovered, they should be dealt with only by personnel who have been adequately trained and have proper equipment.

Many of the enclosure alarms that can indicate an internal leak could potentially lead to an unsafe atmosphere or could over-pressurise the box. Responding to the alarms may include having the operator go to the enclosure to eliminate the alarm condition. Operators shall be trained on the response to such alarms to be able to evaluate when it is safe to attempt to rectify the alarm by field action and when it is necessary to not physically approach the hazardous area.

If a leak is suspected or discovered, the potential rapid and severe consequences shall be considered. In particular, if the pressure inside the enclosure increases, the possibility of sudden perlite release shall be considered. If the probability of a perlite release is high, a restricted access area should be established and permission to enter such a space shall be issued by a responsible person.

When working in cryogenic enclosures with interconnected sections, consideration shall be given to monitoring internal conditions of all enclosure sections. A sudden rise in pressure can occur in a section where perlite is being removed as well as in adjacent sections. This rise could cause an eruption or release to the atmosphere from adjacent sections or could affect the section where work is being done.

The restricted area size and location should be determined taking into account:

- location and elevation of relieving devices;
- permanent working places on the premises that could be affected by perlite release;
- possibility of perlite ingestion by adjacent processes;
- venting during perlite release of oxygen-enriched or oxygen-deficient streams (and flammable streams in case of HYCO); and
- fog cloud from cryogenic release.

It may be decided to open the enclosure to investigate or repair the leak. In these cases, the plant operators shall exercise caution if any openings are made into the coldbox. Some of the hazards with an opening in the enclosure are described in 9.2.

9 Changes, modifications, and repairs to cryogenic enclosures

All work shall be carried out using a safe work permit system [2, 21].

9.1 Management of change

Enclosures are engineered to perform a specific purpose. Any modification to process equipment, piping, and / or the cryogenic enclosure shall be approved under a MOC plan [13]. Subject matter experts in the design and operations of the process equipment, piping, and the enclosure shall be involved in changes to any enclosure structure.

Repairs to cryogenic enclosures that are not introducing changes are a replacement in kind. Repairs shall be carried out in accordance with the original enclosure supplier's structural design, insulation specifications, purge system specification, etc. If the repair requires a modification to the structure, however simple, it shall be considered as a change in accordance with MOC procedures.

9.2 Structural members and panels

Welding or cutting shall not be performed on the panels or structural members of the enclosure from the outside without an engineering review of the structural design and its limitations.

Removing or modifying of panels can have one or more of the following hazards:

- Opening a panel can release all the perlite in the enclosure above the opening;
- There can be piping or wiring behind the panel that could be damaged;
- The panel can bear part of the structure load and removal could affect the structural integrity of the enclosure;
- The atmosphere behind the panel can be asphyxiating, oxygen-enriched, flammable and / or toxic; and / or
- If perlite surrounded by liquid cryogen is disturbed, it can cause a perlite eruption.

9.3 Insulation removal

AIGA 032 gives guidance on removing and installing perlite [10].

AIGA 032 discusses the hazard of removing perlite when cryogenic liquids have collected within the perlite [10]. In addition, the liquids can have a hazardous composition and the enriched liquid could create problems as described in 7.3.

9.4 Confined space entry

If a repair to the process piping or equipment inside the enclosure has to be carried out, the work inside the enclosure shall be conducted following confined spaces entry regulation(s) applicable to the location and the owner / operator's confined space entry work process procedures. All other applicable regulations shall be followed [22]. For more information, see AIGA 032 [10].

9.5 Equipment isolation

Some portions of the process equipment and piping inside the enclosure can be left cold or pressurised or contain hazardous energy or fluids while work is performed on other portions of the equipment / piping. The operator of the enclosure shall define appropriate circuit isolation procedures and lockout / tagout (LOTO) protection to ensure entrants are not exposed to unsafe work conditions. Experts knowledgeable in process isolation shall be engaged to review the isolation method and adequacy of any lockout, purging, and depressurising performed before the entry begins.

9.6 Perlite removal from piping and process equipment

If a leak or process line break occurs and the process pressure is less than the enclosure pressure (even for a short time), then perlite can enter the process piping and equipment.

In these cases, a risk assessment shall be performed to determine the consequences and hazards of perlite within the process. These include, but are not limited to the following:

- blocking small openings within equipment, particularly the small channels within brazed aluminium heat exchangers. See AIGA 057, *Safe Use of Brazed Aluminium Heat Exchangers* [1];
- increased pressure drop due to blocking of piping and other flow paths;
- operating problems with perlite continually accumulating on filters, strainers, and screens;
- reducing process performance by blocking distributors within columns and heat exchangers;
- potential for dry or pool boiling within reboilers, heat exchangers, leading to potential accumulation of hazardous mixtures; and
- damaging rotating equipment and valves when they ingest perlite.

When perlite is suspected within the process, it is prudent to stop the process immediately to prevent the perlite from moving further into the process.

DANGER: Failure to remove perlite and continuing to operate can lead to significant performance degradation, to accumulation of hazardous mixtures, and to explosions causing serious injury or death. This is an extremely serious situation. Experts shall be consulted before attempting to remove perlite from the equipment or piping.

In almost all cases, the assessment determines that the perlite shall be removed from the process. This is done by:

- Entering process equipment and physically removing the perlite;

- Stopping reboiler operation to prevent perlite from migrating further into the process;
- Flushing the plant with liquids and draining the perlite with the liquids. This can require repeated filling and draining of low points and sumps;
- Repeatedly cleaning and reinstalling filters, strainers, and screens; and
- Pressurisation and rapid depressurisation of process equipment (see AIGA 056 [2]).

9.7 Piping and equipment

Prior to modifying piping and / or equipment within the cryogenic enclosure, the new piping and equipment supports shall be analysed in relation to the existing piping and equipment. Existing piping and equipment supports shall be reanalysed if affected by modification. Much of the piping and equipment within the coldbox is cleaned for oxygen or cryogenic service. Before returning such piping and equipment to process service, it shall be appropriately cleaned [4].

10 Training

All personnel involved in the commissioning, operation, and maintenance of a cryogenic enclosure shall be informed regarding the hazards to which they can potentially be exposed.

Individuals shall receive specific training in the activities for which they are employed. Training shall cover, but not necessarily be confined to, the following subjects:

- Potential hazards of the materials;
- PPE;
- Site safety regulations;
- Operating with process leaks (see 8.5); and
- Emergency procedures (see 8.6).

If perlite handling is required, the personnel shall be trained in perlite management in accordance with AIGA 032 [10].

Periodic retraining is recommended to ensure that the personnel skill level remains current. Satisfactory completion of training / retraining shall be documented.

11 Quality assurance

A quality control plan and documentation is required for the fabrication and erection of cryogenic enclosures. The plan needs to detail both the fabrication and installation procedures noting differences for portions completed partially or completely in a shop.

All pipe welding and brazing shall be performed in accordance with welding and brazing procedures and by welders and brazers qualified to the procedures in accordance with the applicable piping code as defined for the intended installation location.

Inspectors and inspections shall be in accordance with the applicable piping code (ASME B31.3, EN 13480, *Metallic Industrial Piping*, or equivalent) [11, 23]. The applicable piping code shall be used for the type and quantity of testing. For example, NDT can be conducted verifying weld integrity by X-ray and penetrant testing, and piping integrity by pressure testing.

Inspection of cryogenic enclosure casing, support structure, and process equipment supports by qualified inspectors is also required for proper welding and attachments.

Material quality records should be part of the quality plan to confirm the correct material grade and characteristics have been provided per the design requirements.

If the cryogenic enclosure is modified, the original equipment fabrication quality control plan requirements should be followed unless deviations are reviewed by the original equipment manufacturer and found acceptable.

12 References

Unless otherwise specified, the latest edition shall apply.

- [1] AIGA 057, *Safe Use of Brazed Aluminium Heat Exchangers for Producing Pressurised Oxygen*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [2] AIGA 056, *Safe Practices Guide for Cryogenic Air Separation Plants*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [3] AIGA 035, *Safe Operation of Reboilers/Condensers in Air Separation Units*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [4] AIGA 012, *Cleaning of Equipment for Oxygen Service*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [5] AIGA 067, *Safe Location of Oxygen and Inert Gas Vents*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [6] Steinberg, T. A., Newton, B. E. and Beeson, H. D. *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, Volume 9, ASTM International. www.astm.org.

- [7] BS 2972, *Methods of Test for Inorganic Thermal Insulating Properties*, www.bsigroup.com.

- [8] ISO 1182, *Reaction to Fire Tests for Products—Non-Combustibility Test*, www.iso.org.

- [9] EIGA SI 23, *Fire in LOX Vacuum Jacketed Piping*, www.eiga.eu.

- [10] AIGA 032, *Perlite Management*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

- [11] ASME B31.3, *Process Piping*, www.asme.org.

- [12] EIGA PP-14, *Definitions of Oxygen Enrichment/Deficiency Safety Criteria Used in IHC Member Associations*, www.eiga.eu.

[13] AIGA 010, *Management of Change*, www.asiaiga.org

[14] AIGA 008, *Hazards of Oxygen-Deficient Atmospheres*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

[15] CSB Safety Bulletin, *Nitrogen-Enriched Atmospheres Can Kill*, U.S. Chemical Safety and Hazard Investigation Board. www.csb.gov.

[16] CSB Safety Bulletin, *Hazards of Nitrogen Asphyxiation*, U.S. Chemical Safety and Hazard Investigation Board. www.csb.gov.

[17] CSB Final Report: *PowerPoint Presentation, The Hazards of Nitrogen Asphyxiation*, U.S. Chemical Safety and Hazard Investigation Board. www.csb.gov.

[18] AIGA 005, *Fire Hazards of Oxygen and Oxygen Enriched Atmospheres*, www.asiaiga.org

NOTE This publication is part of an international harmonisation programme for industry standards. The technical content of each regional document is identical, except for regional regulatory requirements. See the referenced document preface for a list of harmonised regional references.

[19] Bohlken, S. F., *Heat Exchanger Explosion in a Nitrogen-Wash Unit*, Chemical Engineering Progress, April 1961, Vol. 57, pp. 49-52. www.aiche.org.

[20] Sakai, Y., *This Ammonia Unit Exploded*, Petroleum Refinery, January 1961, Vol. 40, pp. 178-181.

[21] AIGA 011, *Work Permit Systems*, www.asiaiga.org

[22] *Code of Federal Regulations*, Title 29 (Labor), U.S. Government Printing Office, www.gpo.gov.

[23] EN 13480, *Metallic Industrial Piping*, www.cen.eu.

[24] AIGA SB 22, *Safety Inspection Check List of Air Separation Units and Cryogenic Liquid Storages*, www.asiaiga.org

Appendix A – Cryogenic coldbox located pressure equipment (Informative)

The industrial gases industry generally does not carry out periodic inspection of cryogenic equipment within a coldbox.

Periodic inspections of cryogenic equipment are not carried out for the following reasons:

- Industry operating experience;
- Cryogenic plants are constructed from materials that have low corrosion potential. These materials retain their corrosion resistance at temperatures less than ambient and experience shows that corrosion at cryogenic temperatures is negligible;
- Process fluids are dry, clean, and non-corrosive;
- Dry, inert atmosphere purge space;
- Limited impact of the traditional failure mechanisms for such equipment: namely erosion and fatigue due to the external cryogenic coldbox structure;
- Design and construction are carried out to well established and internationally recognised codes and standards. Design takes into account pressures, loadings, temperature changes, and movements expected during normal running and during start up and shutdown;
- Operating mode of a cryogenic air separation plant is generally steady state with few pressure and temperature variations;
- Some materials used in the construction have high fracture toughness characteristics. The critical defect size for the initiation of an unstable fracture can allow a defect to be detected from an increase in coldbox pressure or from the presence of cold patches well before the critical defect size is reached; and
- Materials used in the construction have significantly enhanced yield and ultimate tensile strengths at their working temperature. For example, at cryogenic temperature the ultimate tensile strength of austenitic stainless steel is approximately twice that at ambient temperature.

In industry, there have been incidents where failure of the enclosure has been reported. A periodic inspection and maintenance plan shall be set up to ensure integrity of the enclosure (for example, tightness, embrittlement of the carbon steel structure, purge gas, icing, perlite level, vacuum). Inspections should

confirm that the environment within the coldbox is dry, inert, and that there are no indications of cryogenic and / or pressure leaks.

Two examples of checklists follow: Table A1 is for routine exterior inspections and Table A2 is for inspections of a coldbox when an opportunity arises because the perlite has been removed. These checklists contain useful guidance but do not contain mandatory requirements.

Table 2 – Example of a coldbox located pressure equipment annual inspection checklist

<u>#</u>	<u>Inspection Item</u>	<u>Condition Found</u>	<u>Remedial Actions (if required)</u>
1	<u>Check for ice build up on the coldbox skin, and where valves and pipework penetrate the coldbox.</u> <u>Where ice build up is found:</u>		

#	Inspection Item	Condition Found	Remedial Actions (if required)
	<ul style="list-style-type: none"> compare extent with previous inspections or plant operator reports with consideration of the time of year or ambient temperature; and determine and record the cause of the ice buildup, whether it represents a hazard to internal equipment or the coldbox structure, and any remedial action required. <p>NOTE Pay particular attention to new patches or patches that engulf carbon steel structural beams.</p>		
2	<p>Where ice patches are of a size where they could represent a danger to personnel or equipment if they detach (for example following a plant trip), appropriate precautions shall be implemented, for example:</p> <ul style="list-style-type: none"> install scaffold platform; cordon off the area; and provide warning signs. 		
3	<p>Check for cracks in the coldbox skin and on structural beams.</p> <p>Where cracks are found:</p> <ul style="list-style-type: none"> compare size and location with previous inspections or plant operator reports; determine and record the cause of the cracks; determine whether there is a risk of loss of perlite or whether a hazard exists to internal equipment or the coldbox structure; and determine any remedial action required. 		
4	<p>Check for significant corrosion on the coldbox structure, any externally mounted spring hangers, and holding down bolts.</p> <p>NOTE Pay particular attention to any beams and columns on the underside of the box where maintenance of paint integrity is harder to ensure.</p> <p>NOTE Ensure there is no wet debris in contact with significant carbon steel supports.</p>		
5	<p>Check interspace purge for adequate flowrate.</p> <p>NOTE—Each entry point shall indicate a flow.</p> <p>Check operator reports to confirm interspace flow has been maintained.</p>		
6	<p>Check that nitrogen purge feed pipework is protected against corrosion and that the integrity of the pipework is maintained.</p>		
7	<p>Check coldbox purge gas pressure and oxygen % from analysis tapping at roof level (and if considered necessary at other points).</p>		
8	<p>Check coldbox interspace pressure monitoring switches or transmitters for correct signal, value, tagging and alarm set point.</p> <p>Ensure their location is known to operators.</p>		
9	<p>Check all interspace overpressure protection devices.</p> <p>Check that they are included on the piping and instrumentation diagram (P&ID) and are periodically examined.</p>		

#	Inspection Item	Condition Found	Remedial Actions (if required)
	<p>Check any coldbox interspace deadweight or hinged flap pressure relief devices for correct marking, positioning, or signs of recent lifting.</p> <p>Visually check any side mounted blowout disks are in place and free from ice build up.</p> <p>NOTE If close access is not possible the check may be carried out from ground level or other position with the use of binoculars.</p>		
10	Check process pressure relief valves for correct marking, positioning, and freedom from ice build up, leakage, or signs of lifting.		
11	<p>Check for potential water ingress points through manway covers, cover gaskets, corrosion through carbon steel cladding, split valve boots, etc.</p> <p>Check for evidence of excessive steam usage (for example, to thaw ice patches on valve boxes).</p> <p>NOTE Any moisture ingress to coldbox can result in frozen wet perlite, which can constrain and damage pipework.</p>		
12	<p>Check valve spindle penetrations for indications of contact with the coldbox structure.</p> <p>Record any such examples and determine the significance and any remedial action.</p>		
13	Check that internal vessel nameplates are readable and securely displayed on external face of the coldbox.		
14	Check that access ways, roofs, handrails, access ladders, cages, platforms, kick plates are all in a safe condition.		
15	<p>Check and record integrity of pipe lagging, field pipework, instrumentation, etc.</p> <p>Consider the following:</p> <ul style="list-style-type: none"> • paint condition; • insulation in good order and weather sealed; and • no deposits on surface of pipework. <p>If significant corrosion found, carry out an ultrasonic thickness survey of the corroded pipework.</p>		
16	Check perlite level and top up as required (If the addition of perlite is more than would be considered due to compaction further investigation could be required).		
17	Review plant operator report records and any adverse issues raised since last coldbox inspection.		
18	Check the plant has adequate written thawing and start up procedures.		

Table 3 – Example of a coldbox located pressure equipment inspection checklist

#	Inspection Item	Condition Found	Remedial Actions (if required)
1	<p><u>Visually examine external surfaces of pipework, pressure vessels, heat exchangers, and valves for cracks, corrosion, damage, or deterioration.</u></p> <p><u>NOTE</u> Where appropriate, NDT methods such as dye penetrant, ultrasonic, or eddy current techniques should be used.</p> <p><u>Pay particular attention to:</u></p> <ul style="list-style-type: none"> • <u>welded areas and changes of section for cracks;</u> • <u>potential presence of perlite scouring damage;</u> • <u>instrument lines where they connect to vessels or pipework that could have become deformed;</u> • <u>potential pipework corrosion due to wet insulation, particularly under metal banding;</u> • <u>high pressure pipework;</u> • <u>austenitic stainless steel vessels and pipework local to possibly moist slag wool insulation due to the potential for stress corrosion cracking.</u> 		
2	<u>Where possible, visually examine internal surfaces of coldbox cladding for signs of water ingress that could indicate flaws in the coldbox jacket.</u>		
3	<u>Examine coldbox structural framework for deterioration or cracking due to cryogenic leaks.</u>		
4	<u>Examine condition of pipe and equipment supports.</u>		
5	<u>Examine pipework hanger condition and their attachment points to equipment and structures.</u>		
6	<u>Visually examine the internal purge gas distribution pipework. Check for indication of blockages to vent holes or loss of any hole protecting filter cloth.</u>		
7	<p><u>Carry out a leak test of the coldbox located pressure equipment, if possible.</u></p> <p><u>NOTE</u> Typically at 0.5 bar (7 psi)</p>		
8	<u>When applicable, significantly modified or repaired coldbox equipment shall be subjected to NDT in accordance with the design code.</u>		